



National Training Program

NACT 299

Introduction to Control Devices

House Keeping

- Bathrooms
- Emergency Evacuation
- Cell Phones
- Refreshments
- Questions
- Agenda



- 
- A photograph of an industrial facility, likely a power plant or refinery, featuring a tall, cylindrical smokestack and several large, rectangular buildings. A thick plume of white smoke or steam is being emitted from the buildings, drifting across the sky. The sky is a mix of blue and orange, suggesting a sunset or sunrise. The overall scene is industrial and atmospheric.
- ◆ **Particulate Matter**
 - ◆ **VOC**
 - ◆ **SO_x - FGD**
 - ◆ **CO**
 - ◆ **NO_x**

Control Equipment

Combustion Considerations

3 T's of Combustion

- Time (residence time)
- Temperature
- Turbulence (mixing)
- Increase 3T's > more NO_x
- Decrease 3T's > more CO & PICs




Let's Discuss CO Catalyst


CO Catalyst

- $2\text{CO} + \text{O}_2 \rightarrow 2\text{CO}_2$
- 700 to 1000 °F operating temp
- 90% plus efficiency
- Pressure drop 1-2 in. H₂O
- Problems
 - Expensive
 - High maintenance
 - Catalyst replacement

CO Catalyst

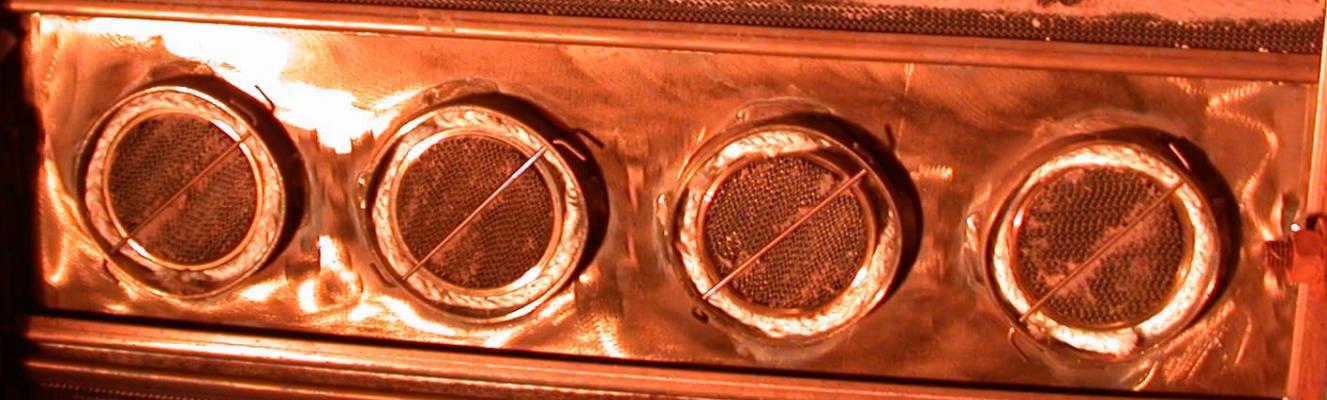

SECTIONAL VIEW

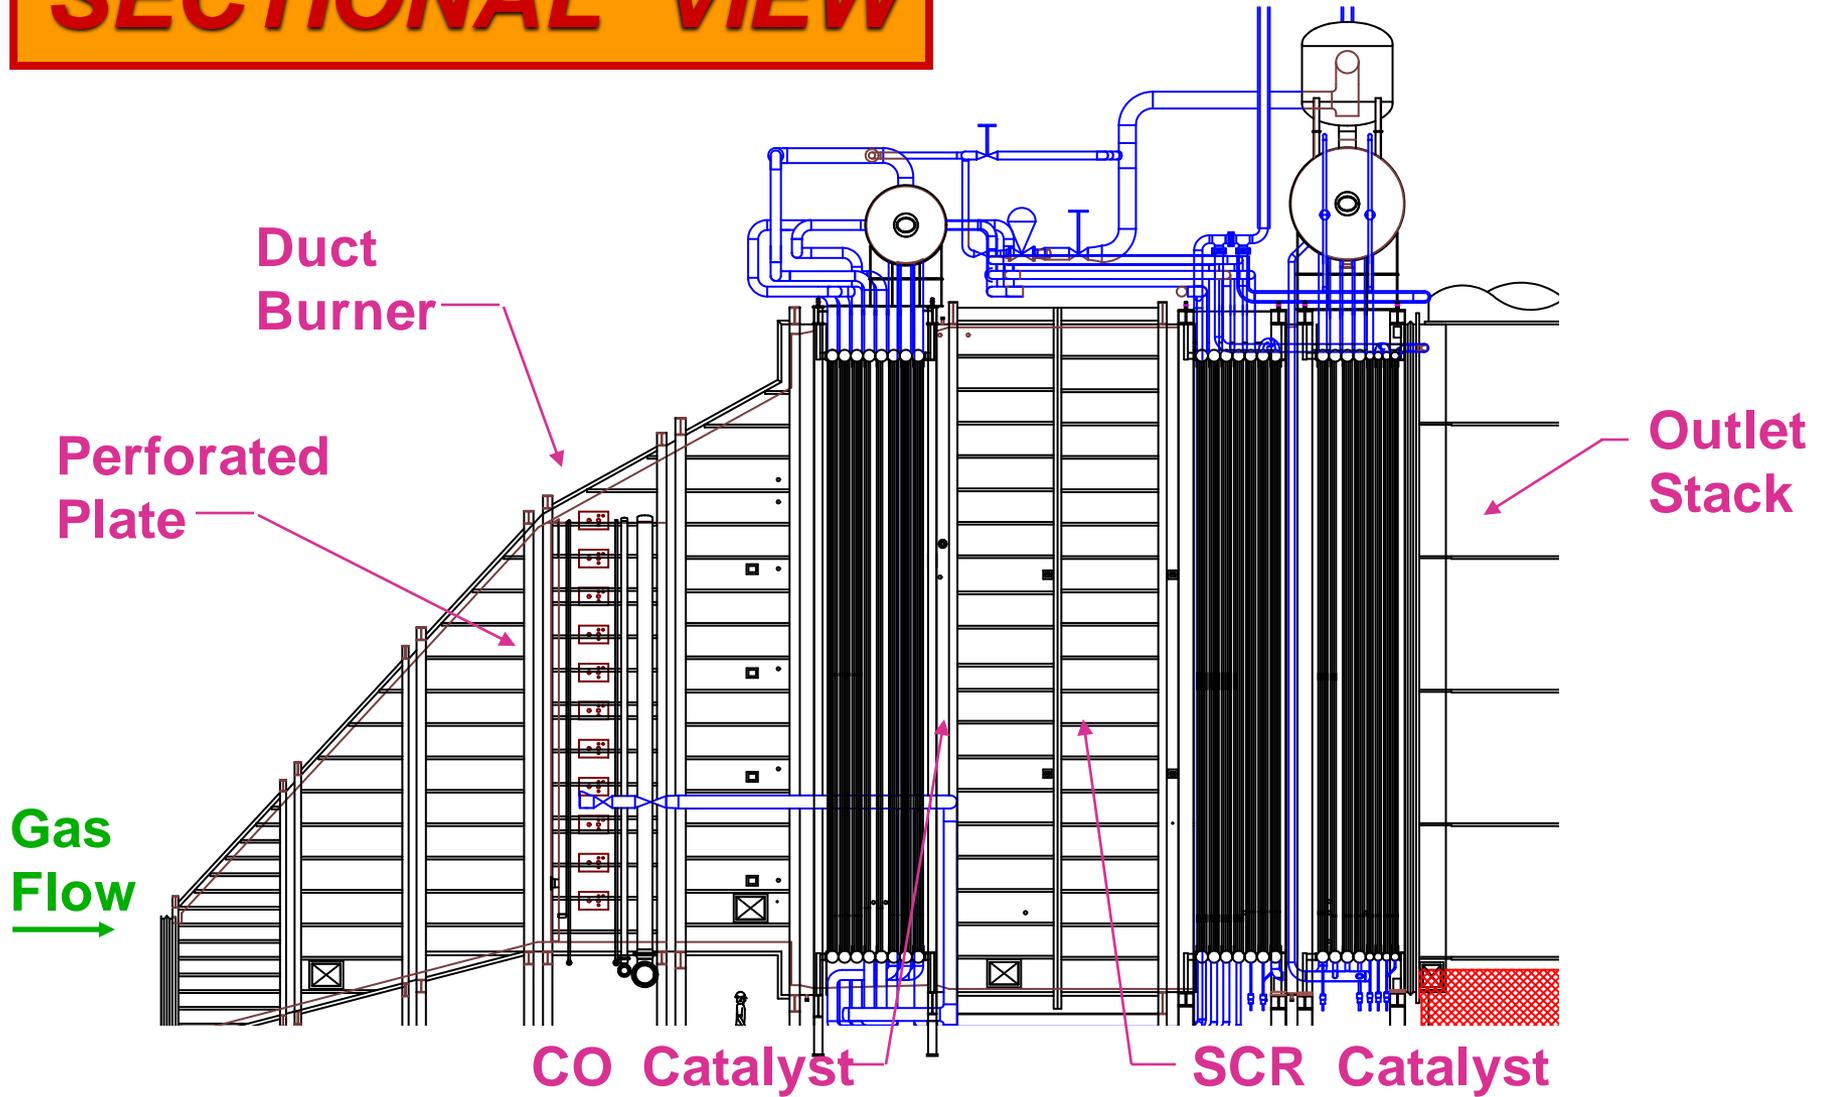

Let's Discuss NOx Control

- **Formation of NOx**
- **Low-NOx combustion techniques**
- **Ammonia injection (SCR & SNCR)**
- **Catalytic controls**




Thermal NOx
Fuel-bound NOx
Prompt NOx



NOx Creation



NOx vs. Temperature

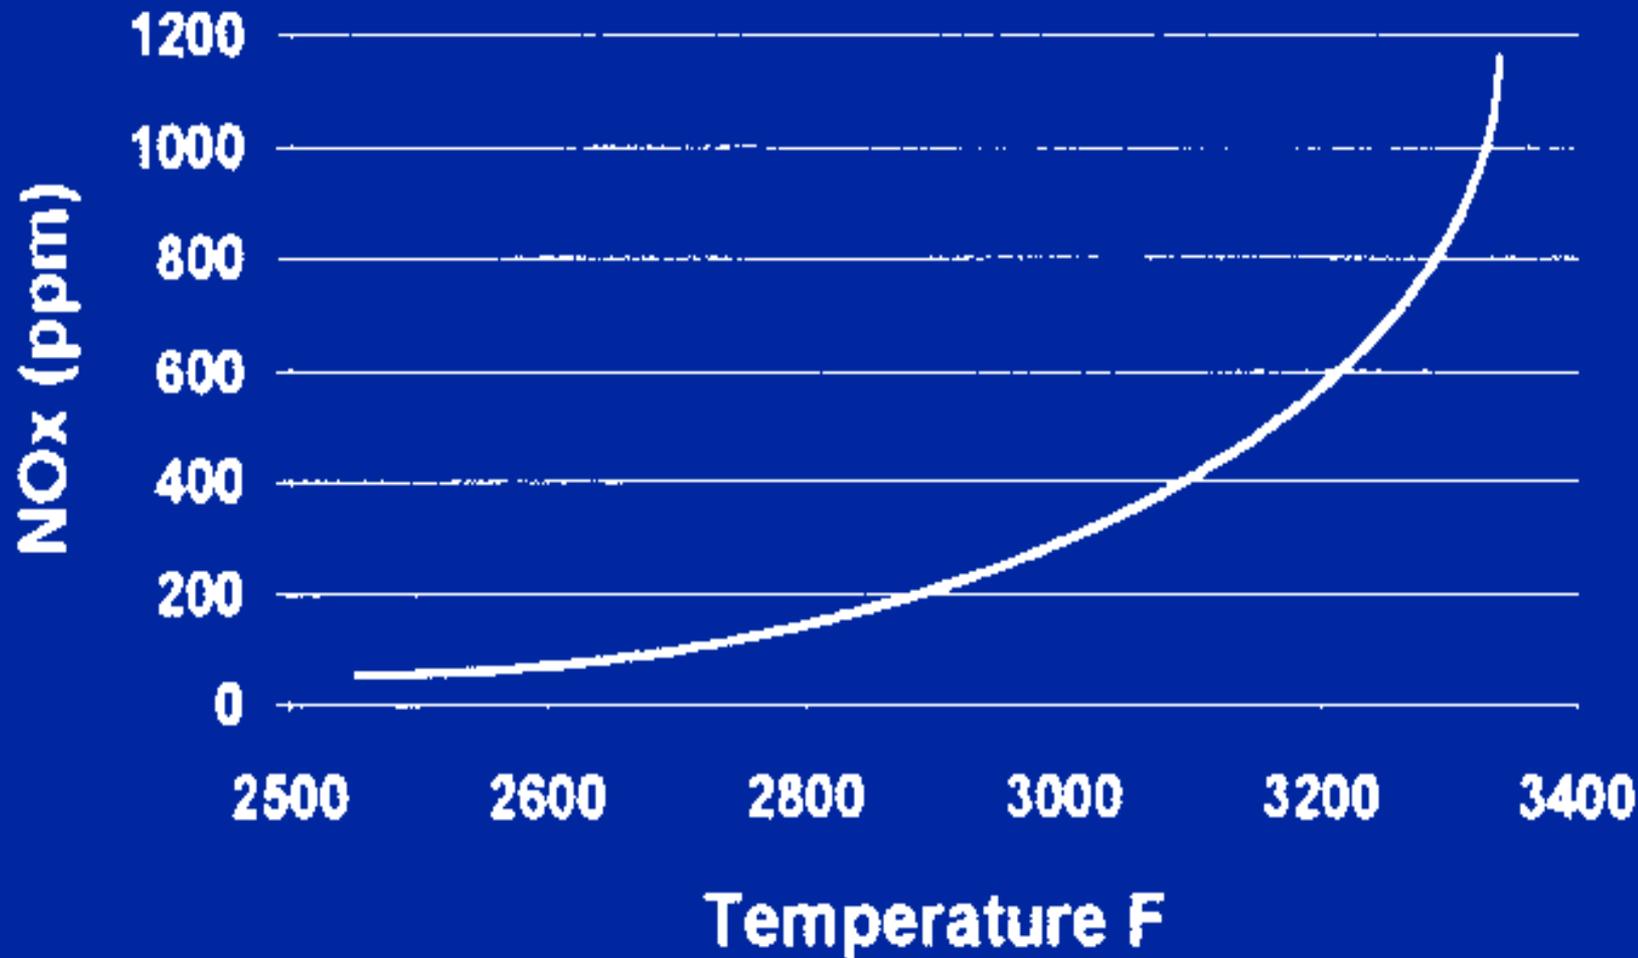

Babcock & Wilcox Utility Boiler




Staged Combustion with Overfire Air

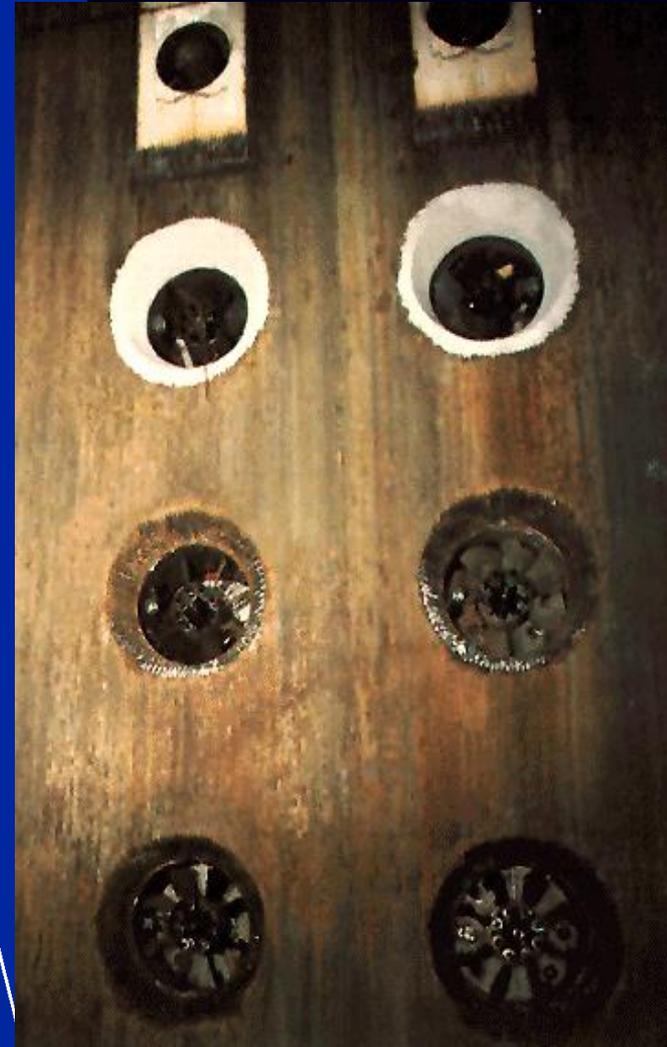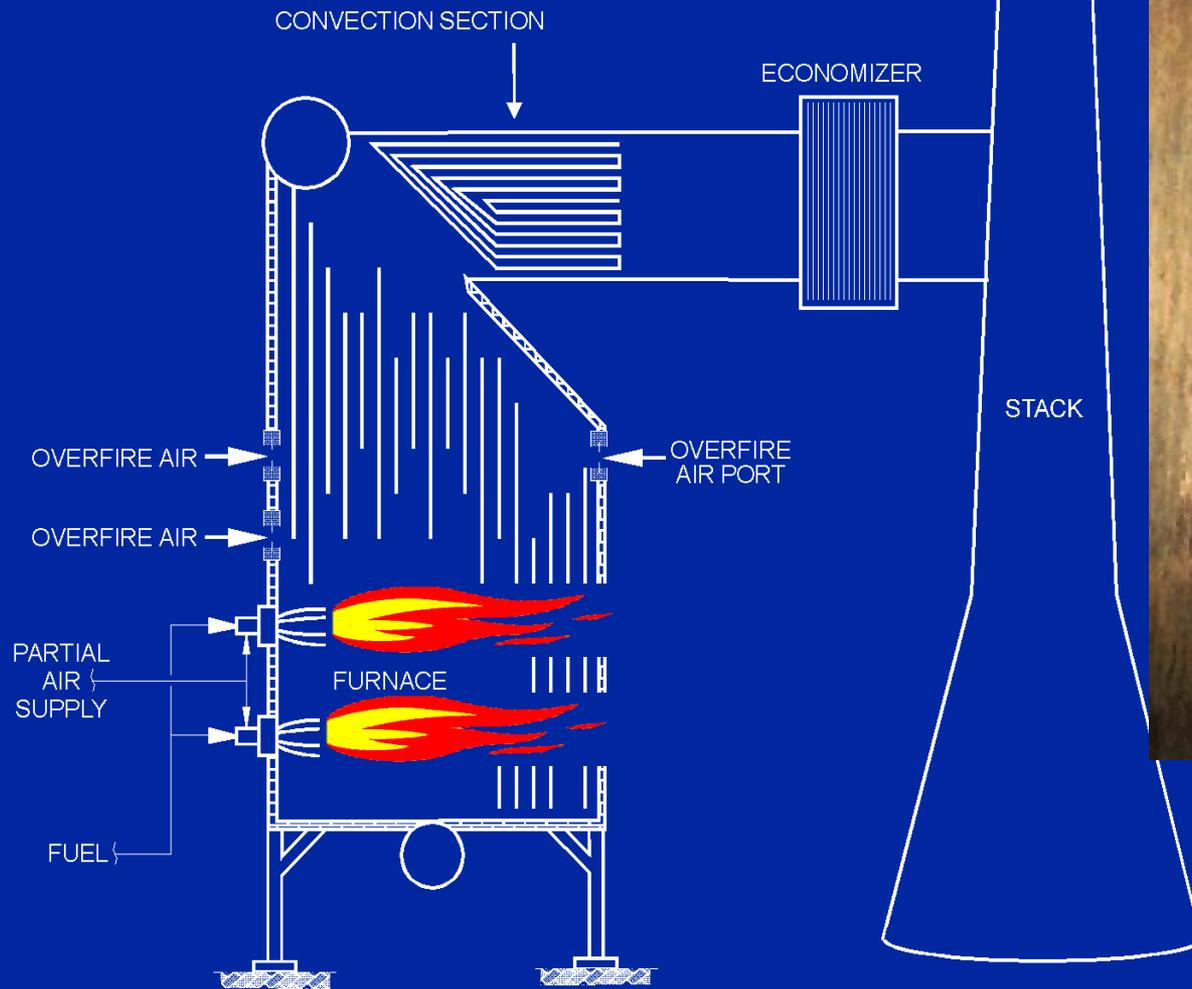




Fire-Tube Boiler

Low-NOx Burner with Staged Fuel

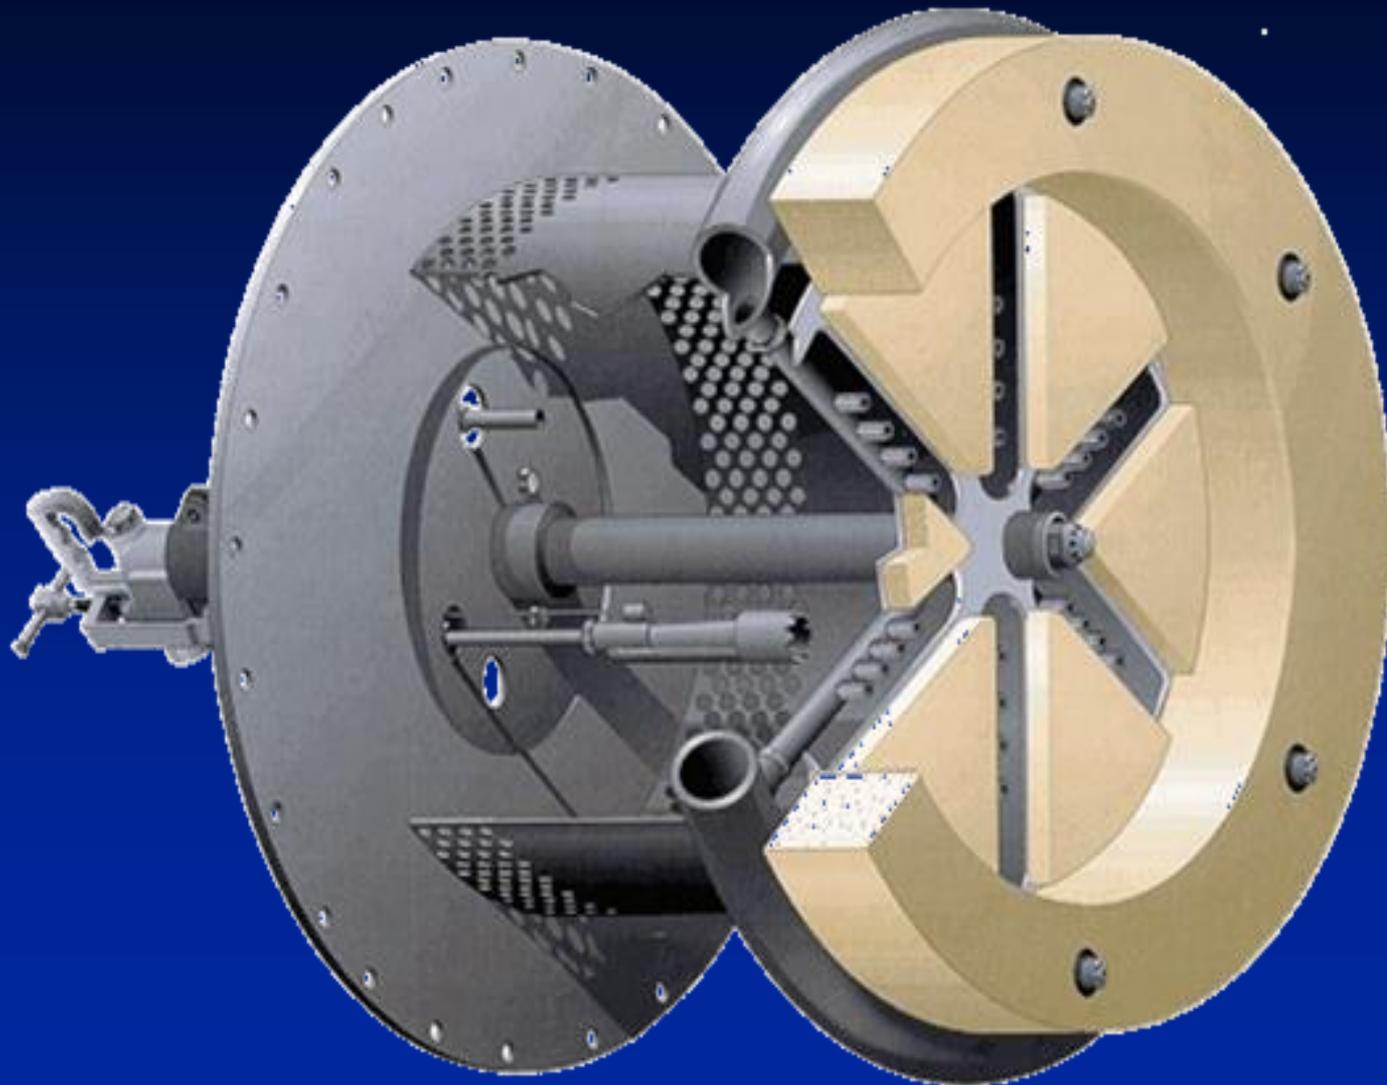

Low-NOx Burner with Staged Fuel

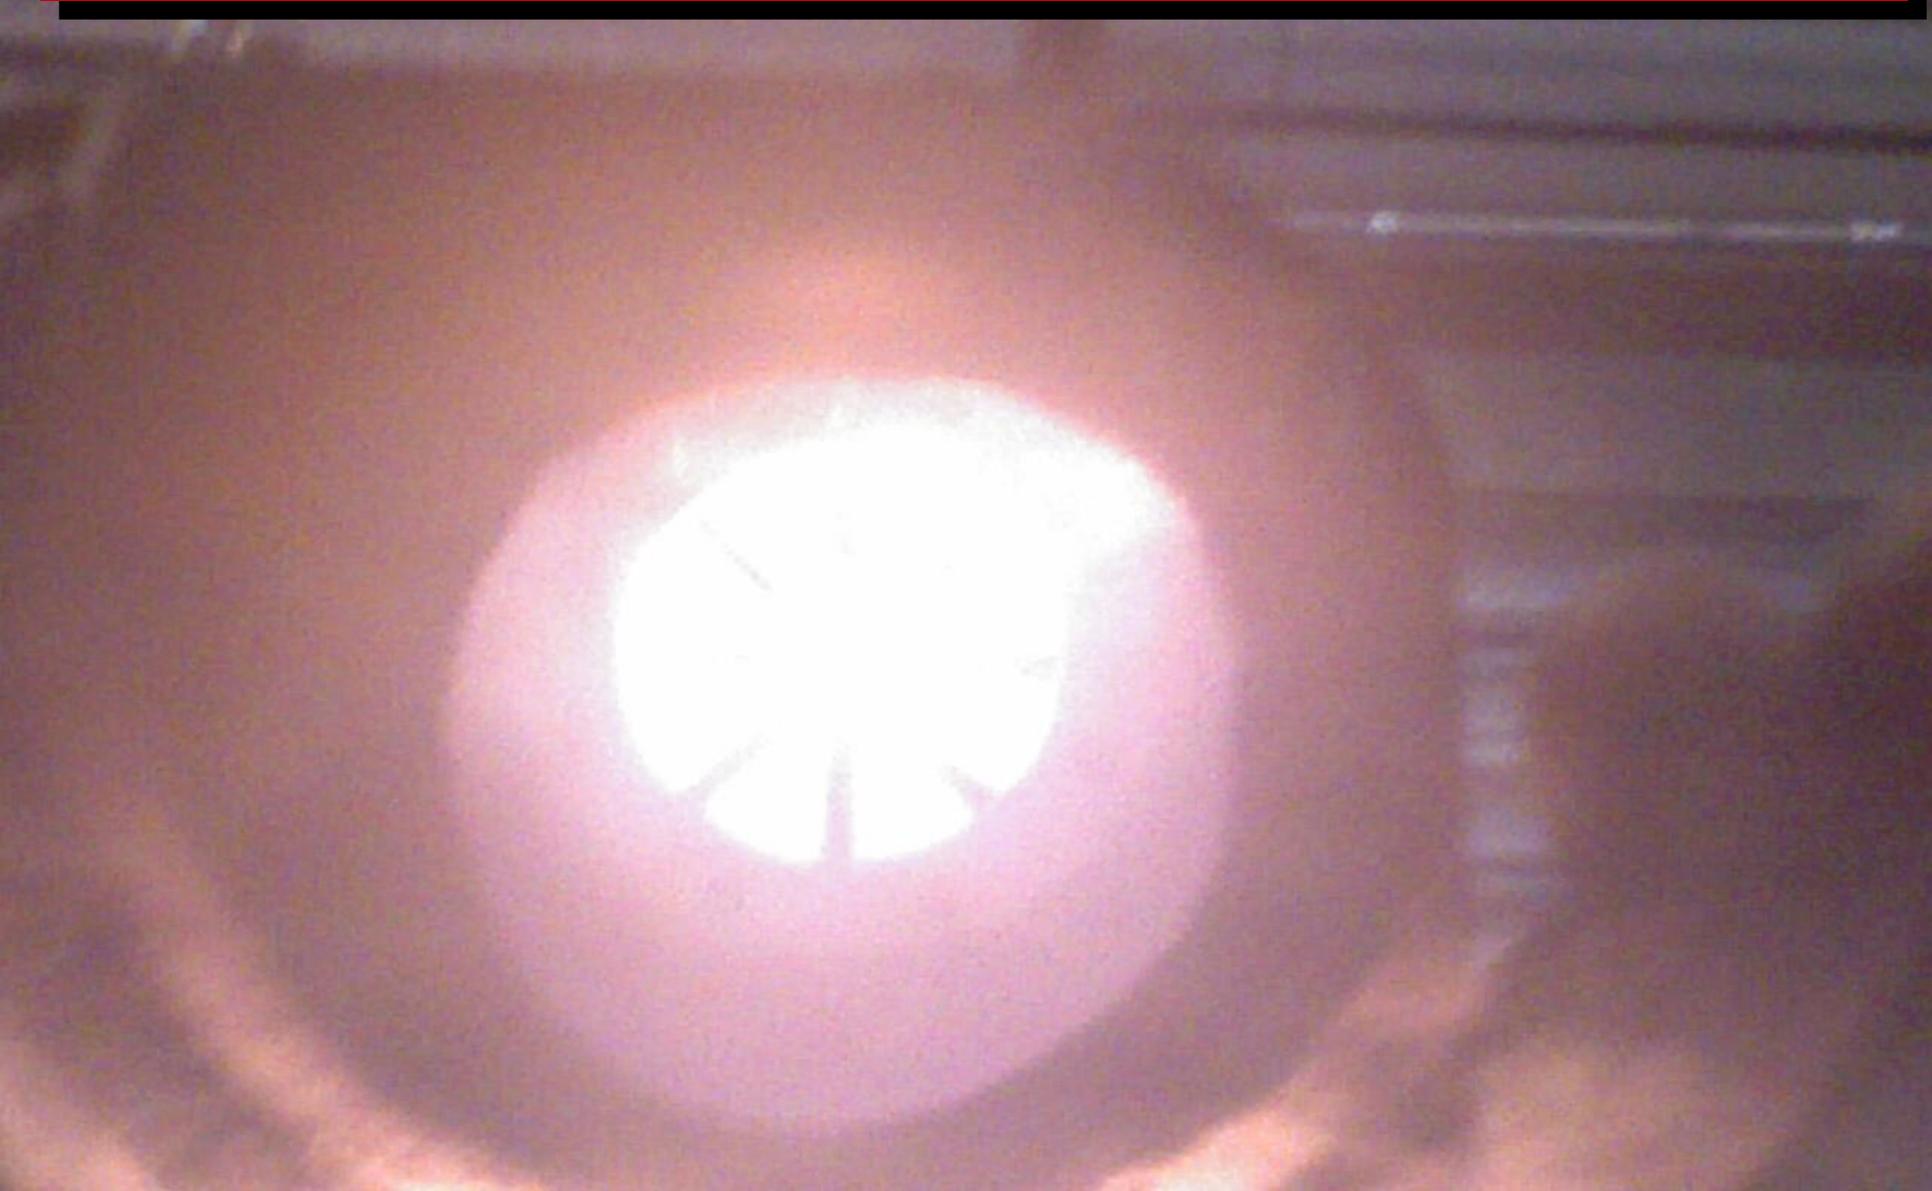

A photograph of a large industrial burner assembly. The burner is a cylindrical metal component with a flange and several horizontal support tubes. It is mounted on a blue metal frame. A bright green gas line is connected to the bottom of the burner. The blue frame has the "NATCOM" logo in white, stylized letters with a red and yellow flame icon. The burner is set against a background of a red metal fence and a blue industrial fan.



NATCOM

Ultra Low-NOx Burner (9 ppm)




Flue Gas Recirculation



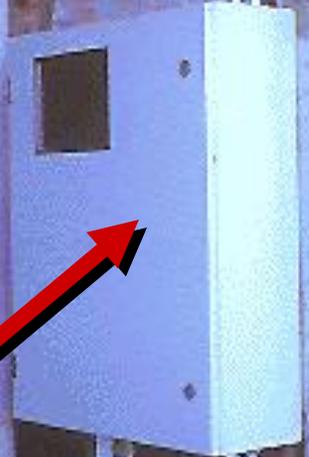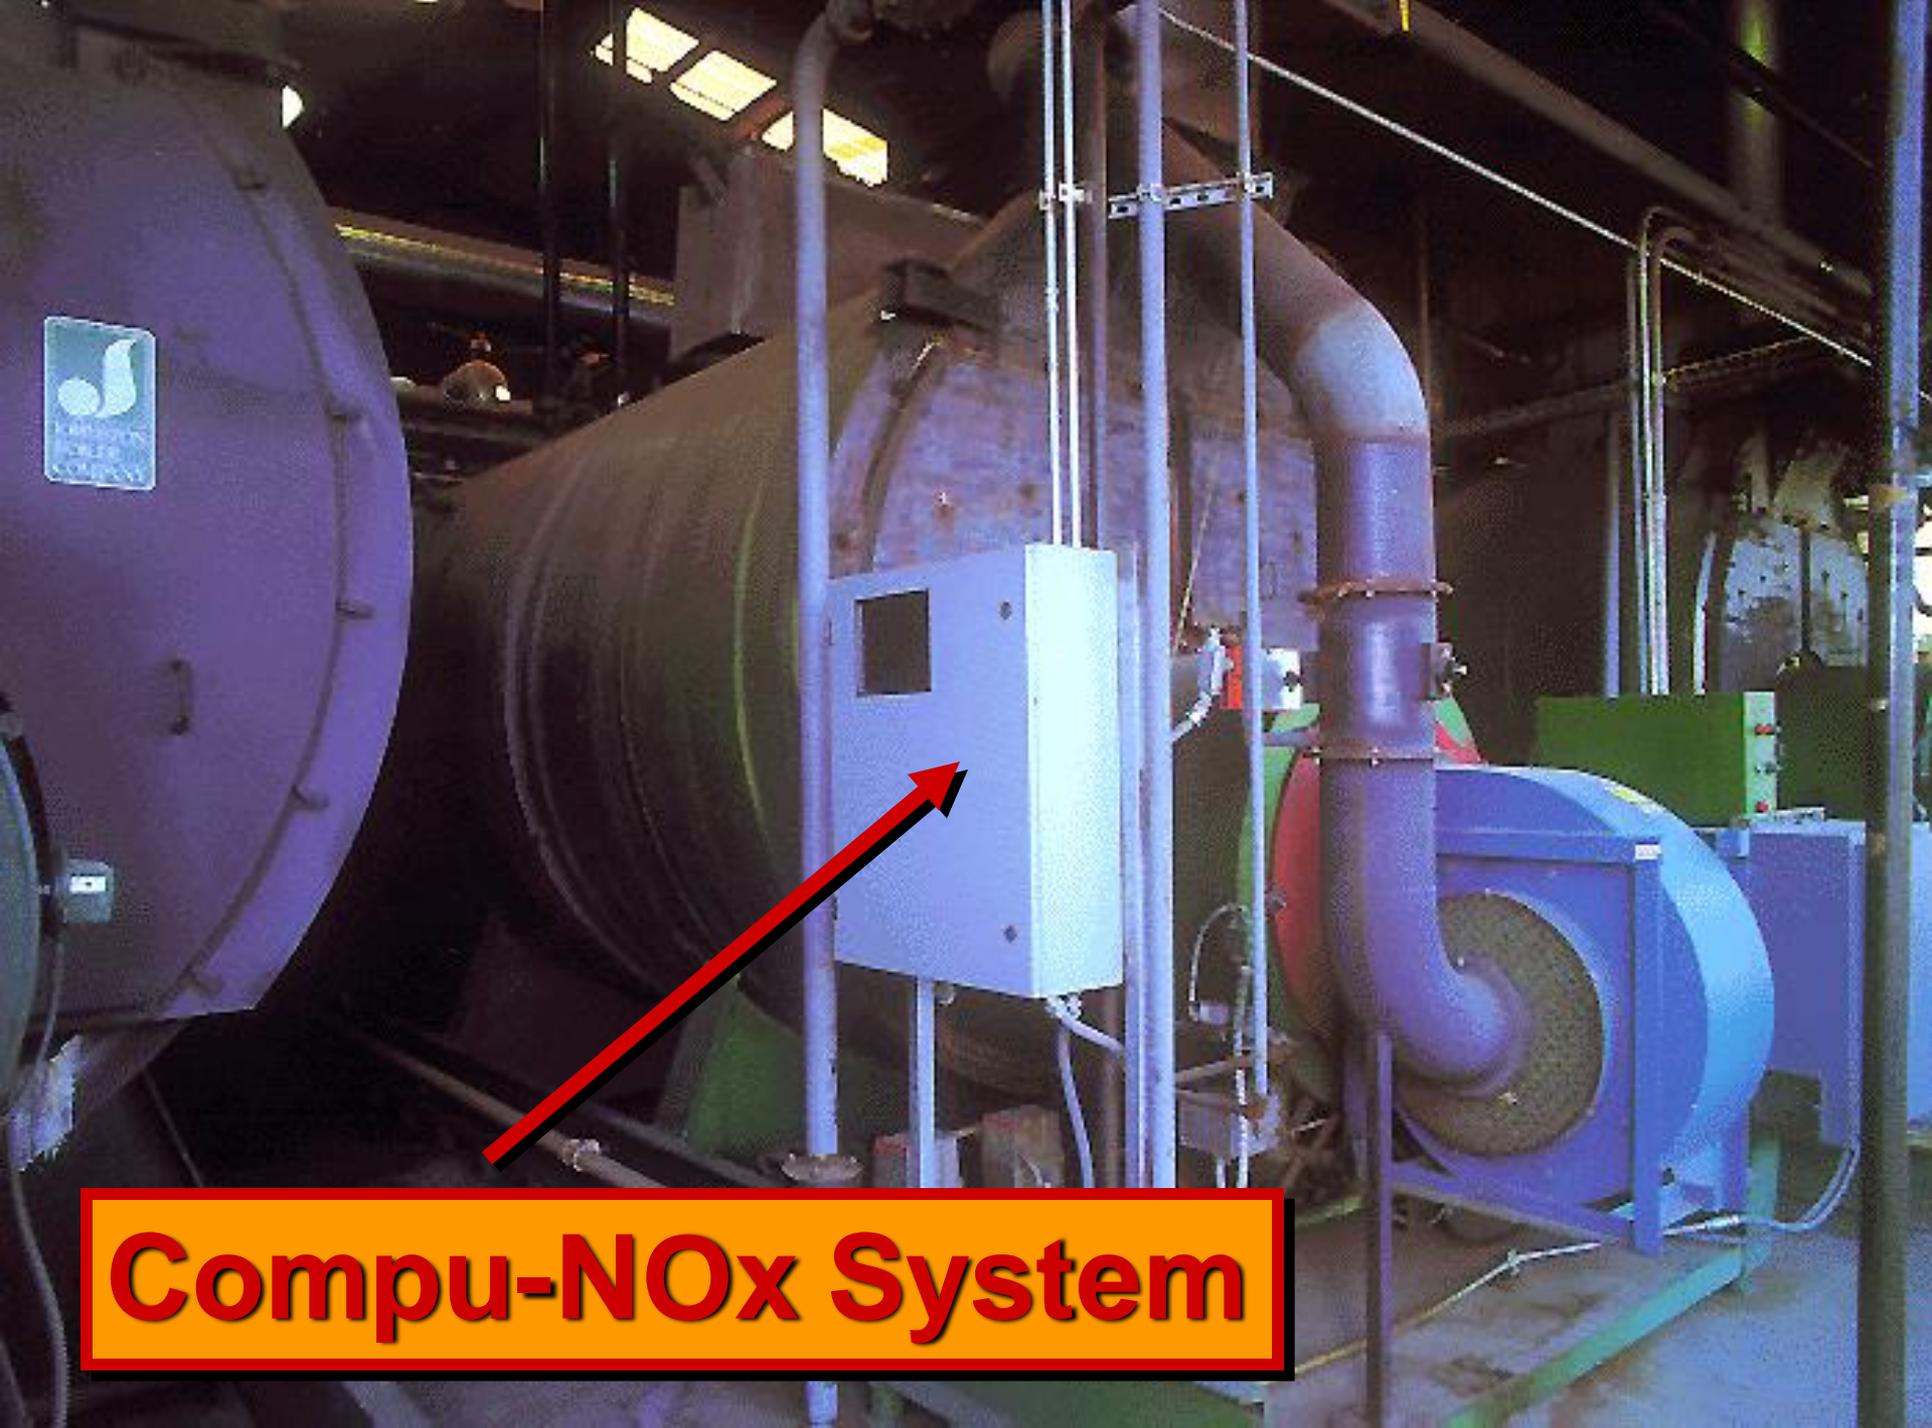

Compu-NOx System

NOx Reduction by Boiler Configuration

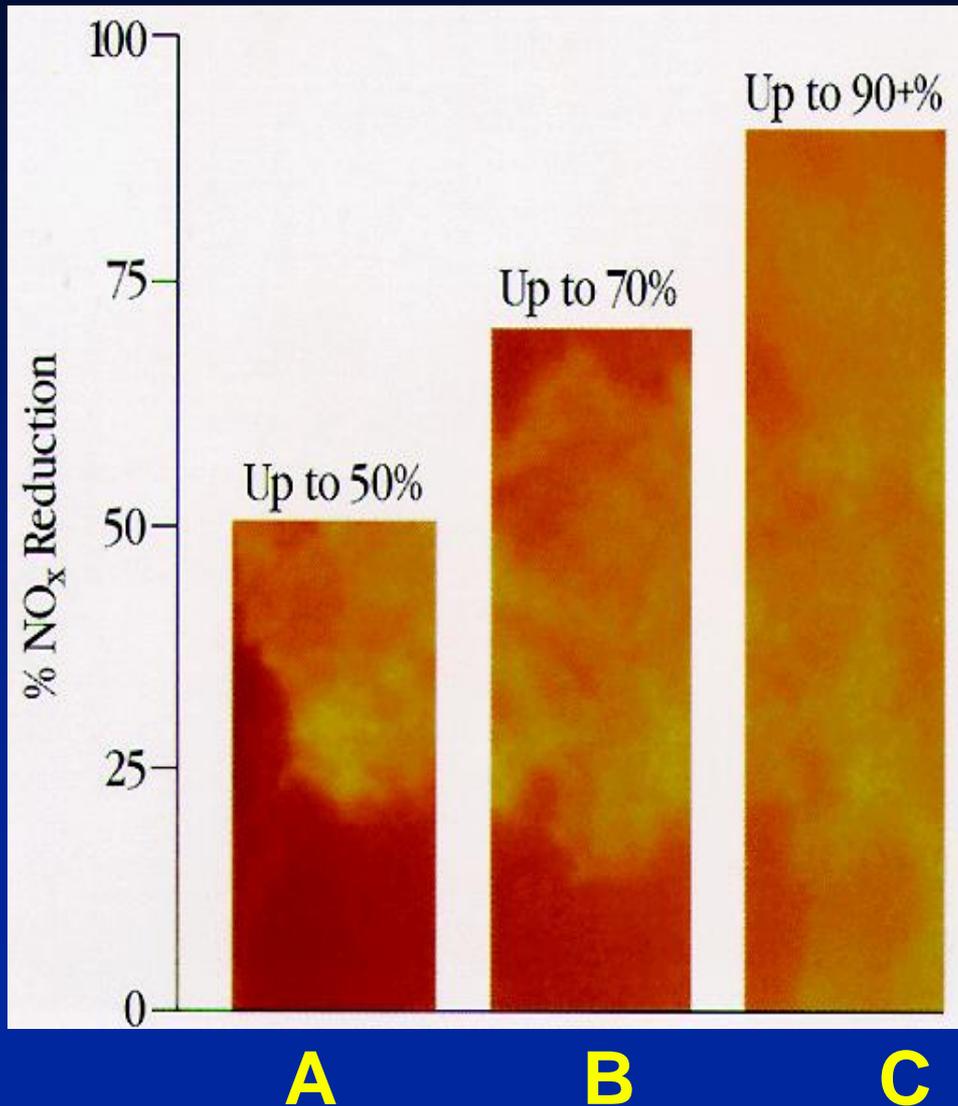

A: Low-NOx burner only, no overfire air (OFA)

B: Low-NOx burner with OFA

C: Ultra Low-NOx burner with FGR


Let's Discuss Gas Turbine Power Plant Controls




Gas Turbine Power Plant



GE LM6000 Gas Turbine

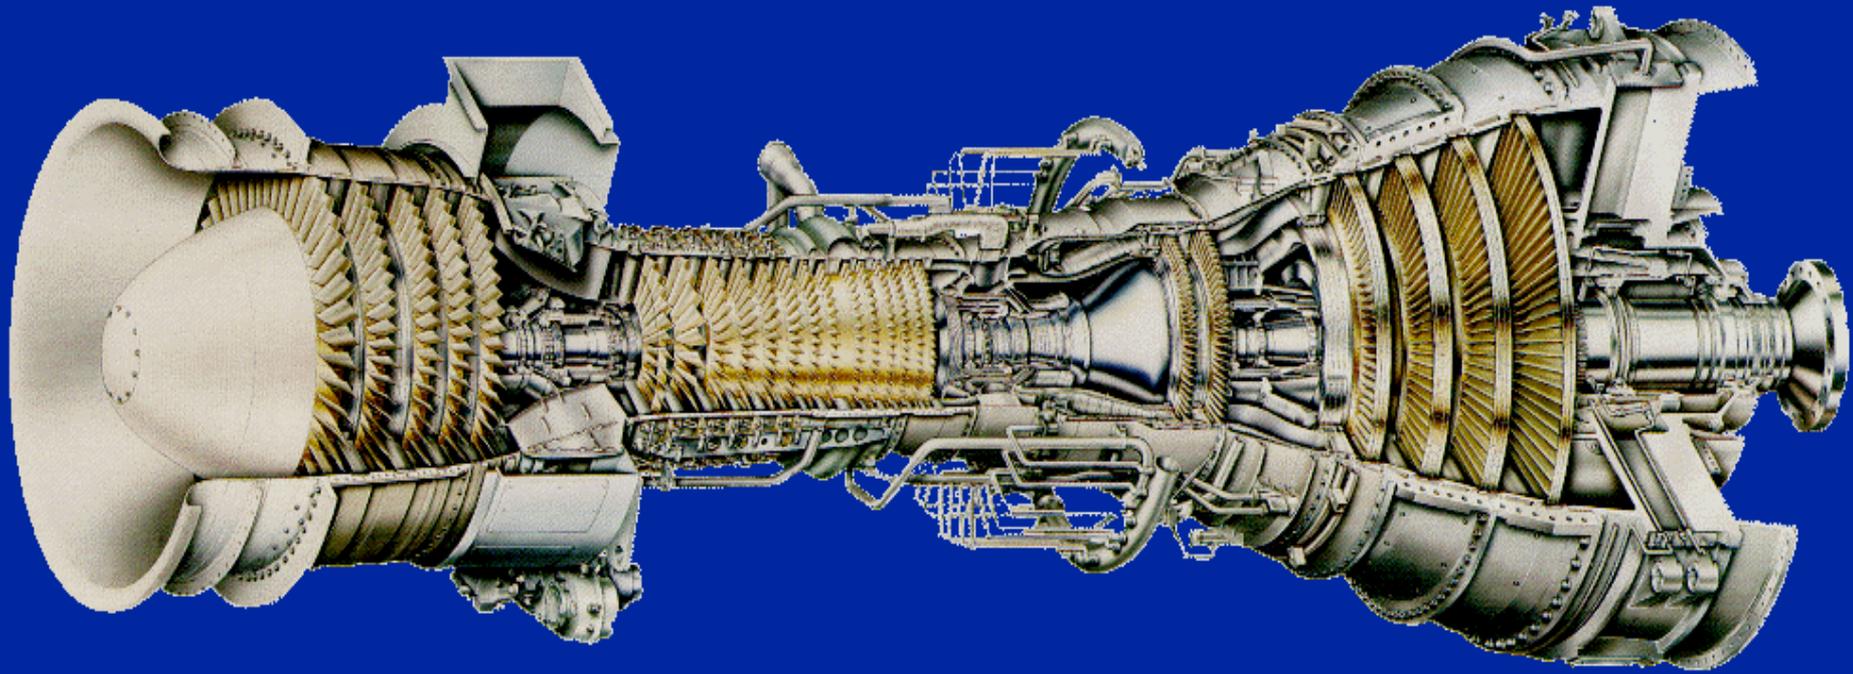

Can-Annular Lean Premix Burner

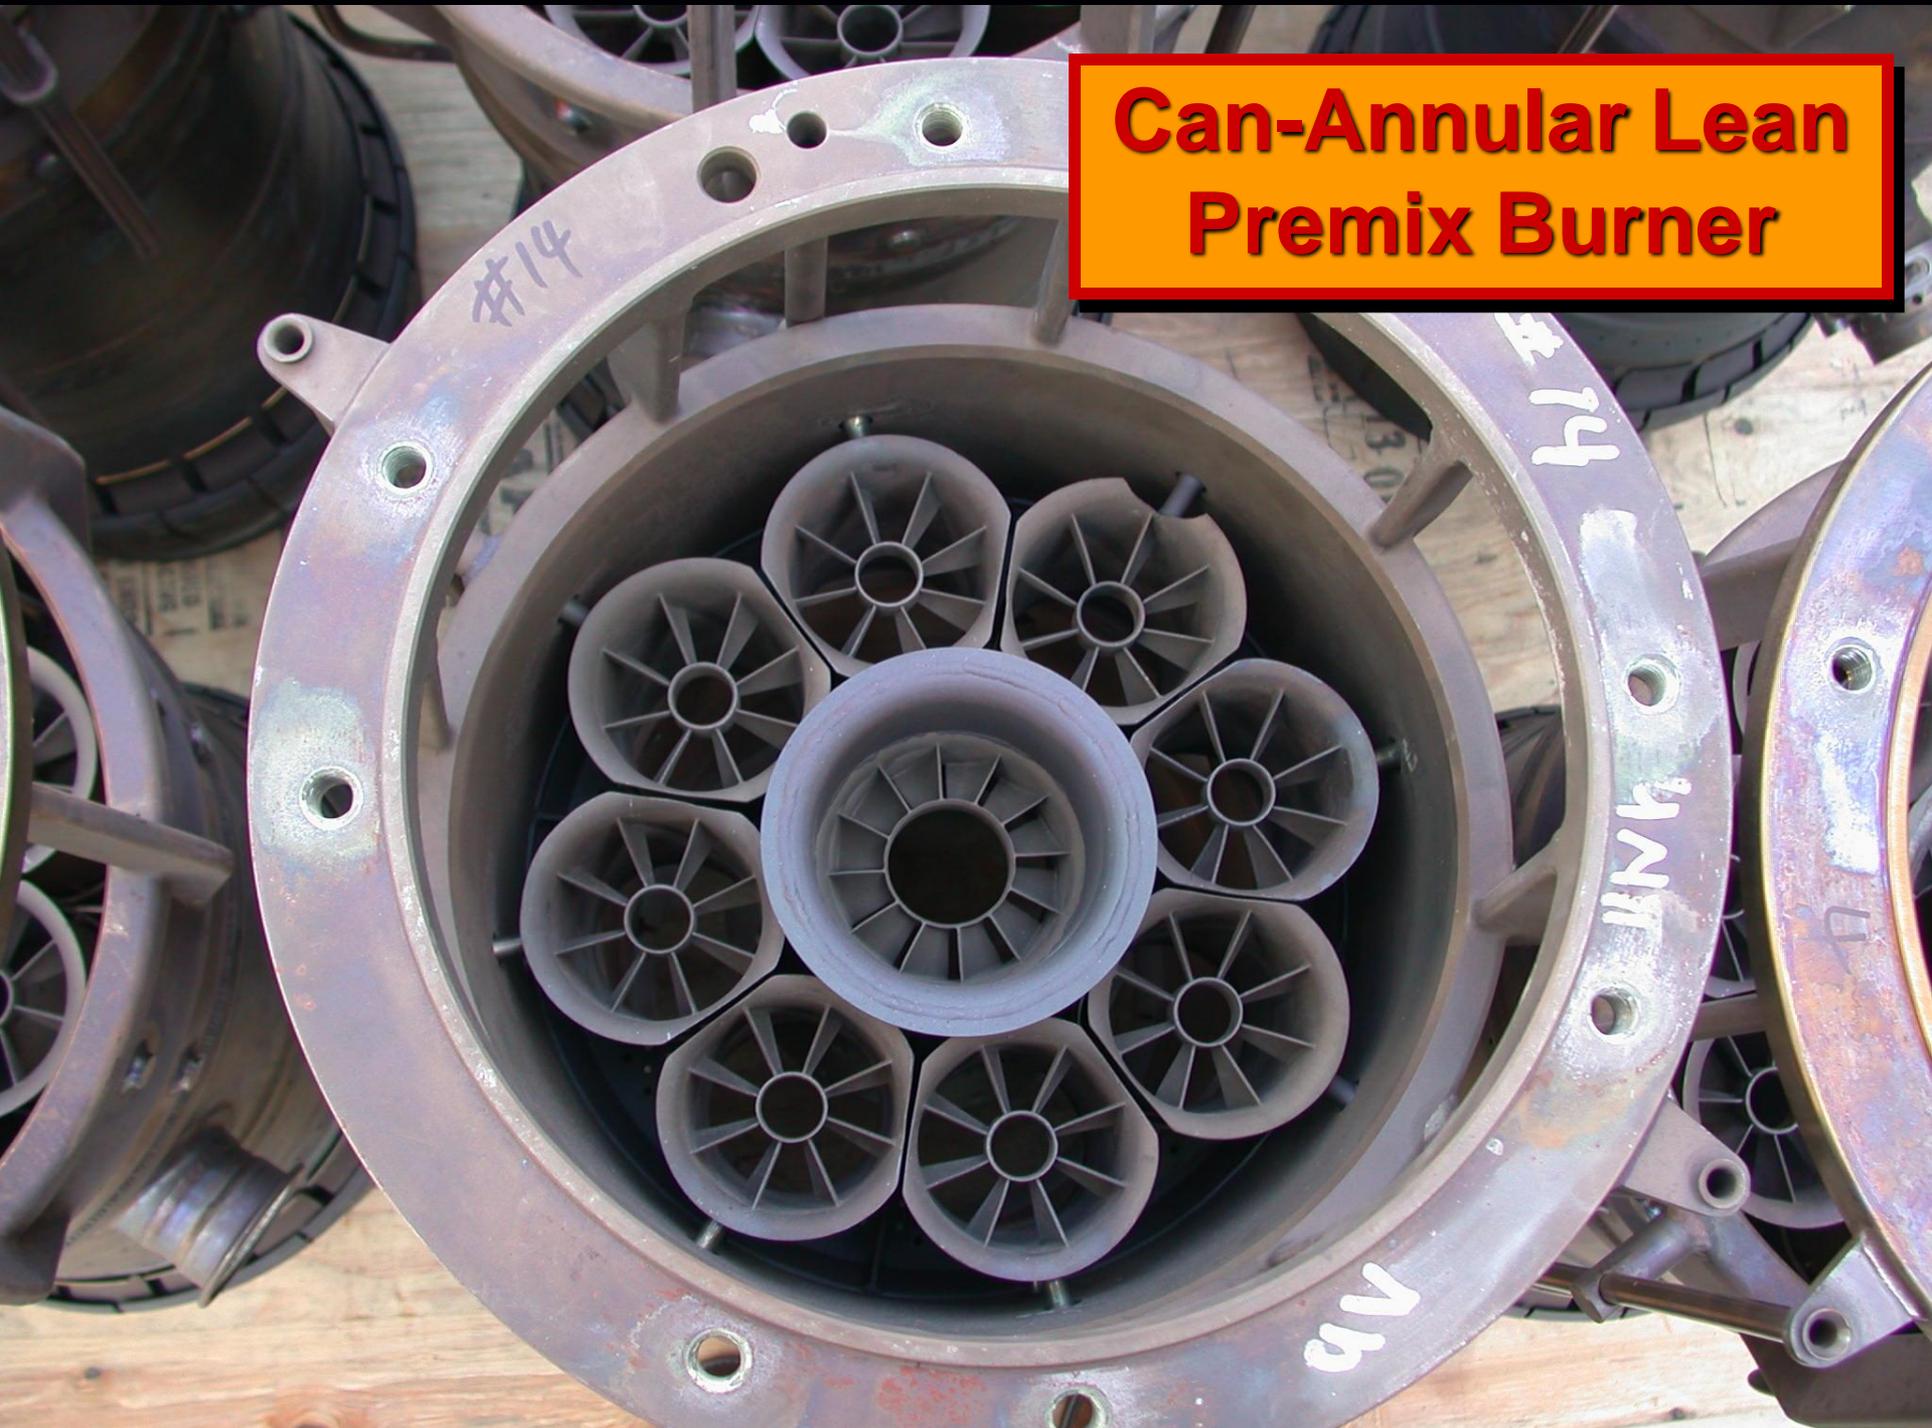



Fuel Nozzles



**Can Annular
Combustors**

**Turbine
Blades**

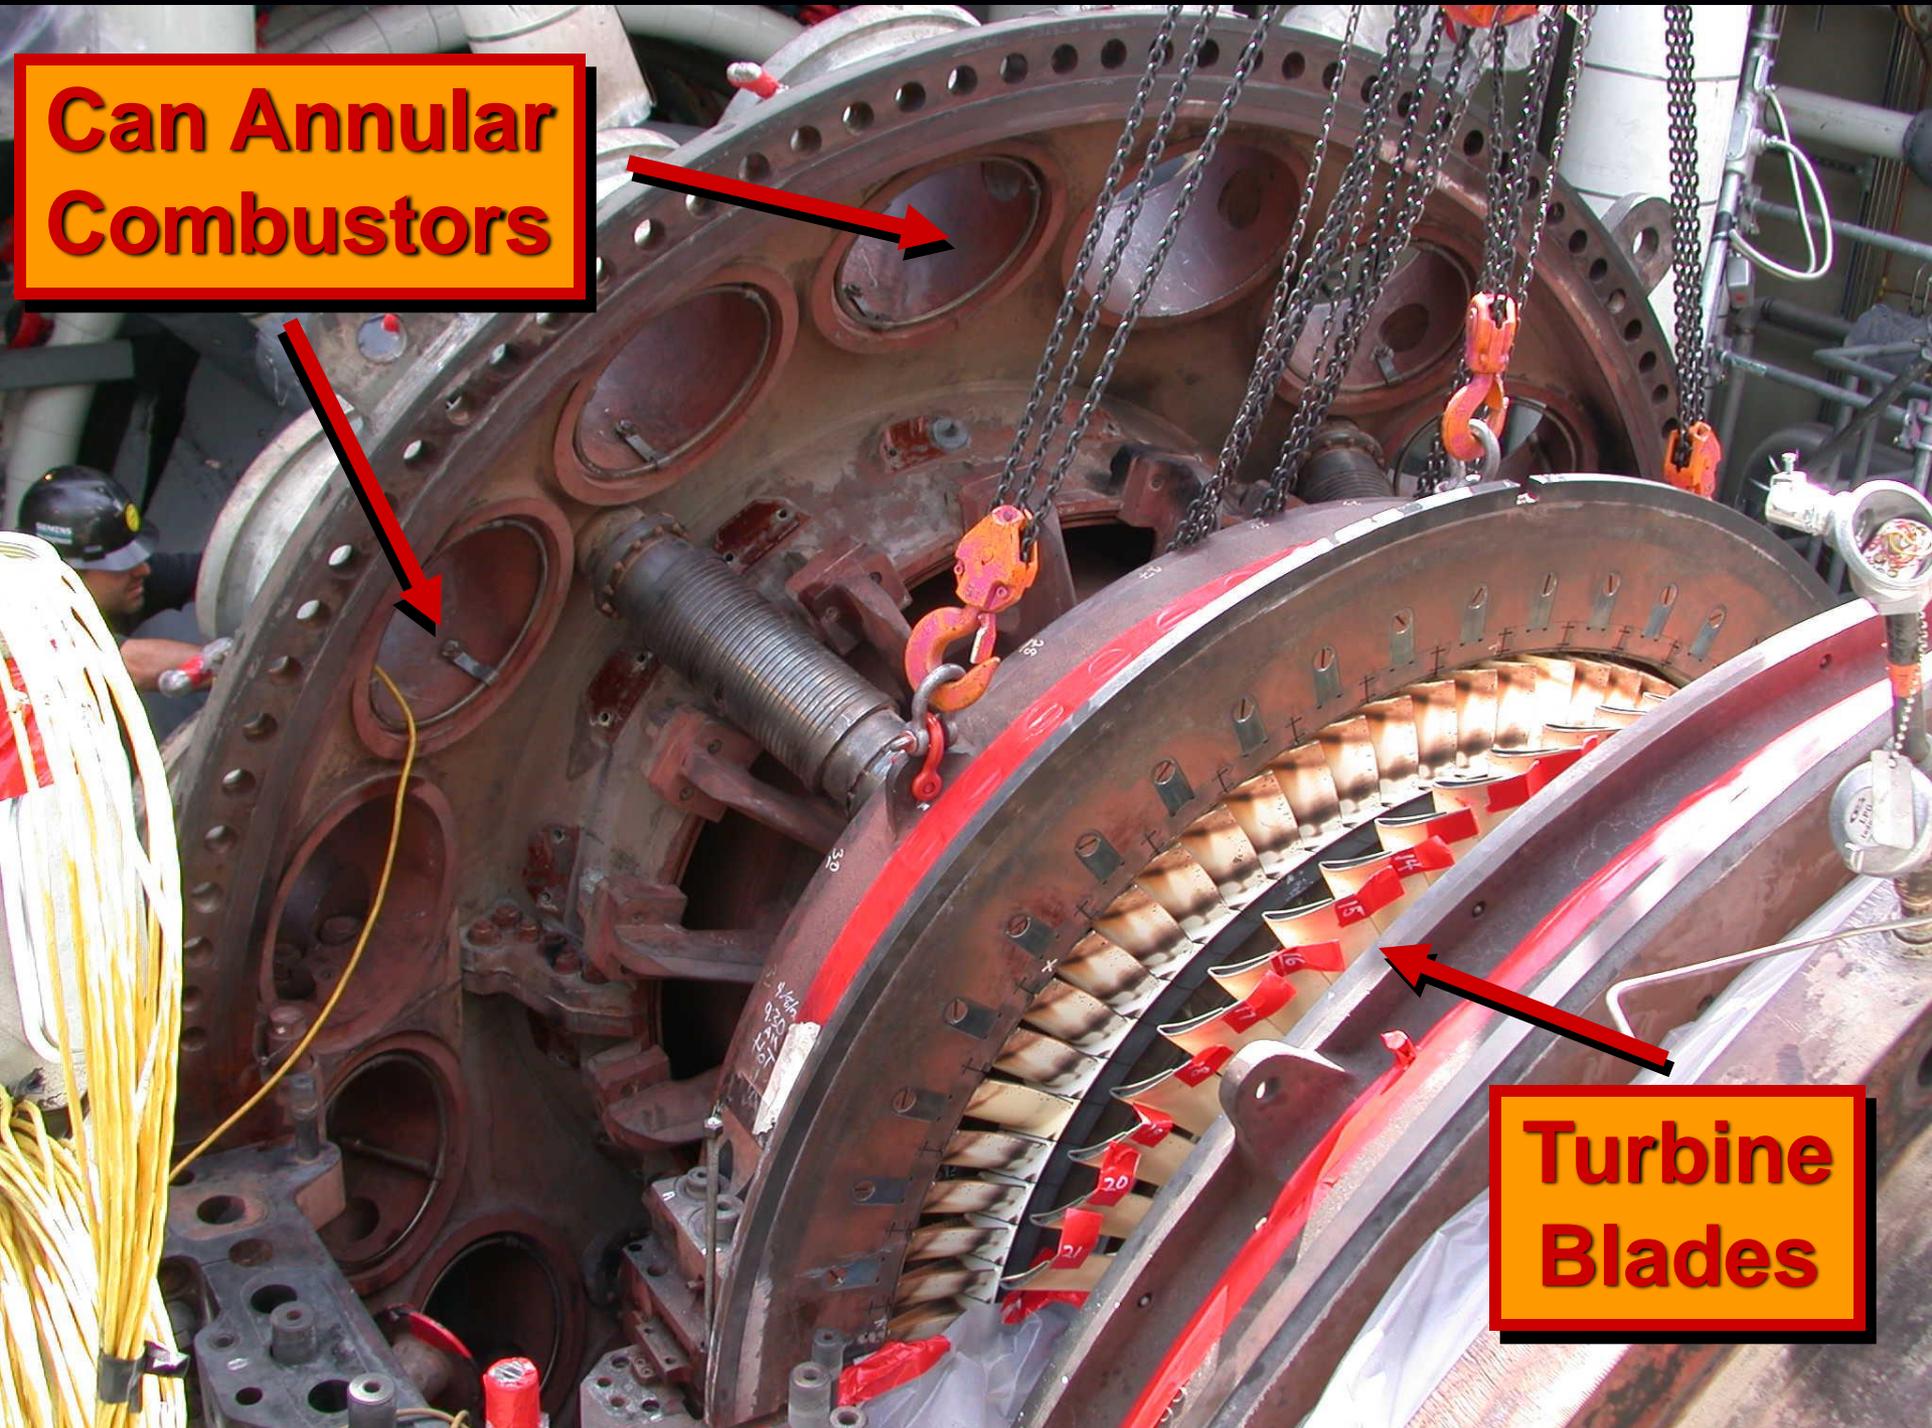


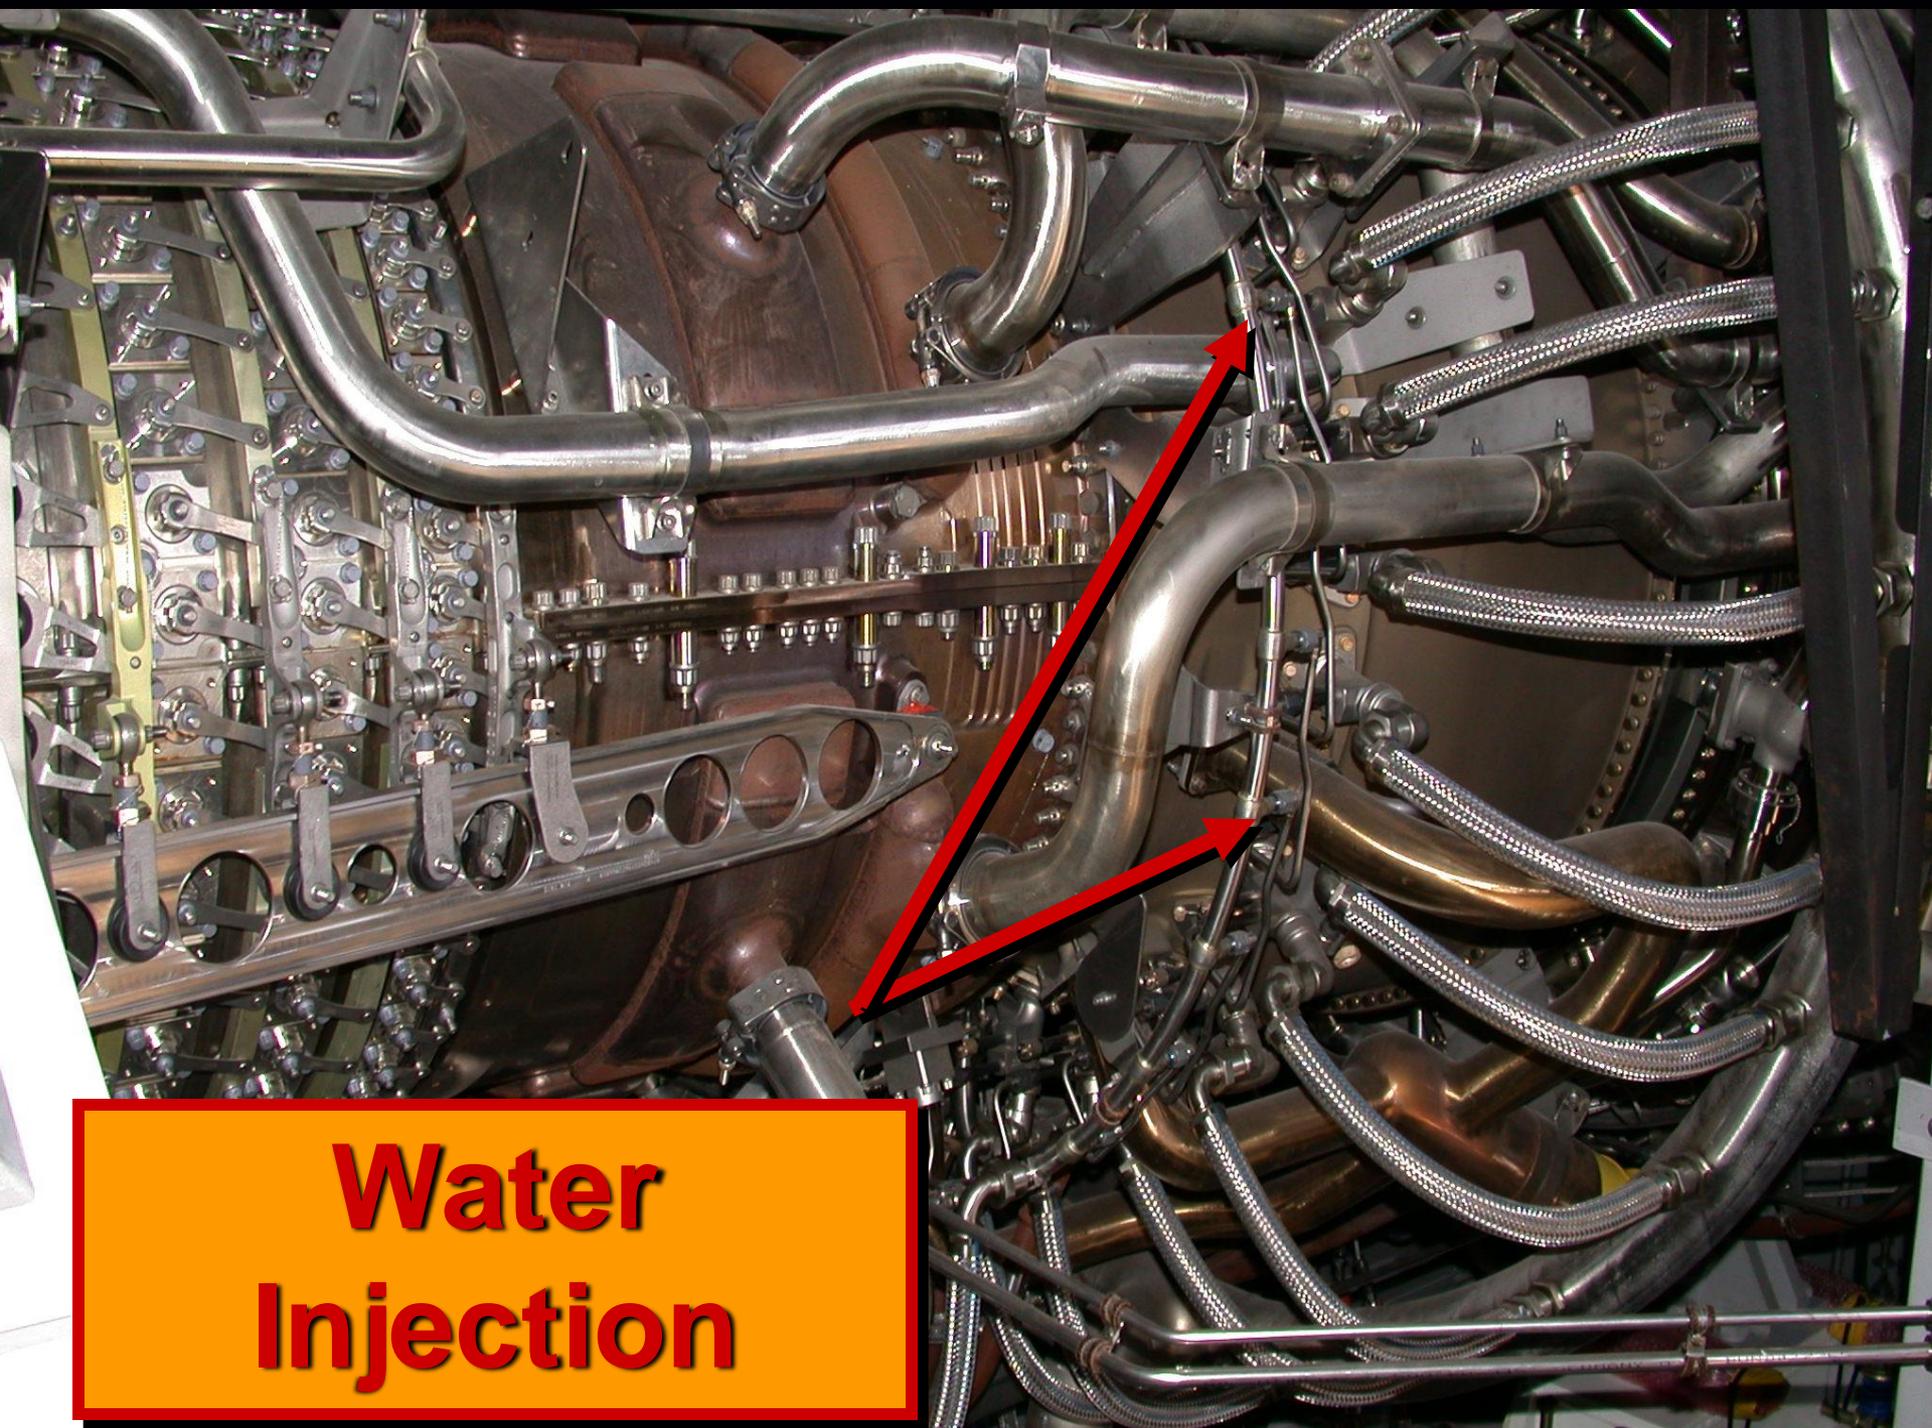


**Water
Injection**

**Gas
Nozzle**


**Water
Nozzle**

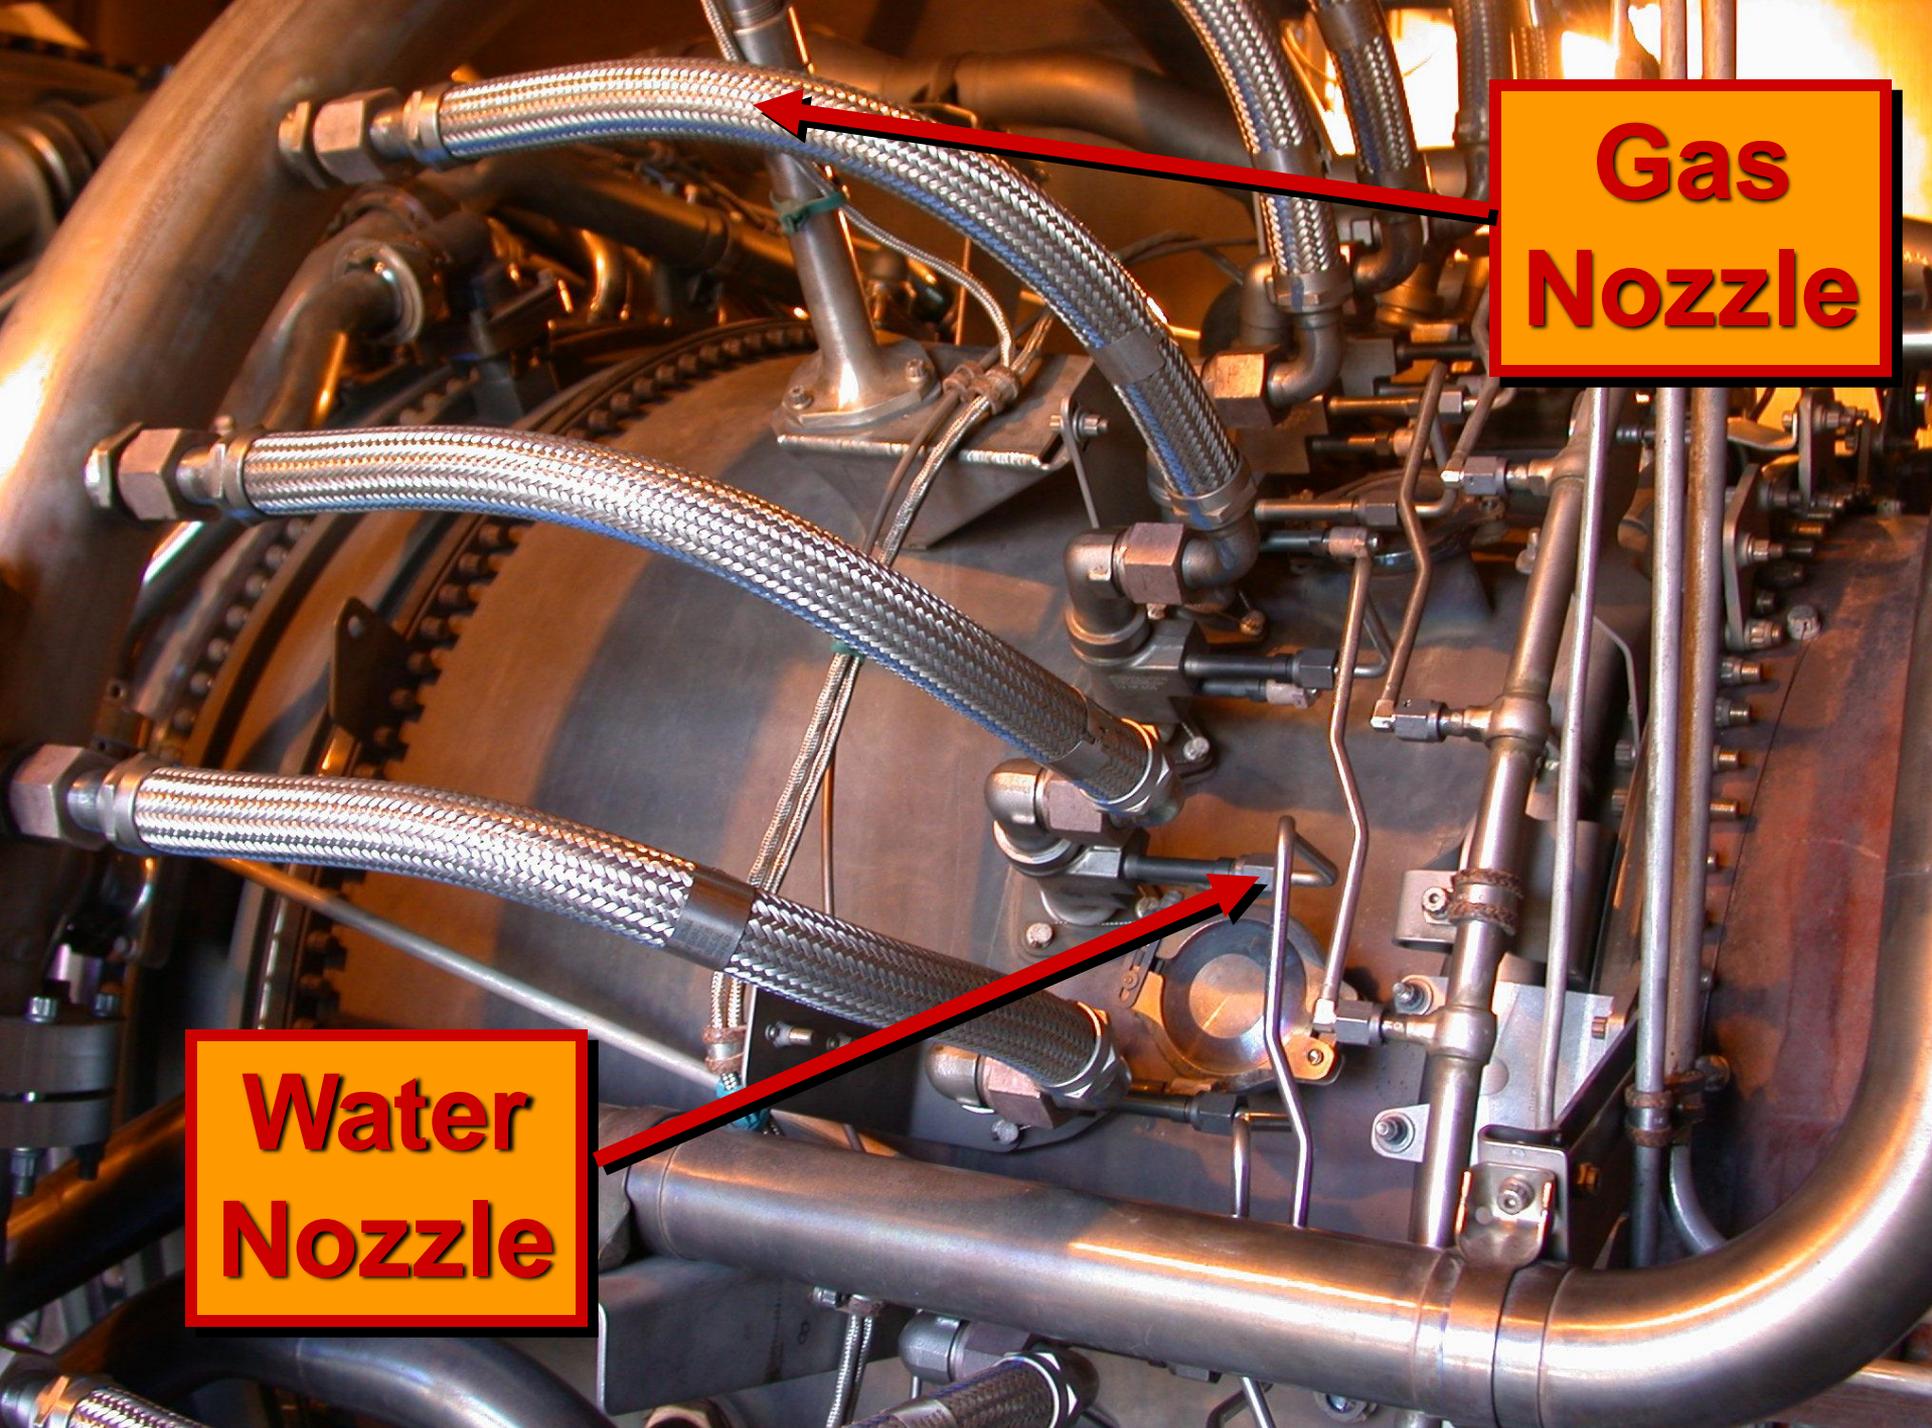

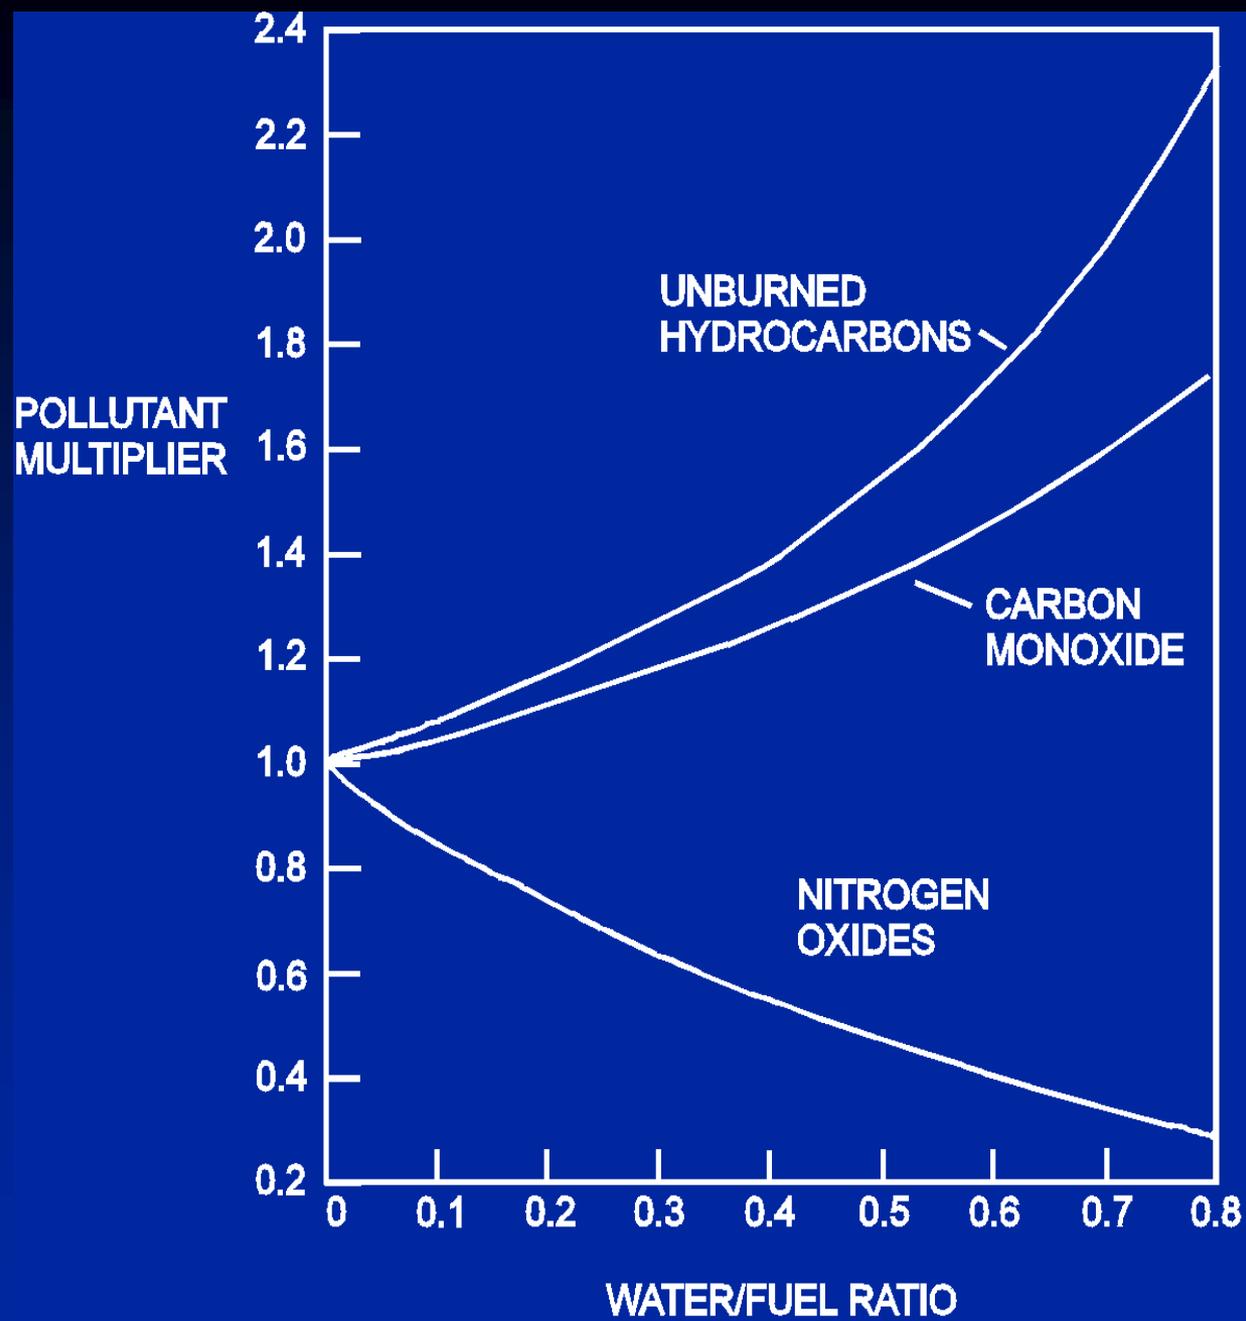

**NOx,
CO,
and
Unburned
HC
vs.
Water
Injection**

Effect of Water/Fuel Ratio on NOx, Thermal Efficiency, and Power Output


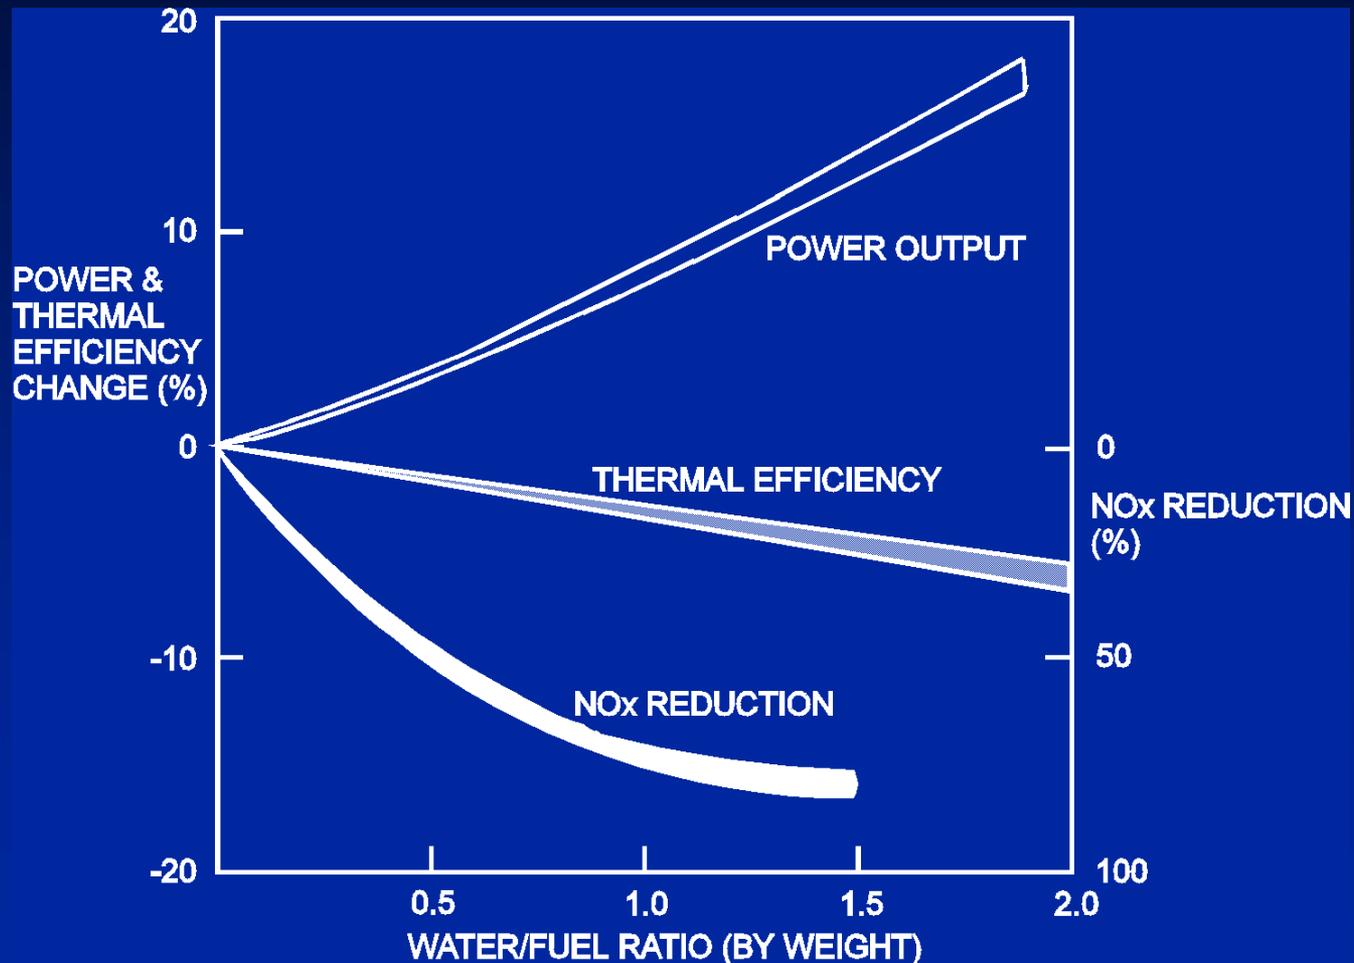




Let's Discuss SCR


SCR - Introduction

Overview of the SCR Process

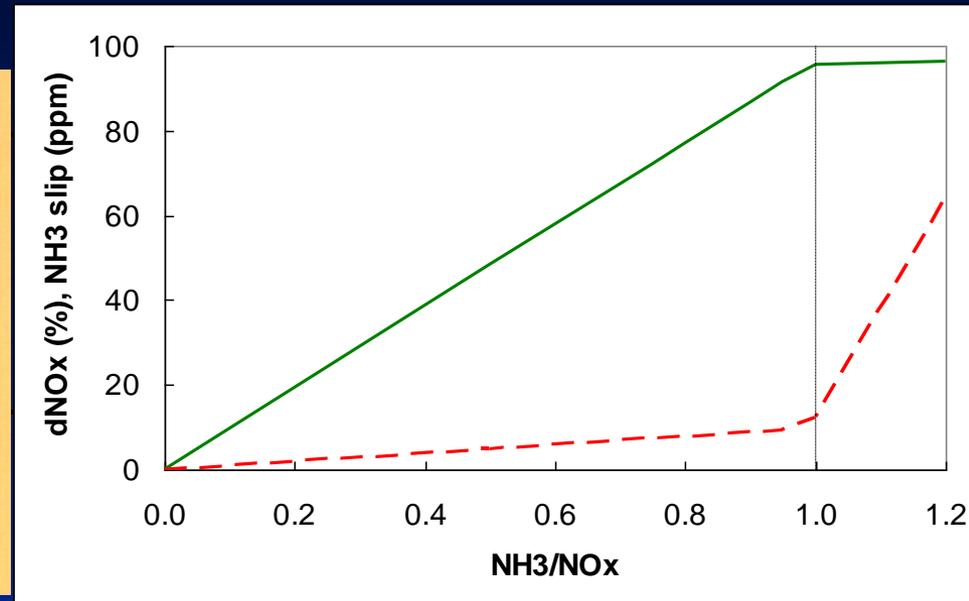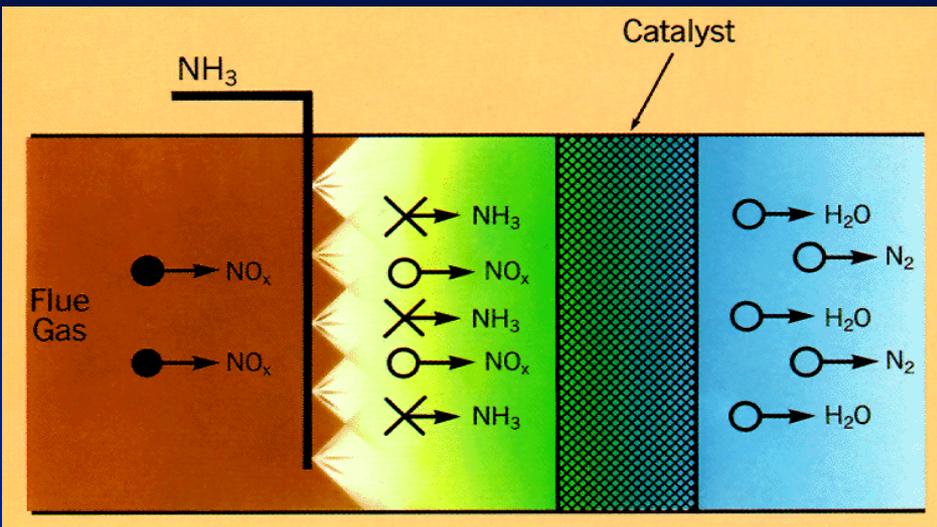

* The vast majority of NO_x is in the form of NO, so reaction (1) dominates

SCRT® Johnson Matthey

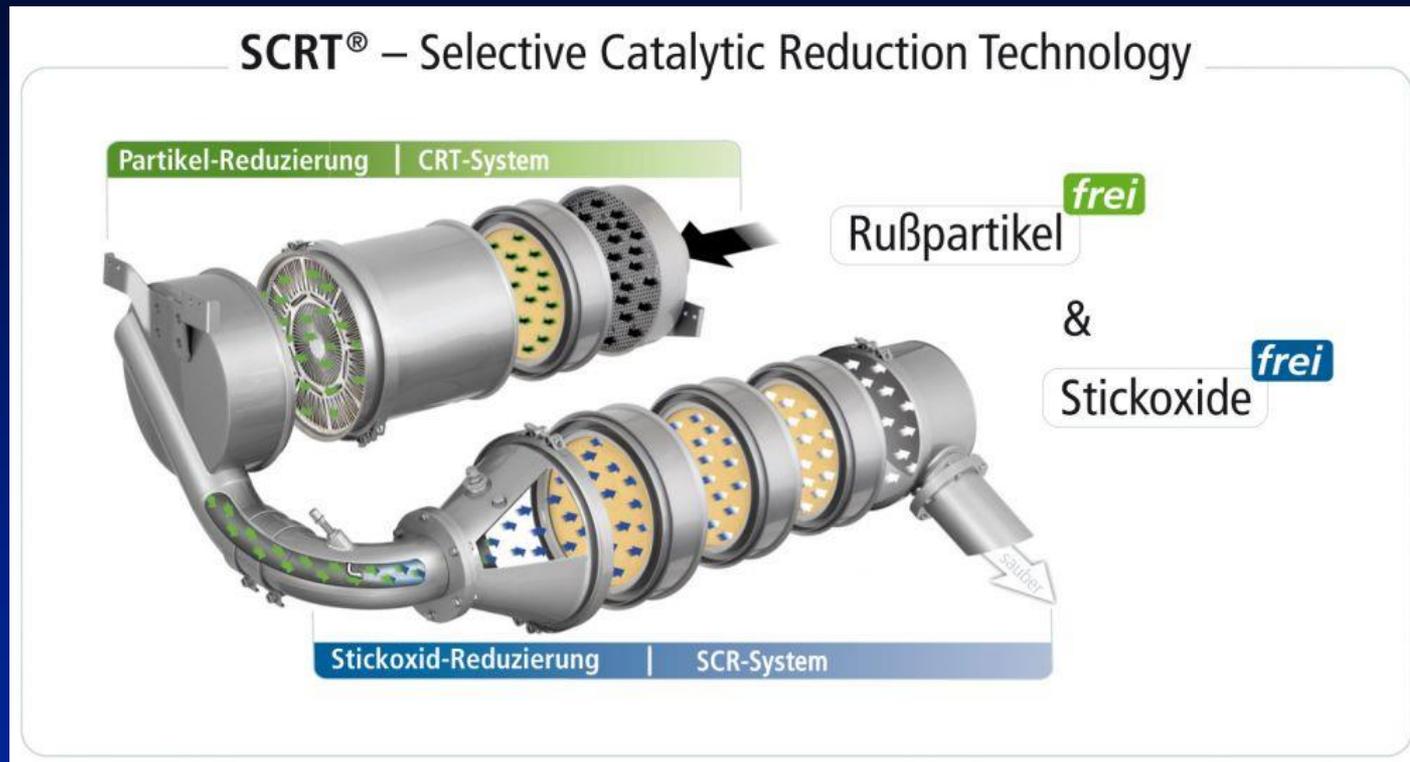

Selective Catalytic Reduction (SCR)

- **65-90% control**
- **Problems**
 - **Expensive**
 - **High maintenance**
 - **Ammonia “slip”**
 - **Catalyst replacement & disposal**

SCR – Where is it Used?

- **Widespread Use**
 - Coal and Gas Fired Utility Boilers
 - Gas Turbine Electric Generators (Simple and Combined Cycle)
- **More Recently**
 - Refinery Combustion Systems
 - Smaller Industrial Boilers (Gas, Biomass Fired)
 - Mobile Diesel Engines




Combined Cycle Power Plant w/SCR




**Small Boiler
with SCR**

NH₃ Manifold

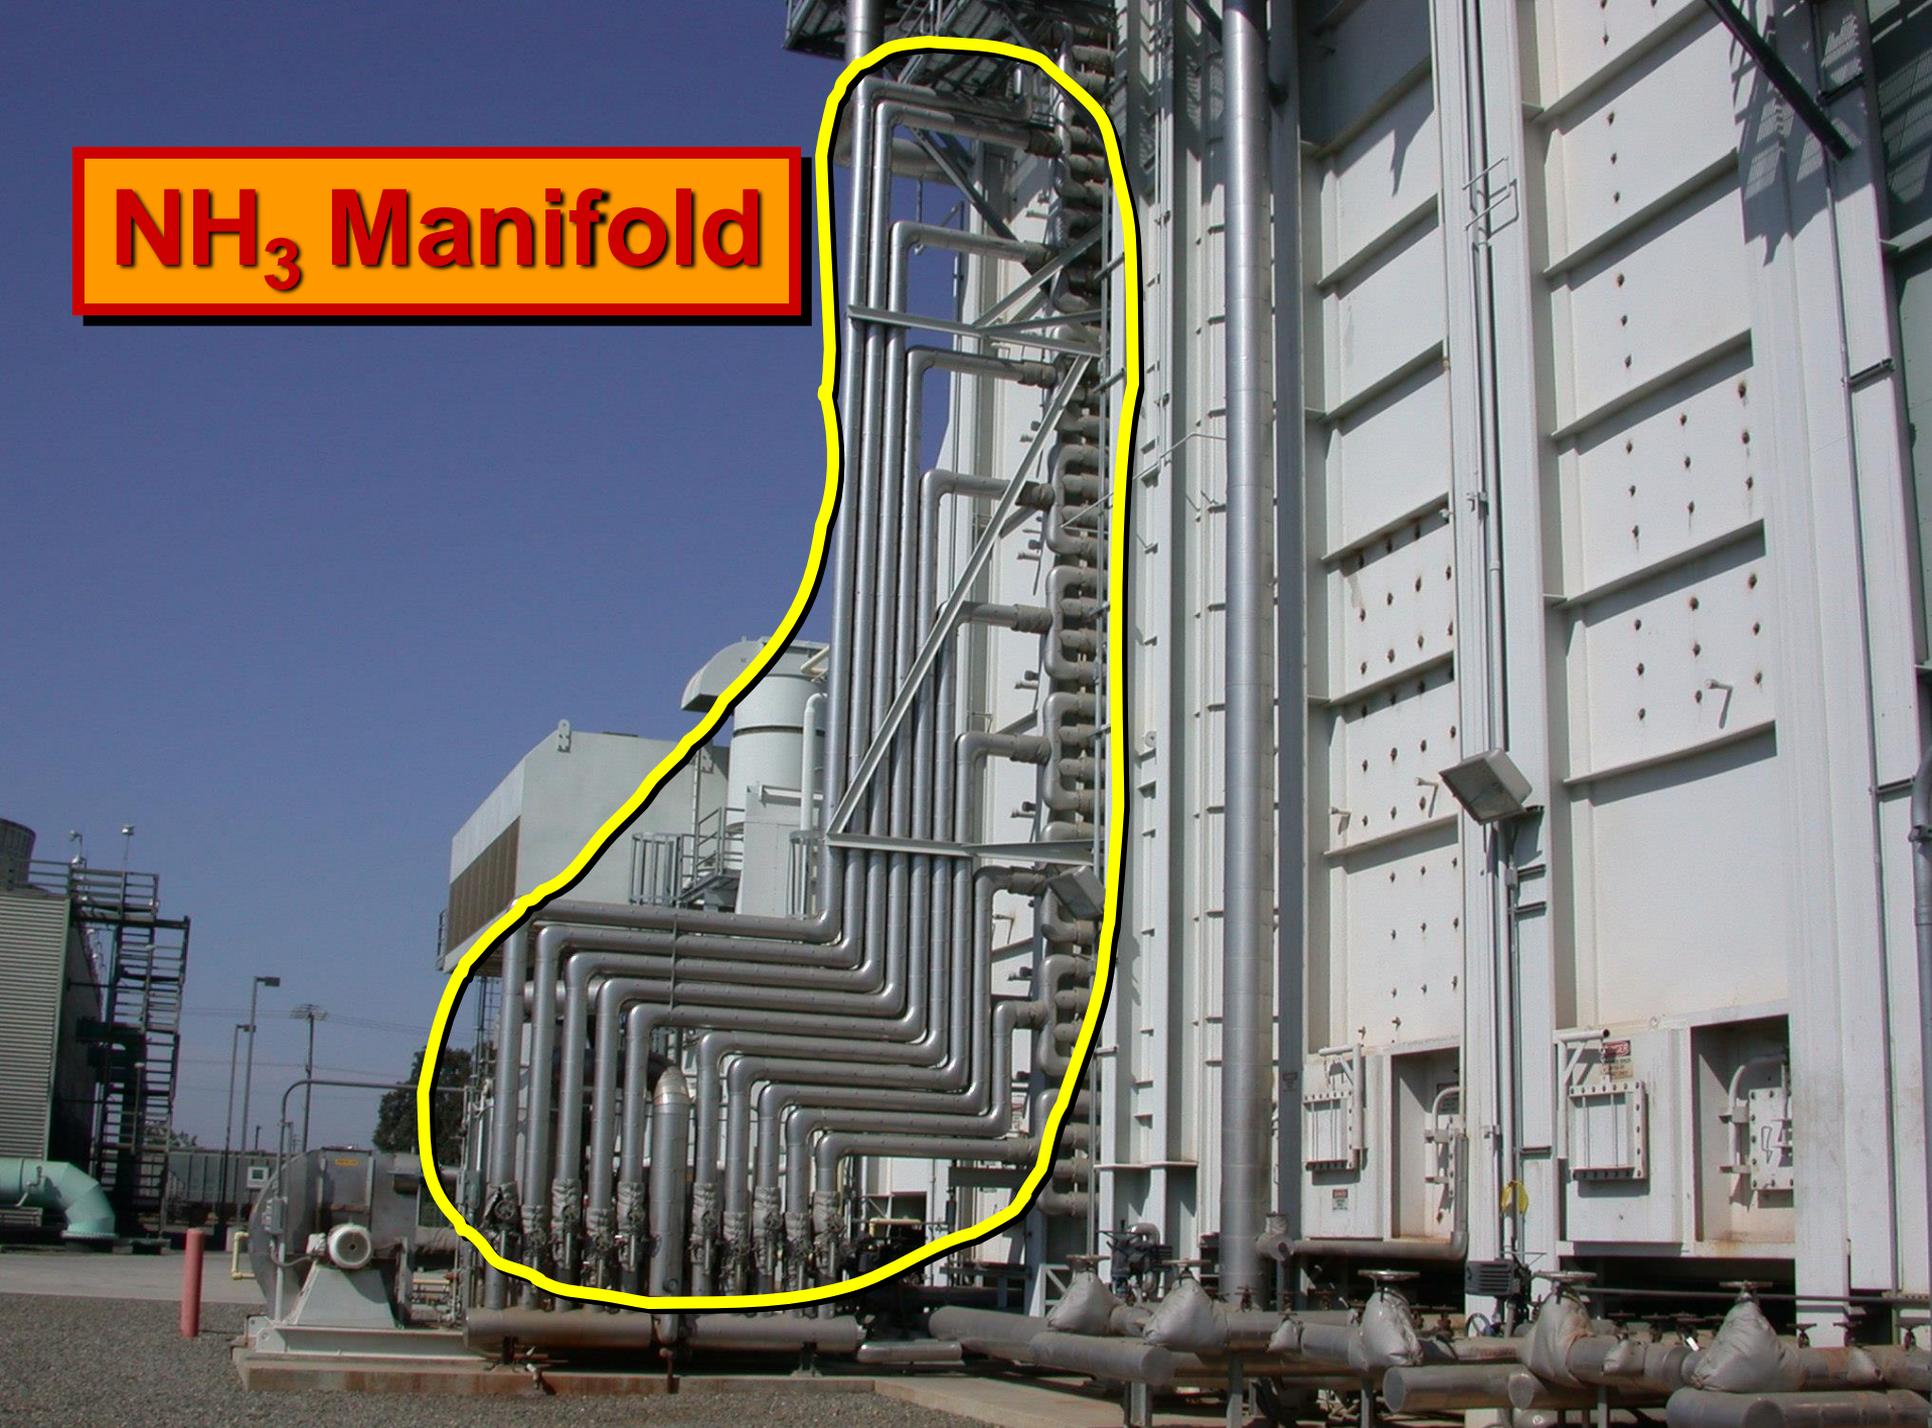

NH₃ Injection

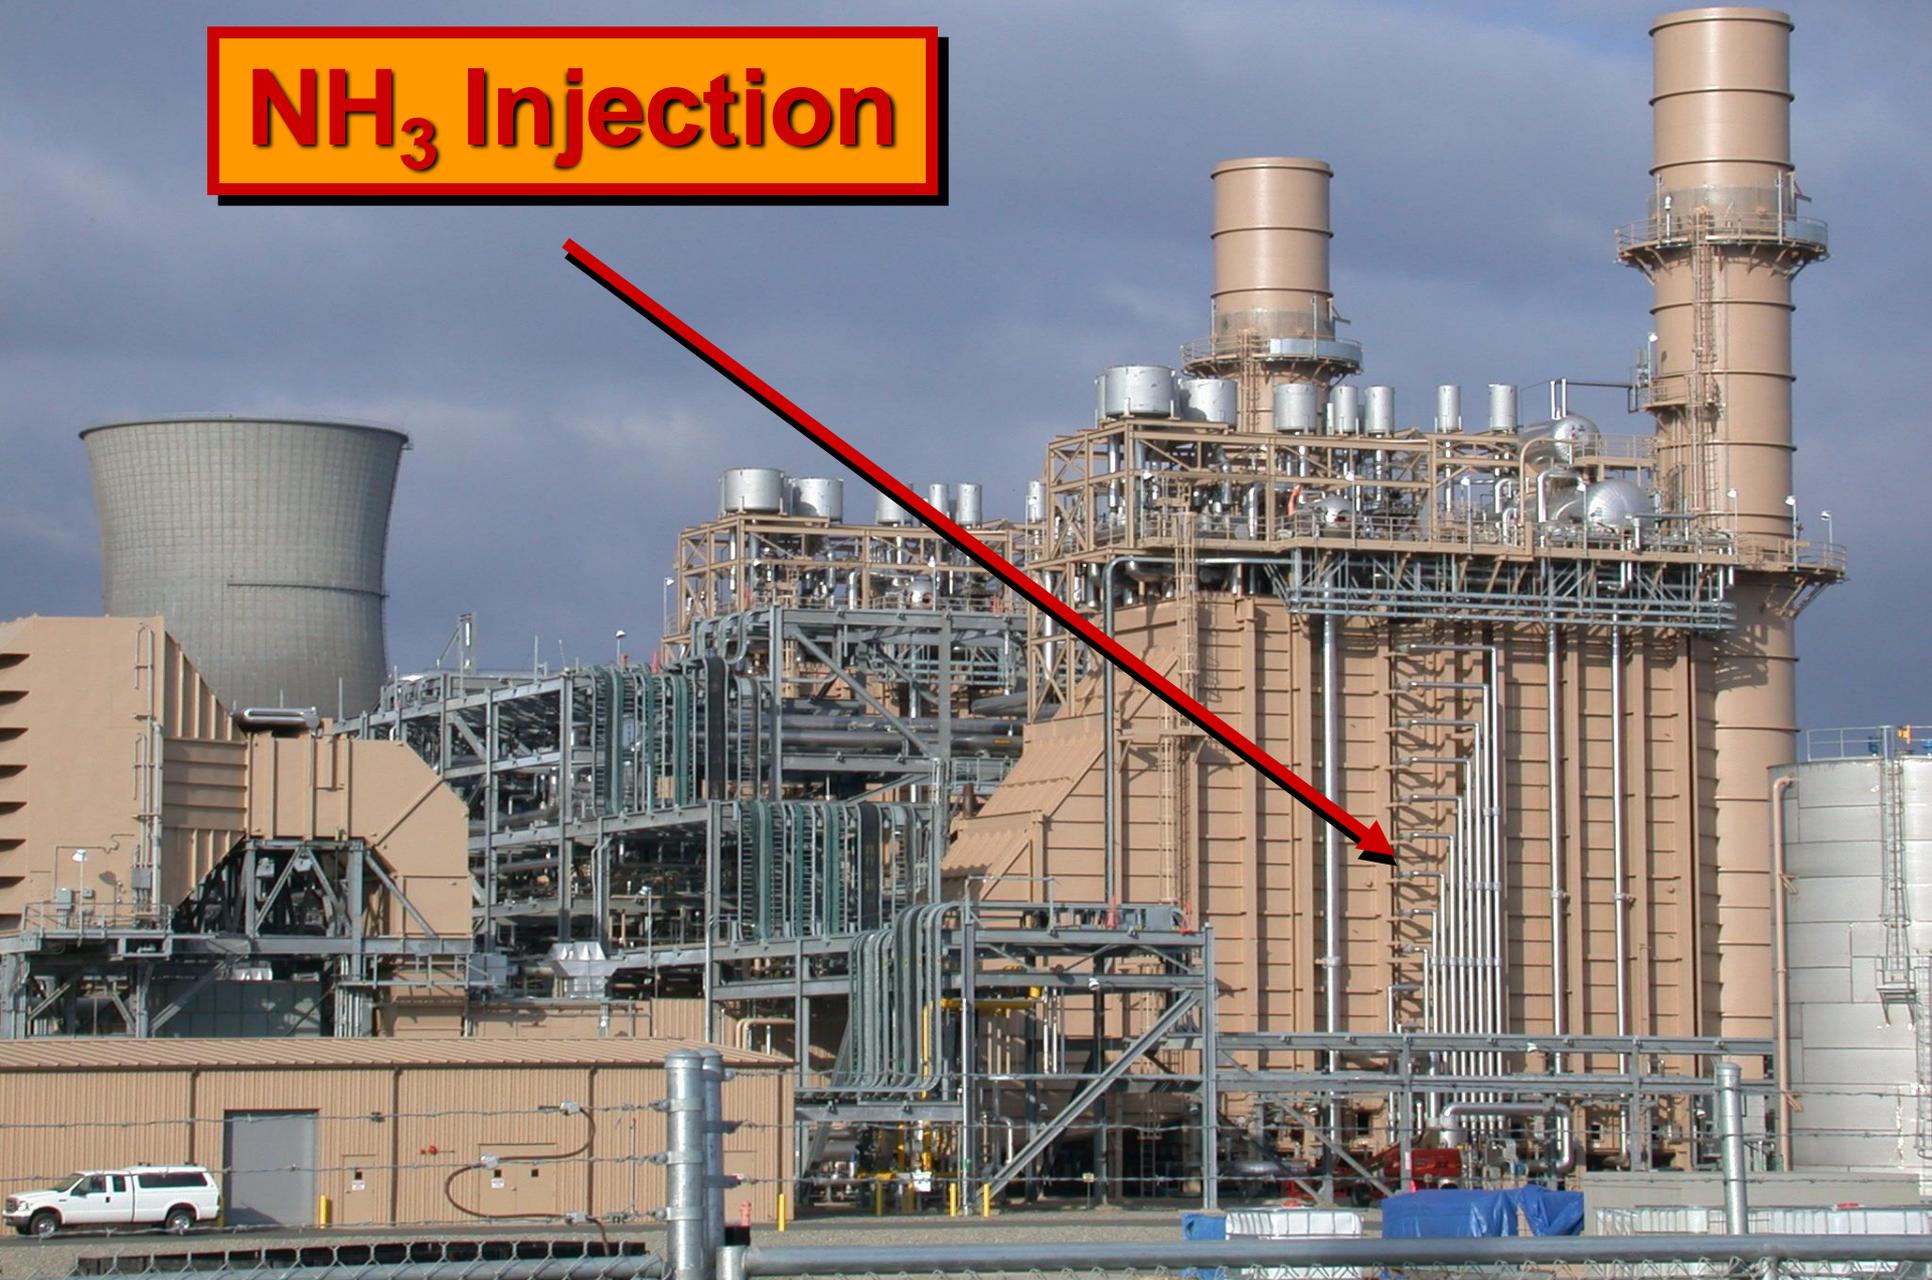



**SCR &
NH₃ Tubes**

**ANHYDROUS
AMMONIA**



AIR PRODUCTS
STOCKTON COGEN FACILITY
CHEMICAL AMMONIA TRUCK UNLOADING POLICIES

1. YOU MUST WEAR A HARD HAT AND SAFETY GLASSES WHILE OUTSIDE OF YOUR TRUCK.
2. CHECK YOUR TRAILER WHEELS BEFORE UNLOADING.
3. STAY WITH YOUR TRUCK WHILE UNLOADING.
4. IF THE ALARM BELL SOUNDS, SECURE YOUR TRUCK AND WAIT FOR INSTRUCTIONS FROM AN AIR PRODUCTS EMPLOYEE.
5. NO SMOKING ON THE PLANT SITE ESPECIALLY IN DESIGNATED AREAS.
6. REMEMBER THE SPEED LIMIT ON THE PLANT SITE IS 5 MPH.
7. PLEASE RECYCLE UP.

! DANGER
NO SMOKING,
MATCHES OR
OPEN FLAMES


! WARNING
CORROSIVE LIQUID
THAT CAN CAUSE
SEVERE BURNS,
IRRITATION AND
SOME DAMAGE

**ANHYDROUS
AMMONIA**

MSDS SHEET
SAFETY DATA SHEET

Ammonia Storage Tank



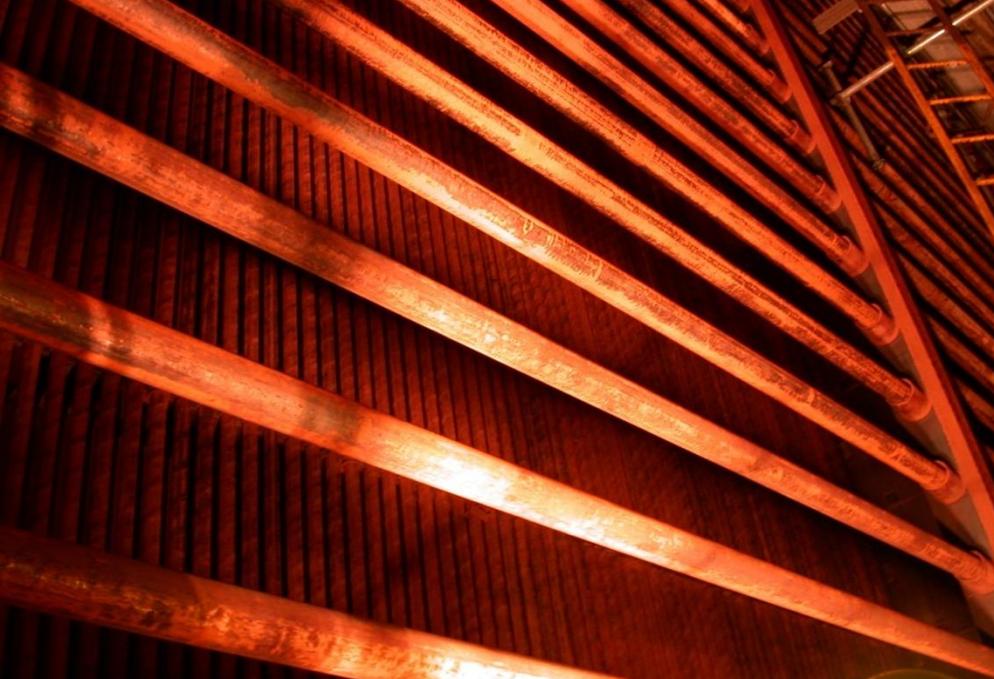



**SCR Catalyst &
NH₃ Tubes**

SCR Catalyst







Utility Boiler with SCR

SCR Catalyst


NH₃ Injection:
(Uniform NH₃/NO_x Critical)

Turning Vanes to give
uniform Velocity across the
Catalyst



Catalyst
Layer(s)

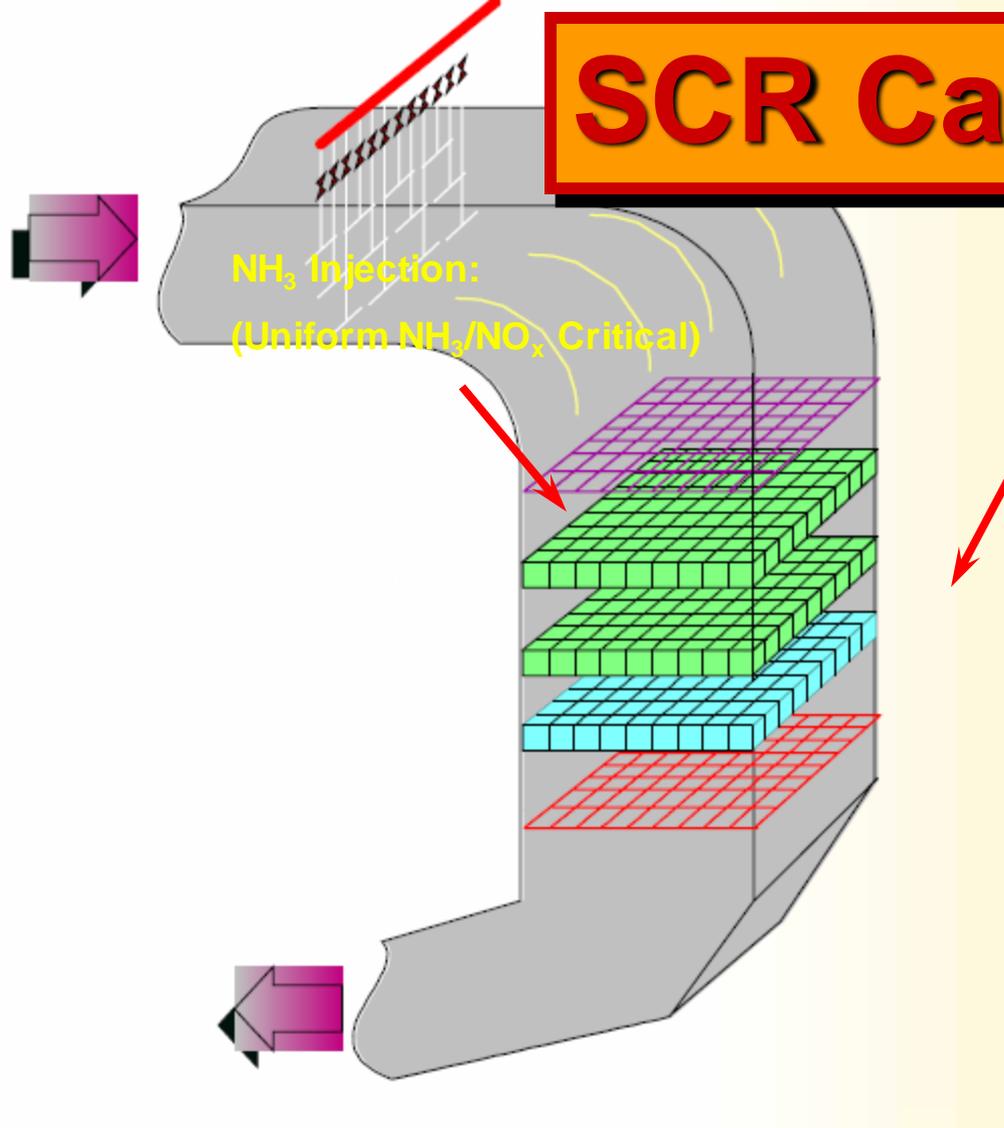

SCR Catalyst Types

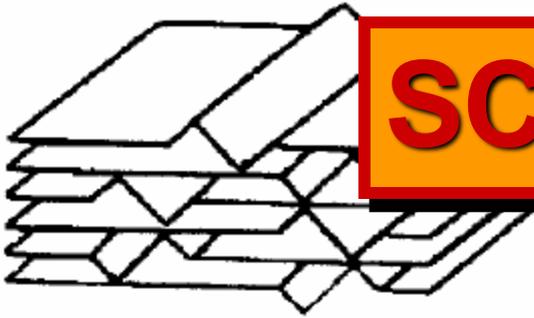

Corrugated
(Haldor-Topsoe)

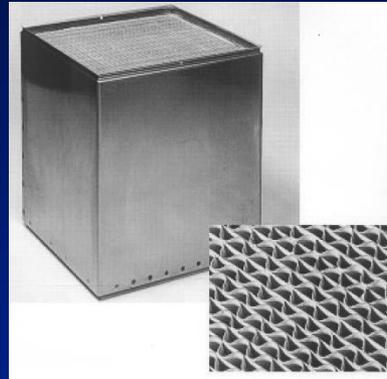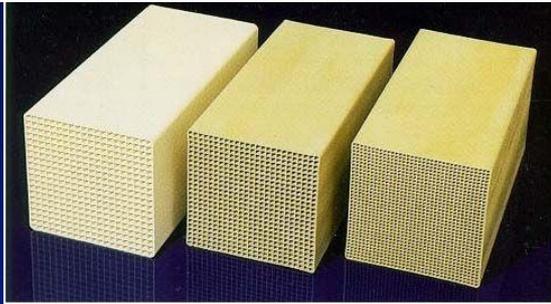

Plate



Composition

- Vanadium Pentoxide (V_2O_5)
- Titanium Dioxide (TiO_2)
- Molybdenum
- Tungsten

Utility Boiler: ID Fans for SCR




Catalyst Degradate with Time

Reason for Degradation Fuel Dependent

- Bituminous Coal-Arsenic Poisoning
- Other Coal- Calcium sulfate blinding
- Potassium & Chlorine Poisoning




Typical Catalyst Deactivation Rates

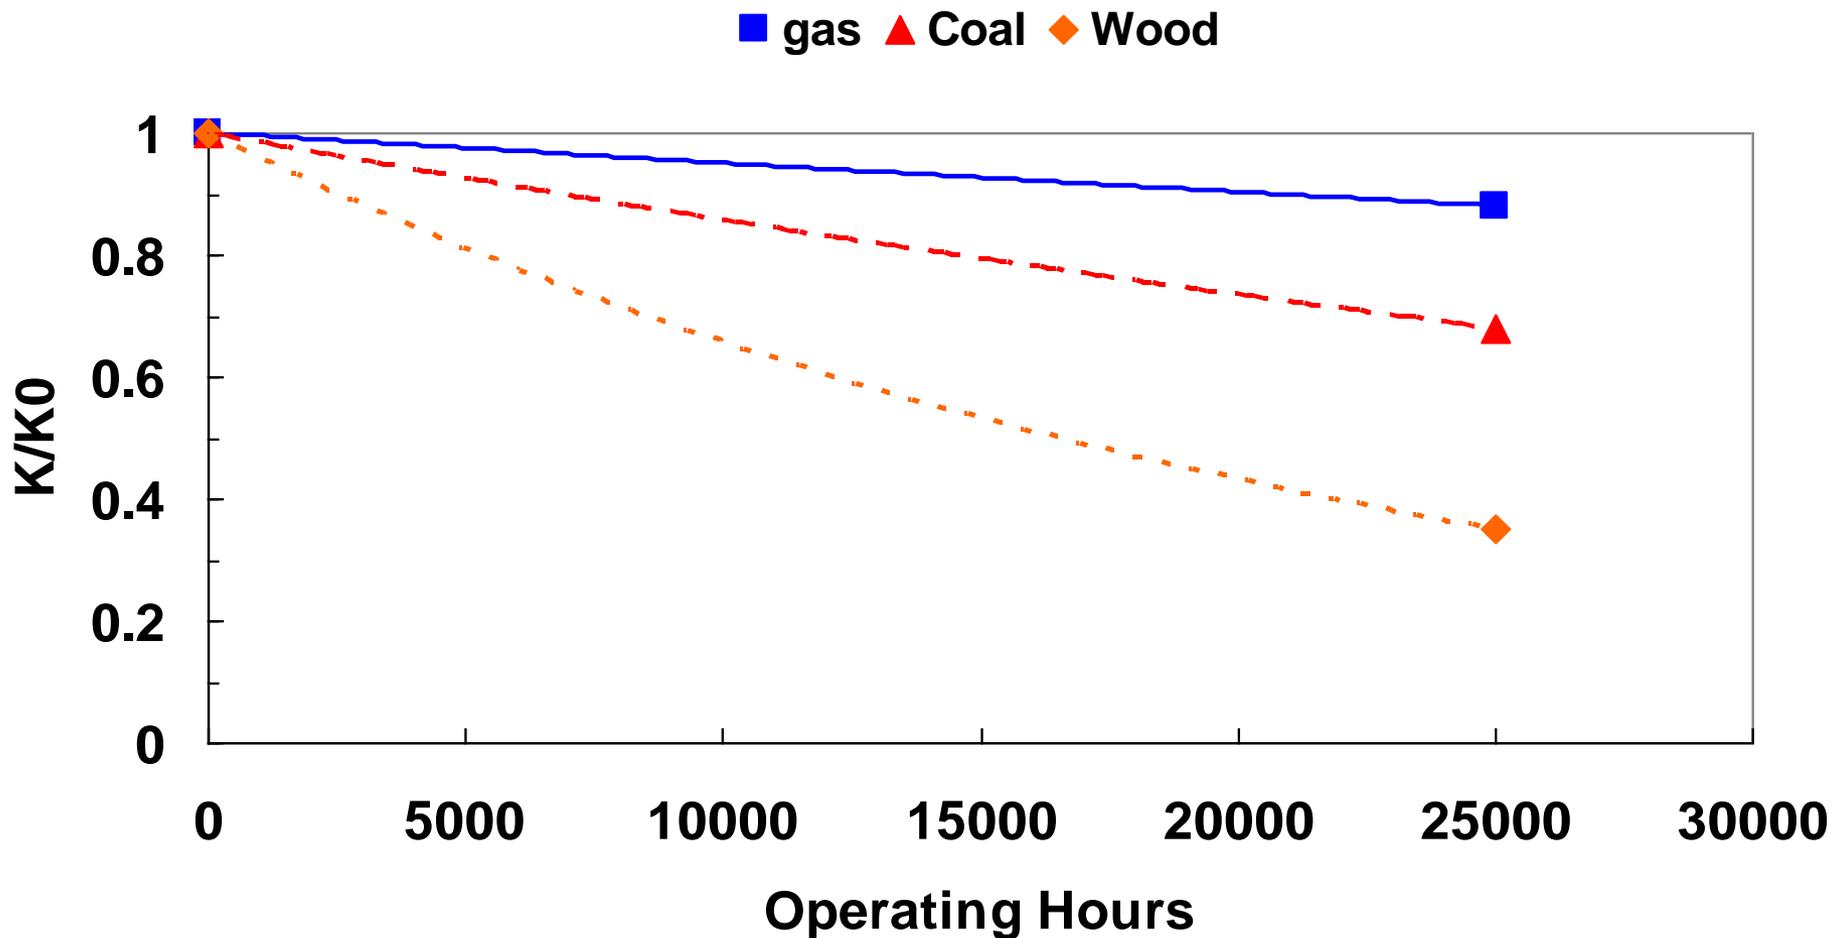

NO_x Control Techniques – Selective Catalytic Reduction

- **Factors affecting efficiency**
 - **Catalyst activity**
 - **Masking or poisoning**
 - **Space velocity (gas flow rate divided by bed volume)**
 - **Excess ammonia or urea slip**

Typical SCR Catalysts Operating Windows

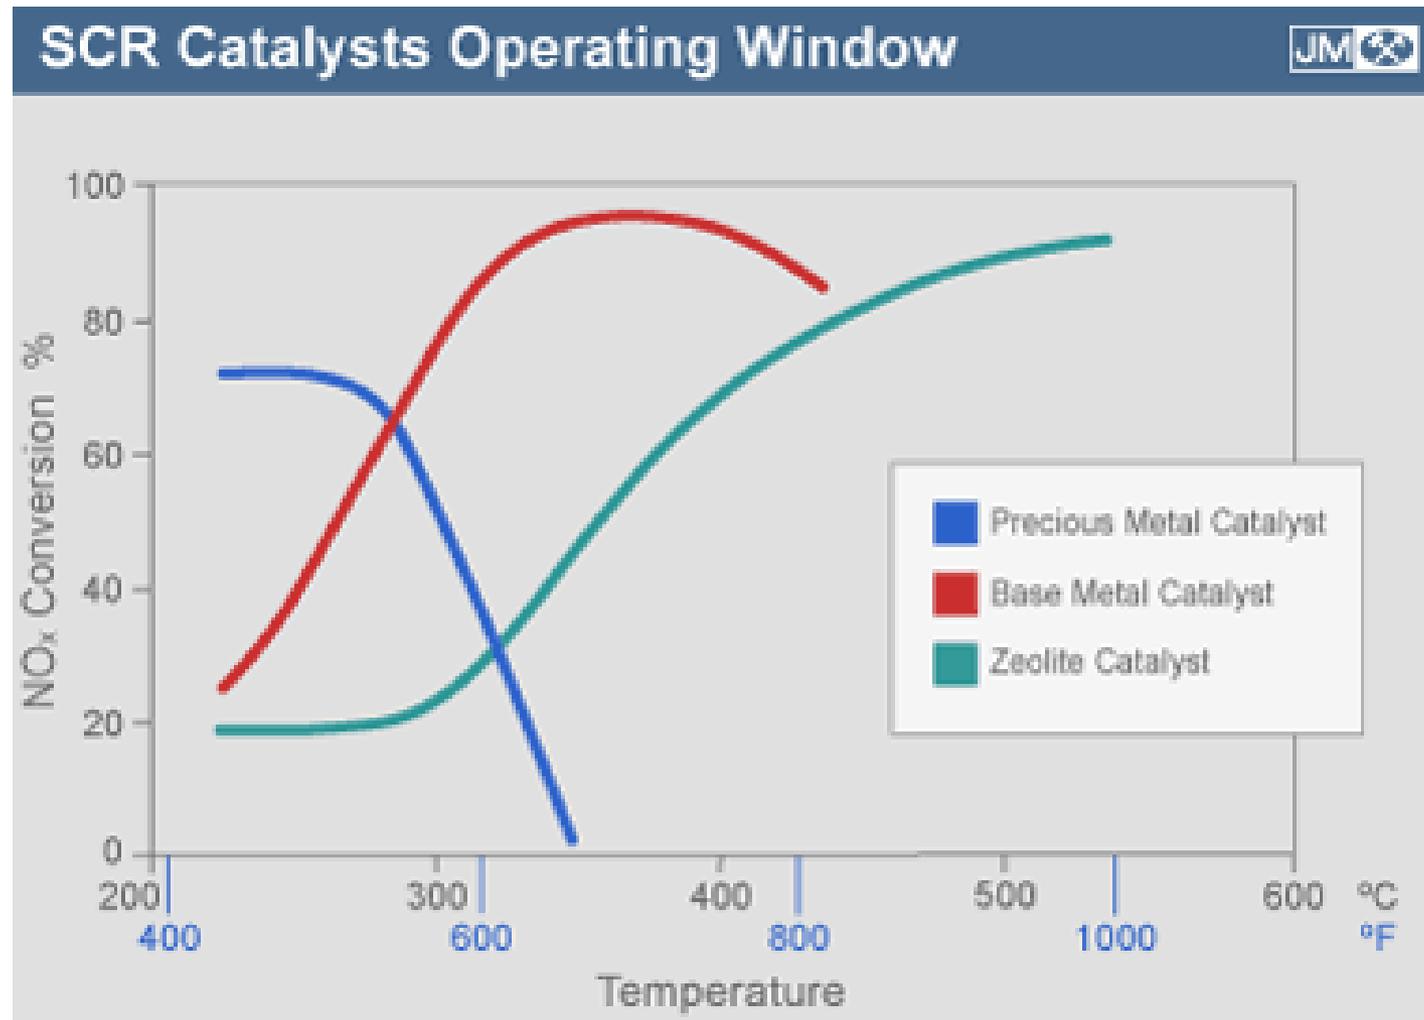


NOx Control Techniques – Selective Catalytic Reduction

- Performance indicators
 - Inlet and Outlet NOx concentration
 - Ammonia / urea injection rate
 - Catalyst bed inlet temperature
 - Catalyst activity (coupon)
 - Outlet ammonia concentration
 - Inlet gas flow rate
 - Fuel sulfur content
 - Pressure differential across catalyst bed




Let's Discuss SNCR

Boiler with SNCR

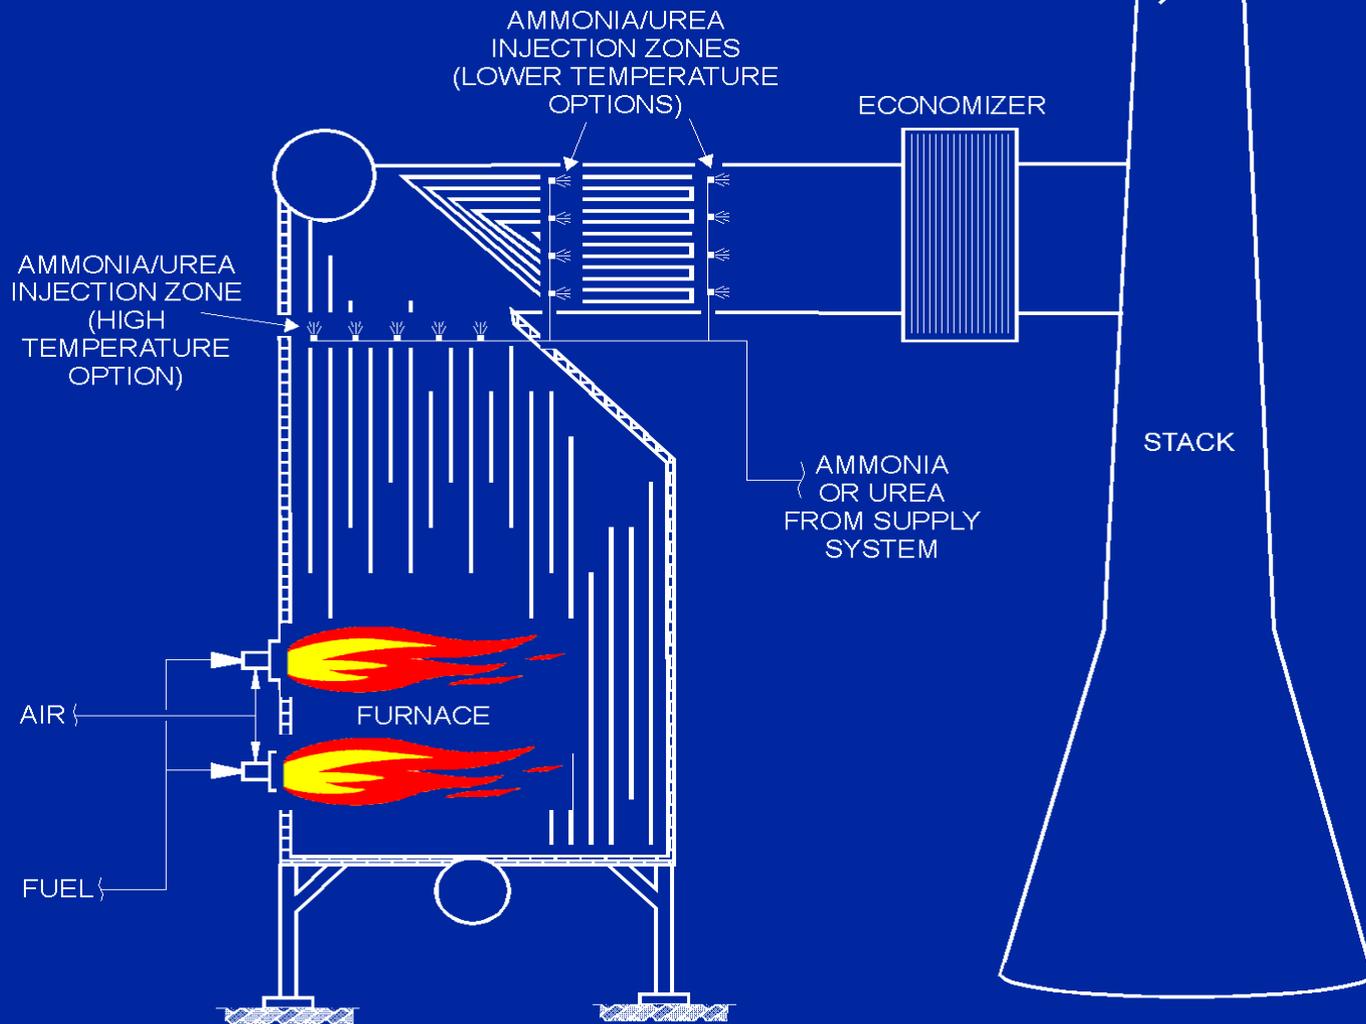

SNCR Process

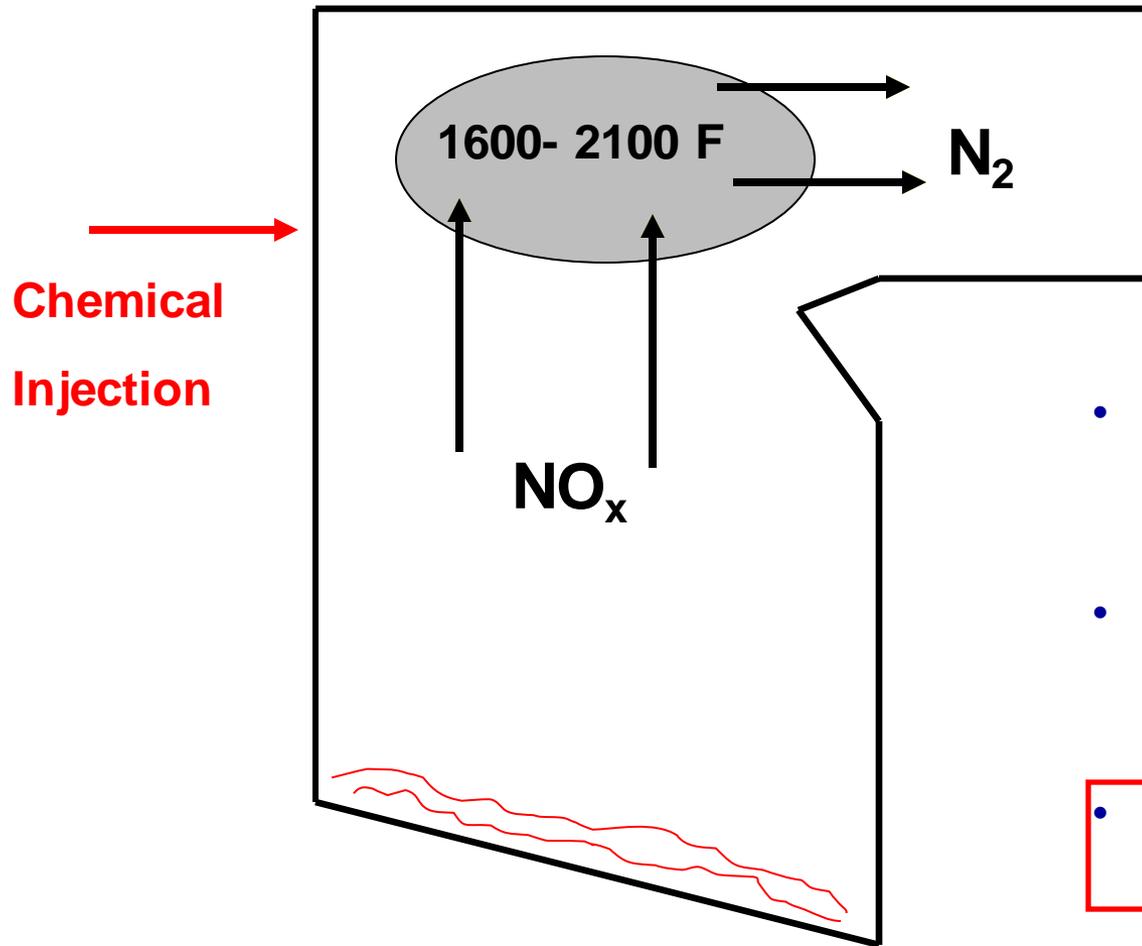

- Gas Phase Reaction Between the Injected Chemical and NO_x
- Reactions Occur in the Temperature Region of 1600-2100 F
- **Furnace is the Chemical Reactor**

Selective Non-Catalytic Reduction

- NO_x control through ammonia injection
- No catalyst necessary
- Temperature range 1600 °F – 2100 °F
- Injected upstream of convection section
- 20% - 50% control under normal conditions
- Problems:
 - Changing flue temperatures with changing load
 - Formation of ammonium salts
 - Ammonia slip



Selective Non-Catalytic Reduction

Ammonia

NH₃

NH₃ + OH

NH₂ + H₂O

NH₂ + NO

N₂ + H₂O

N₂

Urea

NH₂CONH₂

NH₃ + HNCO

HNCO + OH

N₂O + H

N₂O + OH

N₂O + M

NCO + H₂O

NCO + NO


N₂ + OH

N₂ + HO₂

N₂ +

N₂O + CO

N₂O

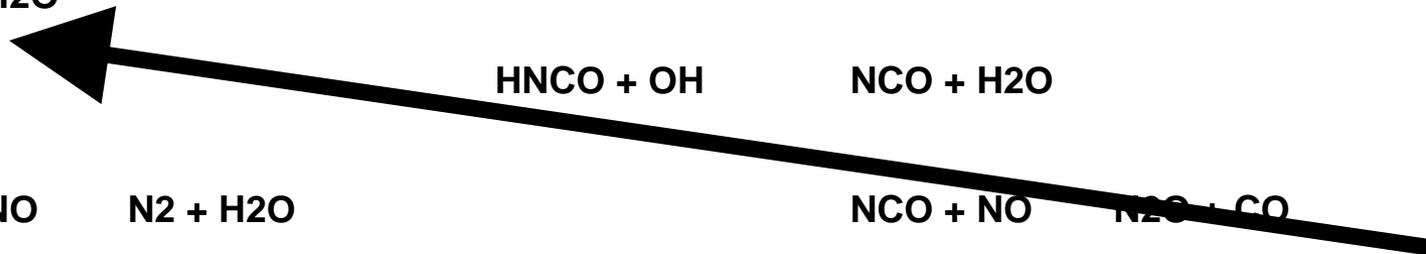

C2H2+C2H2=C4H3+H 0.200E+13 0.000 47780.000
 C4H3+M=C4H2+H+M 0.100E+17 0.000 59700.000
 CH2(S)+C2H
 C4H2+O=C3
 C2H2+O2=H
 C2H2+M=C2
 C2H4+M=C2
 C2H4+M=C2

Detailed SNCR Mechanism

H2+O2=2OH 0.170E+14 0.000 47780.000
 OH+H2=H2O+H 0.117E+10 1.300 3626.000
 O+OH=O2+H 0.400E+15 -0.500 0.000
 O+H2=OH+H 0.506E+05 2.670 6290.000
 H+O2+M=HO2+M 0.361E+18 -0.720 0.000
 H2O/18.6/ CO2/4.2/ H2/2.86/ CO/2.11/ N2/1.26/
 OH+HO2=H2O+O2 0.750E+13 0.000 0.000
 H+HO2=2OH 0.140E+15 0.000 1073.000
 O+HO2=O2+OH 0.140E+14 0.000 1073.000
 2OH=O+H2O 0.600E+09 1.300 0.000
 H+H+M=H2+M 0.100E+19 -1.000 0.000
 H2/0.0/ H2O/0.0/ CO2/0.0/
 H+H+H2=H2+H2 0.920E+17 -0.600 0.000
 H+H+H2O=H2+H2O 0.600E+20 -1.250 0.000
 H+H+CO2=H2+CO2 0.549E+21 -2.000 0.000
 H+OH+M=H2O+M 0.160E+23 -2.000 0.000
 H2O/5/
 H+O+M=OH+M 0.620E+17 -0.600 0.000
 H2O/5/
 O+O+M=O2+M 0.189E+14 0.000 -1788.000
 H+HO2=H2+O2 0.125E+14 0.000 0.000
 HO2+HO2=H2O2+O2 0.200E+13 0.000 0.000
 H2O2+M=OH+OH+M 0.130E+18 0.000 45500.000
 H2O2+H=HO2+H2 0.160E+13 0.000 3800.000
 H2O2+OH=H2O+HO2 0.100E+14 0.000 1800.000
 CH+N2=HCN+N 0.200E+12 0.000 13600.000
 CN+N=C+N2 0.104E+16 -0.500 0.000
 CH2+N2=HCN+NH 0.100E+14 0.000 74000.000
 H2CN+N=N2+CH2 0.200E+14 0.000 0.000
 H2CN+M=HCN+H+M 0.300E+15 0.000 22000.000
 C+NO=CN+O 0.660E+14 0.000 0.000
 CH+NO=HCN+O 0.110E+15 0.000 0.000
 CH2+NO=HCNO+H 0.139E+13 0.000 -1100.000
 CH3+NO=HCN+H2O 0.100E+12 0.000 15000.000
 CH3+NO=H2CN+OH 0.100E+12 0.000 15000.000
 HCCO+NO=HCNO+CO 0.200E+14 0.000 0.000
 CH2(S)+NO=HCN+OH 0.200E+14 0.000 0.000
 HCNO+H=HCN+OH 0.100E+15 0.000 12000.000
 CH2+N=HCN+H 0.500E+14 0.000 0.000
 CH+N=CN+H 0.130E+14 0.000 0.000
 CO2+N=NO+CO 0.190E+12 0.000 3400.000
 HCCO+N=HCN+CO 0.500E+14 0.000 0.000
 CH3+N=H2CN+H 0.300E+14 0.000 0.000
 C2H3+N=HCN+CH2 0.200E+14 0.000 0.000
 C3H3+N=HCN+C2H2 0.100E+14 0.000 0.000


CN+N2O=NCO+N2 0.100E+14 0.000 0.000
 C2N2+O=NCO+CN 0.457E+13 0.000 8880.000
 C2N2+OH=HOCN+CN 0.186E+12 0.000 2900.000
 HO2+NO=N2O+OH 0.211E+13 0.000 -479.000
 NO2+H=NO+OH 0.350E+15 0.000 1500.000
 NO2+O=NO+O2 0.100E+14 0.000 600.000
 NO2+M=NO+O+M 0.110E+17 0.000 66000.000
 NCO+H=NH+CO 0.500E+14 0.000 0.000
 NCO+O=NO+CO 0.200E+14 0.000 0.000
 NCO+N=N2+CO 0.200E+14 0.000 0.000
 NCO+OH=NO+CO+H 0.100E+14 0.000 0.000
 NCO+M=N+CO+M 0.310E+17 -0.500 48000.000
 NCO+NO=N2O+CO 0.100E+14 0.000 -390.000
 NCO+H2=HNCO+H 0.858E+13 0.000 9000.000
 HNCO+H=NH2+CO 0.200E+14 0.000 3000.000
 NH+O2=HNO+O 0.100E+14 0.000 12000.000
 NH+O2=NO+OH 0.760E+11 0.000 1530.000
 NH+NO=N2O+H 0.240E+16 -0.800 0.000
 N2O+OH=N2+HO2 0.200E+13 0.000 10000.000
 N2O+H=N2+OH 0.760E+14 0.000 15200.000
 N2O+M=N2+O+M 0.160E+15 0.000 51600.000
 N2O+O=N2+O2 0.100E+15 0.000 28200.000
 N2O+O=NO+NO 0.100E+15 0.000 28200.000
 NH+OH=HNO+H 0.200E+14 0.000 0.000
 NH+OH=N+H2O 0.500E+12 0.500 2000.000
 NH+N=N2+H 0.300E+14 0.000 0.000
 NH+H=N+H2 0.100E+15 0.000 0.000
 NH2+O=HNO+H 0.863E+15 -0.500 0.000
 NH2+O=NH+OH 0.675E+13 0.000 0.000
 NH2+OH=NH+H2O 0.400E+07 2.000 1000.000
 NH2+H=NH+H2 0.692E+14 0.000 3650.000
 NH2+NO=NNH+OH 0.840E+16 -1.250 0.000
 NH2+NO=N2+H2O 0.620E+16 -1.250 0.000
 NH3+OH=NH2+H2O 0.204E+07 2.040 595.000
 NH3+H=NH2+H2 0.636E+06 2.390 10171.000
 NH3+O=NH2+OH 0.210E+14 0.000 9000.000
 NNH=N2+H 0.100E+05 0.000 0.000
 NNH+NO=N2+HNO 0.500E+14 0.000 0.000
 NNH+H=N2+H2 0.100E+15 0.000 0.000
 NNH+OH=N2+H2O 0.500E+14 0.000 0.000
 NNH+NH2=N2+NH3 0.500E+14 0.000 0.000
 NNH+NH=N2+NH2 0.500E+14 0.000 0.000
 NNH+O=N2O+H 0.100E+15 0.000 0.000
 HNO+M=H+NO+M 0.150E+17 0.000 48680.000
 H2O/10/ O2/2/ N2/2/ H2/2/
 HNO+OH=NO+H2O 0.360E+14 0.000 0.000
 HNO+H=H2+NO 0.500E+13 0.000 0.000
 HNO+NH2=NH3+NO 0.200E+14 0.000 1000.000
 N+NO=N2+O 0.327E+13 0.300 0.000
 N+O2=NO+O 0.640E+10 1.000 6280.000
 N+OH=NO+H 0.380E+14 0.000 0.000
 END

5.18.1989 modified for CHEMKIN I input from CHEMKIN II input

Ammonia vs. Urea

Parameter	Ammonia	Urea
Form	High Vapor Pressure Liquid Ammonia/Water Solution	Liquid Solution
Safety	Anhydrous/29.4% Aqueous – Safety Issue 19% Aqueous – Fewer Safety Issues	No Safety Issues
Storage	Anhydrous – Pressure Vessel Aqueous – Atmospheric Pressure	Atmospheric Pressure Crystallization at Low Temps.
Injectors	Needs Carrier Gas	Atomizer (Pressure or Twin Fluid)
Temperature	Peak Removal @ 1750° F	Peak Removal @ 1850° F Large Dilute Drops Shield Urea
System Complexity	Relatively Simple	Relatively Simple

SCR vs. SNCR

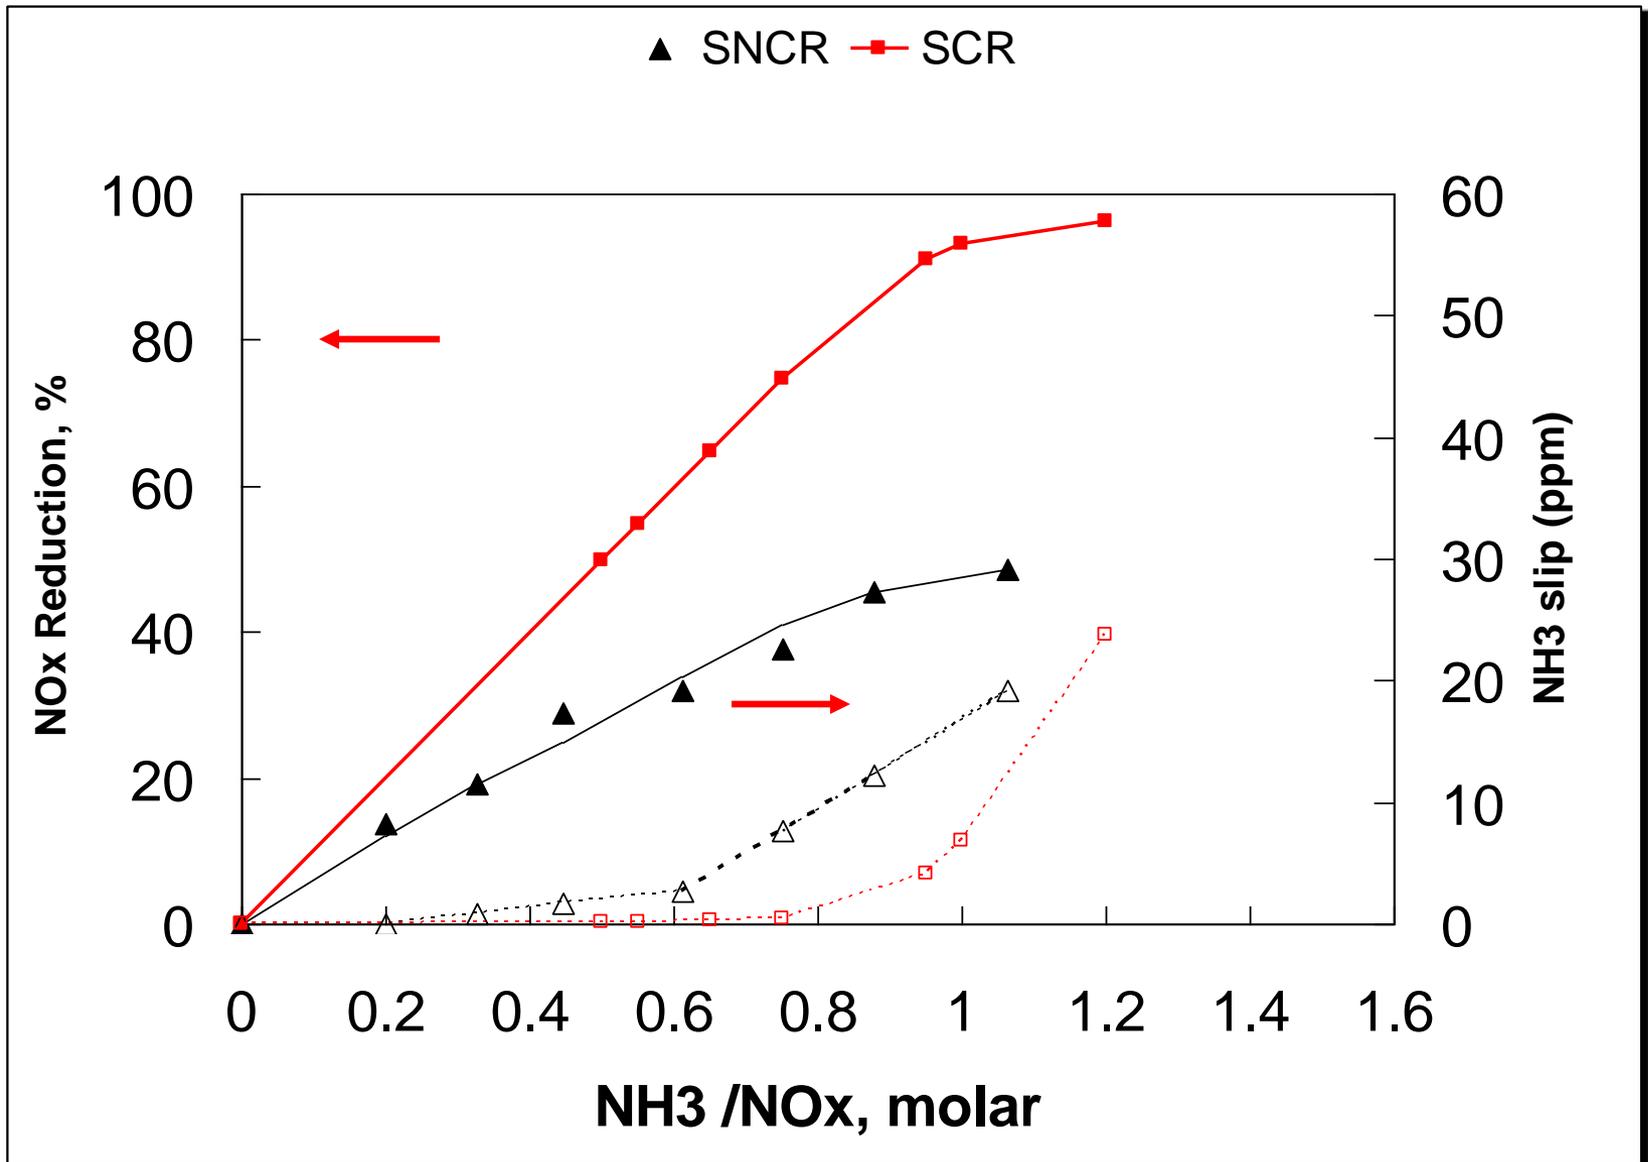

SCR vs. SNCR

	SNCR	SCR
NOx Reductioun	20-50%	50-95%
Hardware	Simple	More Complex
Capital Cost	Low (1)	High (5-10)
Reagent Utilization	Typ. 30%	Almost 100%
O&M	Reagent	Reagent/Catalyst
Designability	Poor	Good
NH3 slip	5-20 ppm	<10 ppm

NH₃ Emissions Limits

- **Regulatory Limit**
- **NH₃/SO₃ Reactions**
 - **Ammonium Bisulfate: $\text{NH}_3 + \text{SO}_3 \rightarrow \text{NH}_4\text{HSO}_4$**
 - **Ammonium Sulfate: $2\text{NH}_3 + \text{SO}_3 \rightarrow (\text{NH}_4)_2\text{SO}_4$**
- **NH₃/Ash Absorption (issue for coal-fired utility units that sell their ash for making cement)**
- **NH₃/HCl Reactions (detached plume)**
 - **NH₃/HCl $\text{NH}_4\text{Cl}(s)$**

Comparison of NOx Control Technologies – Gas-Fired Boilers

Technology	Approx. Reduction	Approx. lbs/MMBTU	Approx. ppmv @ 3% O2
Standard burners	Base case	0.14	120
Low NOx burners	60%	0.06	45
Ultra Low NOx Burners – 1 st gen.	80%	0.03	25
Ultra Low NOx Burners – 2 nd gen.	95%	0.007	6
FGR	55%	0.025	20
Compu- NOx w/ FGR	90%	0.015	12
SNCR	40%	0.033 - 0.085	27 - 70
Catalytic Scrubbing	70%	0.017 - 0.044	14 - 36
SCR	90 – 95%	0.006 - 0.015	5 - 12



**Let's Discuss Particulate &
NH₃ Controls**

Objectives

- **Define “particulate matter or PM”**
- **Identify sources of particulates**
- **Analyze opacity issues**
 - **Potassium plumes**
 - **Ammonium-chloride plumes**

What is Particulate Matter??

- **It is what the test measurement says it is**
- **Meaning:**
 - **Solid particles that are captured on a filter**
 - **Condensable matter collected in a set of impingers**
- **What eventually condenses in the atmosphere is also considered as particulate matter along with “solid” particulate in the gas stream**



PM

Sources of “Particulate Matter”

- Ash in the fuel
 - Silica and Alumina - generally large particles that are retained or collected in the boiler/precipitator
 - Intrinsic ash - generates the small particles that are more troublesome to control
 - Alkalis - potassium, sodium and calcium
- Condensables (HCl , SO_3 , NH_4Cl) which are also considered as “particulates”

Ammonia Slip

- $\text{NH}_3 + \text{OH} \Rightarrow \text{NH}_2 + \text{H}_2\text{O}$
- $\text{NH}_2 + \text{NO} \Rightarrow \text{N}_2 + \text{H}_2\text{O}$
- $2\text{NH}_3 + \text{OH} + \text{NO} \Rightarrow 2\text{H}_2\text{O} + \text{N}_2 + \text{NH}_3$
- 10 to 25 ppm NH_3 Slip
- Could be higher
- Always have Some NH_3 slip



- NH_3 and HCl released as gases
- Combine and condense into aerosol particles
- Two parallel processes taking place
 - Rate of formation reaction controlled by concentrations
 - Rate of condensation control by temperature
- Both affected by air dilution in the plume


NH_4Cl Formation

- Function of the concentrations of NH_3 and HCl
- Concentrations decrease as air is mixed into the plume
- Lower concentrations \Rightarrow less NH_4Cl formed
- Therefore: air dilution is good


What Can Be Done??

- Minimize (eliminate Cl) in fuel
- Install acid gas controls
- Minimize NH_3 slip \leq monitor
- High stack gas temperatures
- High ambient air temperatures (winter time a problem??)
- Promote rapid gas/air mixing ??
- Install high gas temperature concentric stack annulus ??

Continuous NH3 Analyzer

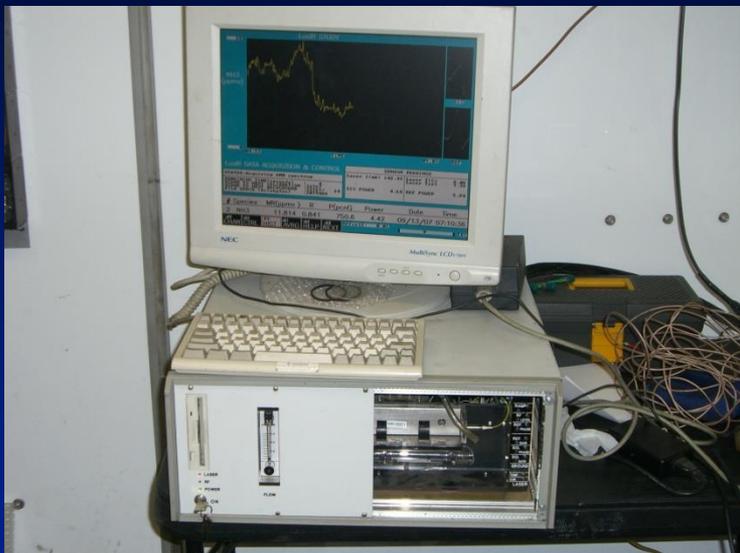

**Laser &
Detector**

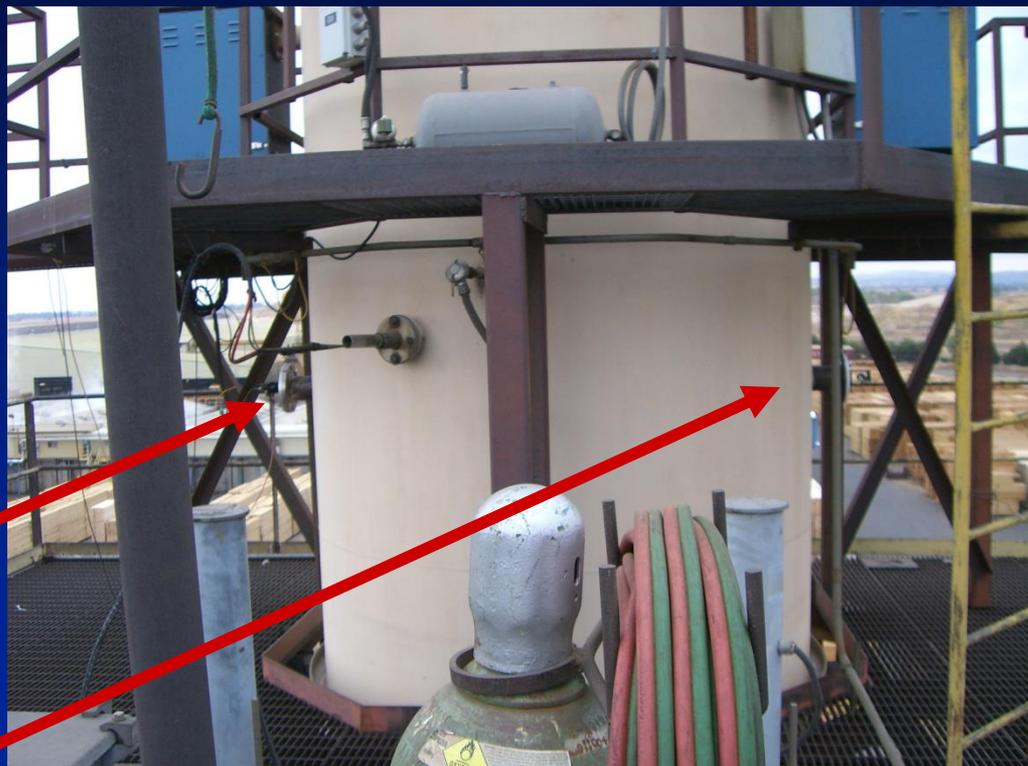

**Retro
Reflector**



Laser & Detector



Retro-reflector

Let's Discuss VOC Control

- ◆ **Material Usage Minimization**
- ◆ **Containment**
- ◆ **Absorption**
- ◆ **Adsorption**
- ◆ **Oxidation**

Material Usage Minimization

Basic Strategy:


If we optimize the efficiency of the amount of VOC-containing material we use, we also limit VOC emissions



Materials Minimization

**We must consider real-world demands
e.g. Spray painted cars look better**



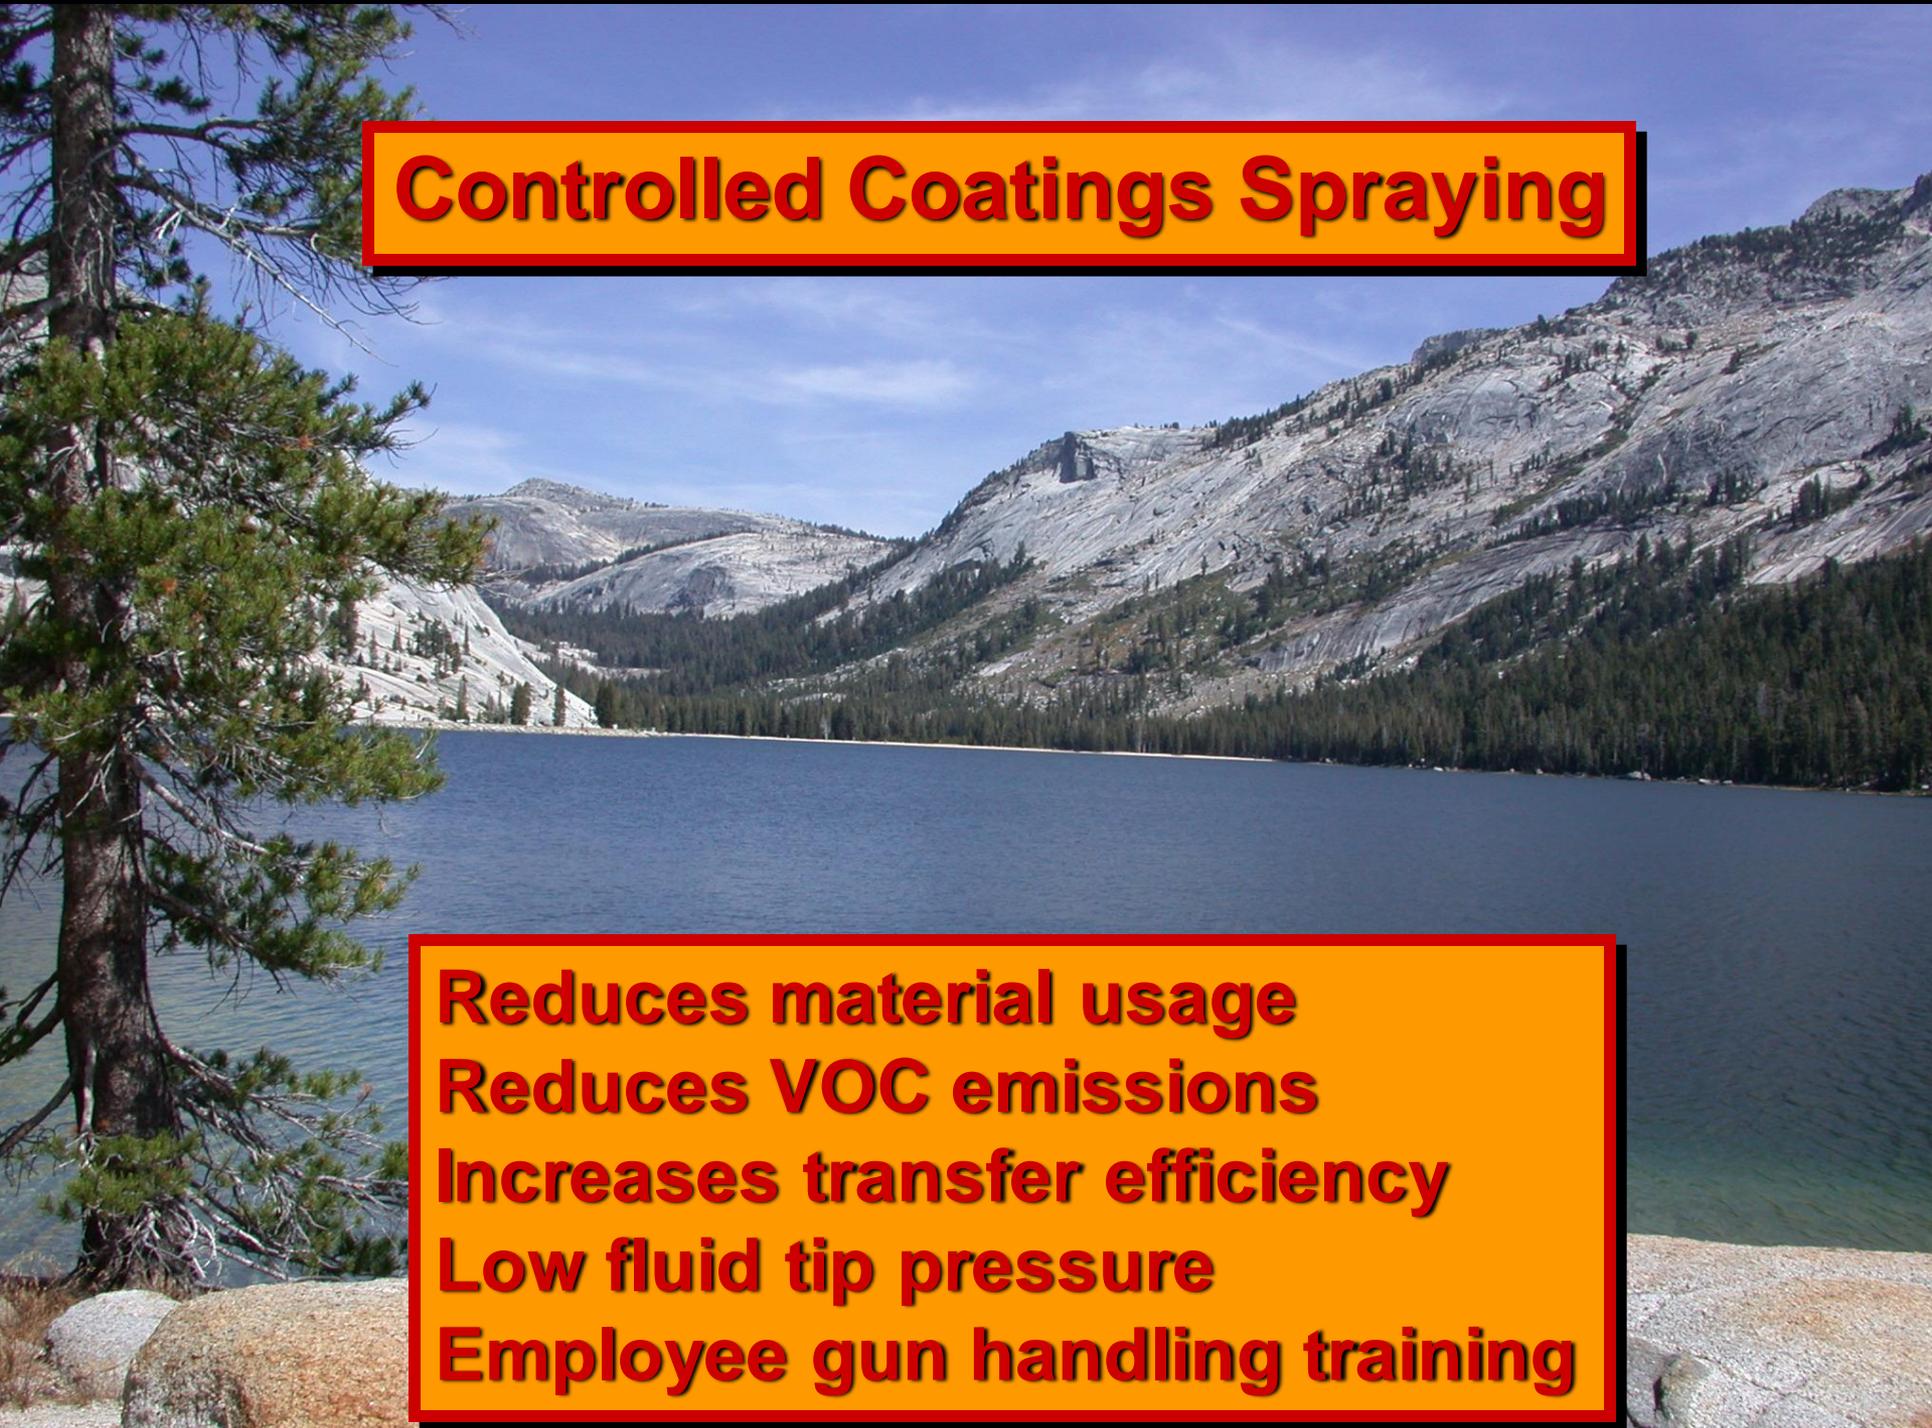

Controlled Coatings Spraying

Reduces material usage
Reduces VOC emissions
Increases transfer efficiency
Low fluid tip pressure
Employee gun handling training



**Motor Vehicle Coating –
High Volume Low Pressure (HVLP)
Spray Gun**



**HVLP
Chopper Gun**



Chopper Gun



Gel Coat Application in a Spray Booth

Hand Layup of Fiberglass



Materials Minimization


Containment Strategy



**Solvent
Reclaim
System**

VOC Disposal System

Is this well contained?

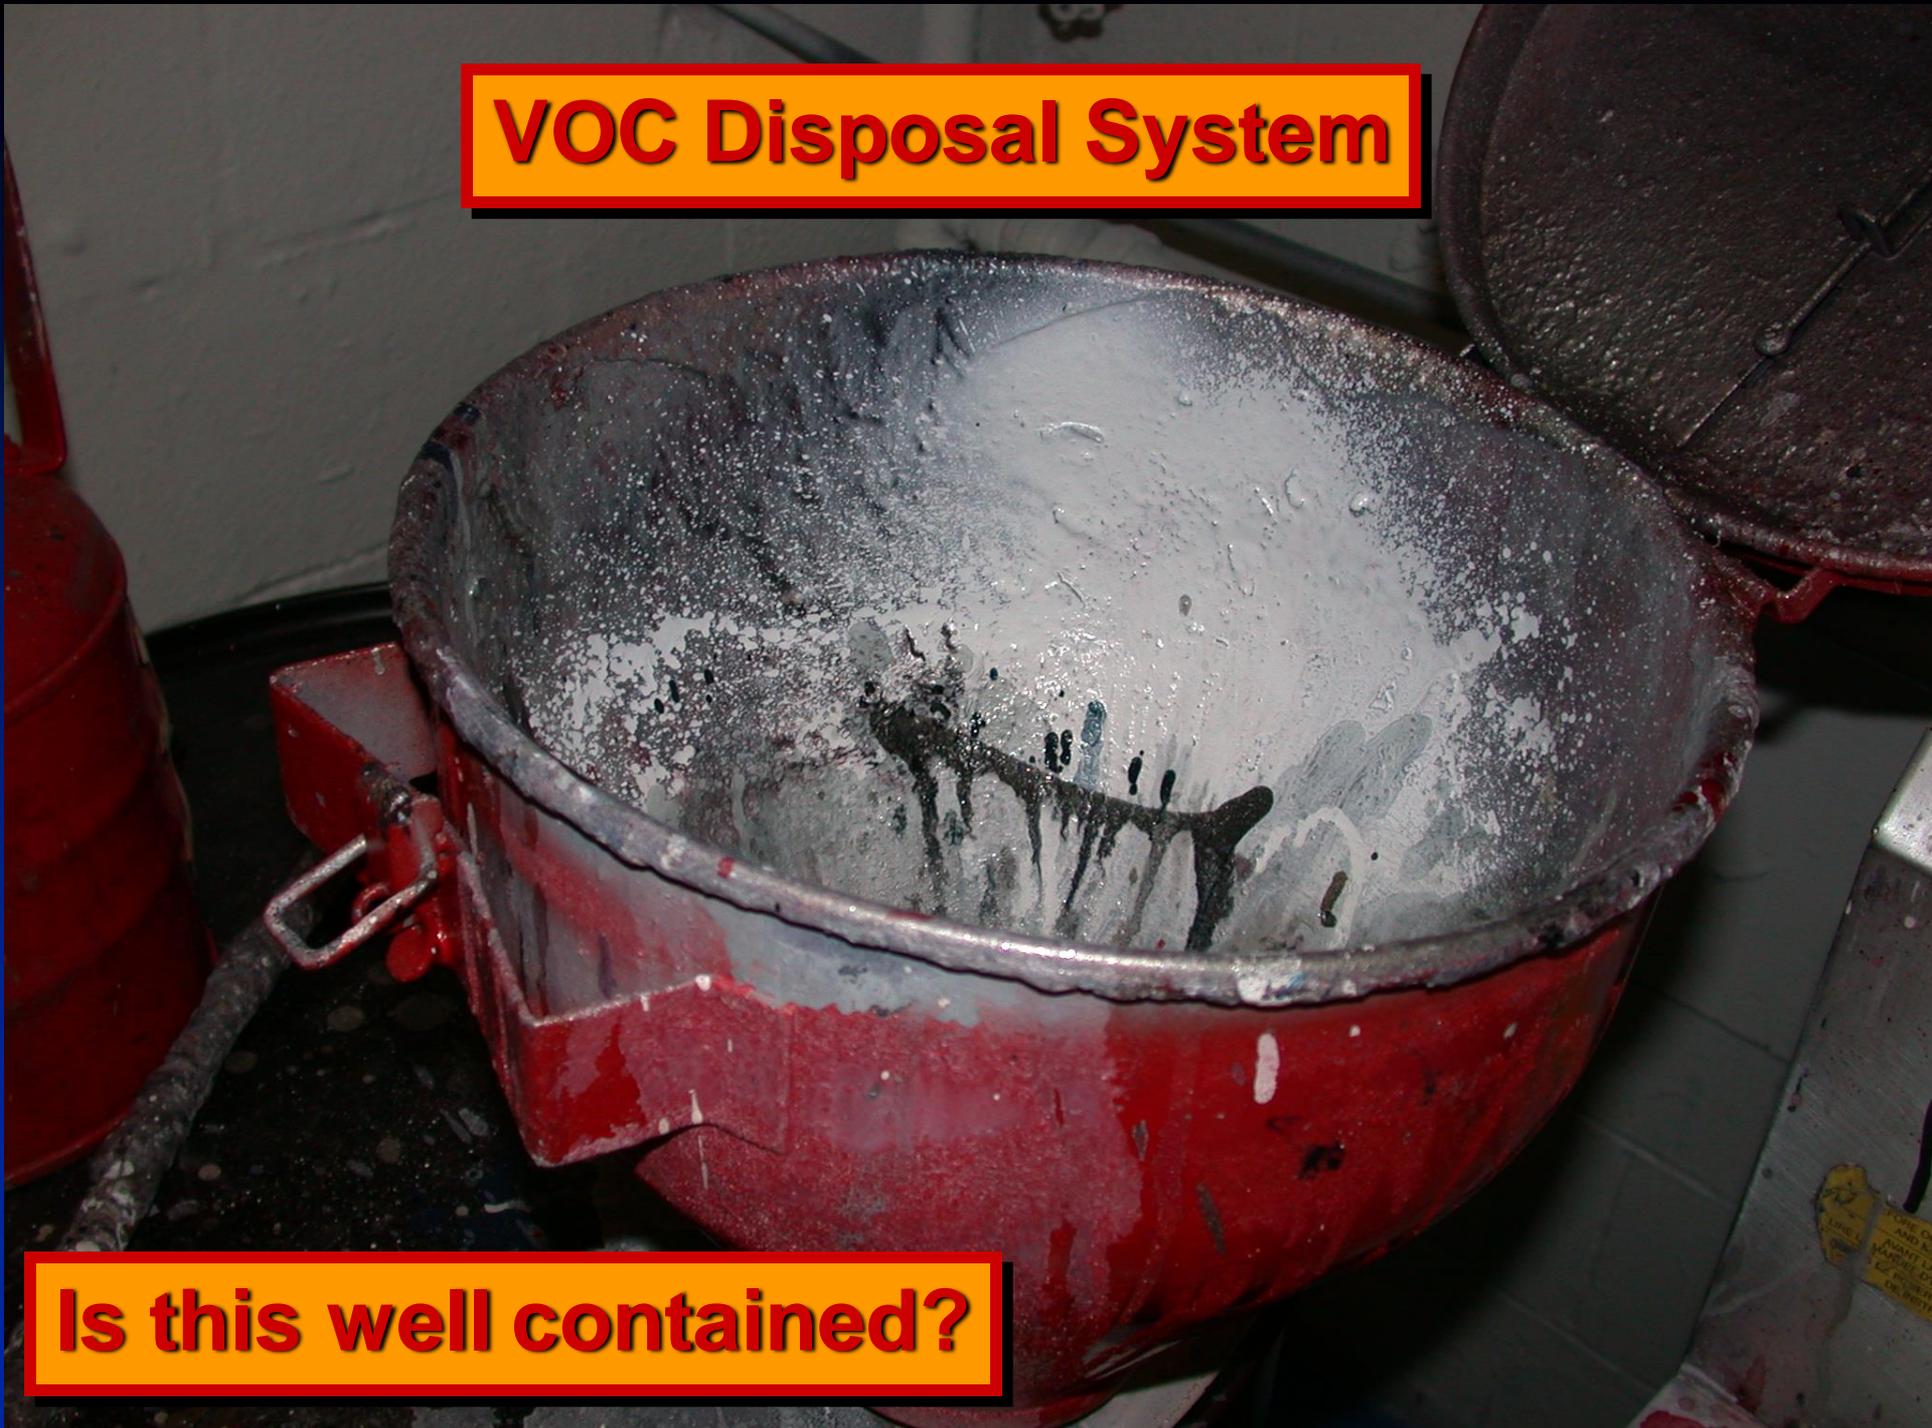

HAZARDOUS WASTE

STATE AND FEDERAL LAW PROHIBIT IMPROPER DISPOSAL. IF FOUND, CONTACT THE NEAREST POLICE, OR PUBLIC SAFETY AUTHORITY, THE U.S. ENVIRONMENTAL PROTECTION AGENCY OR THE CALIFORNIA DEPARTMENT OF TOXIC SUBSTANCE CONTROL

GENERATOR INFORMATION:

NAME: LEER-WEST
 ADDRESS: 1686 EAST BEAUMONT STREET
 CITY: WOODLAND
 STATE: CA ZIP: 95778
 PHONE: (530) 666-176 X31
 EPA ID NO.: 4-1243
 MANIFEST DOCUMENT NO.: D001, D009, 908, D008
 WASTE NO.: F003, F005, CA 343
 ACCUMULATION START DATE: 1/9/7

CONTENTS COMPOSITION:


PHYSICAL STATE: SOLID LIQUID HAZARDOUS PROPERTIES CORROSIVE FLAMMABLE TOXIC
 REACTIVITY OTHER

3, UN1263, PG II

D.O.T. PAPER SHIPPING NAME OR NA NO. WITH PREFIX

HANDLE WITH CARE!

PRINTED BY: G.C. LABEL / 1-800-997-6966 / MADE IN U.S.A. / ITEM# HWLCA175

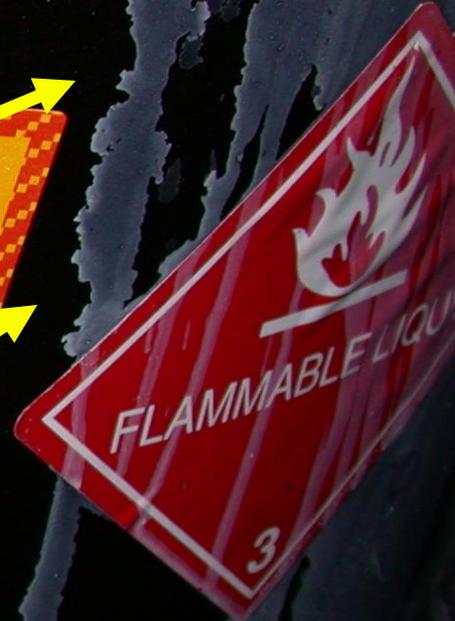

**VOC
Collection
System**

CAUTION HAZARDOUS MATERIAL

ACETONE

CAUTION HAZARDOUS MATERIAL

ACETONE




Look for housekeeping habits



Look for housekeeping habits



Look for housekeeping habits

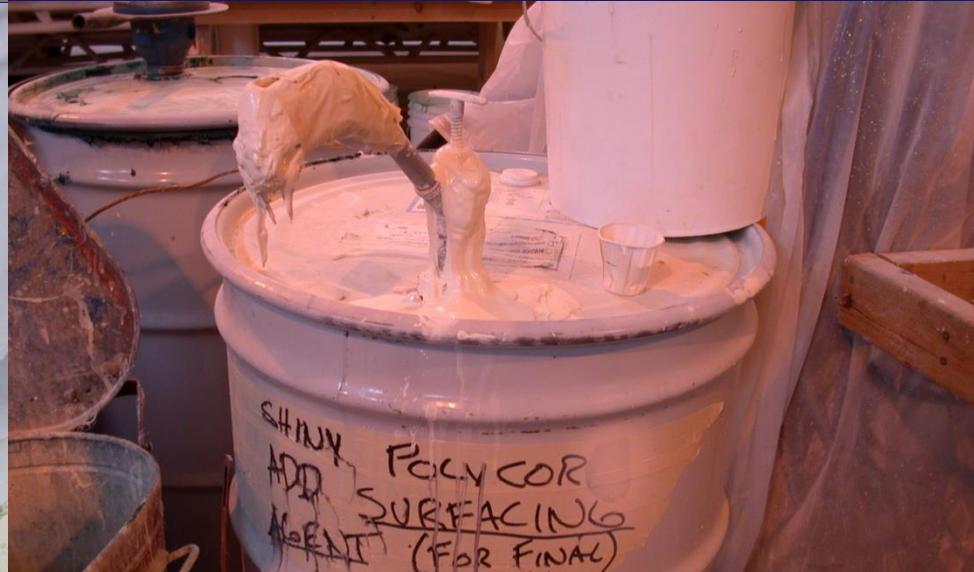

Look for housekeeping habits



Capture and Control


VOC Control Techniques – Capture System

- **General description**
 - **Total efficiency is product of capture and control device efficiencies**
 - **Two types of systems**
 - **Enclosures and local exhausts (hoods)**


VOC Control Techniques – Capture System

- **General description**
 - **Two types of enclosures**
 - **Permanent total (M204) – 100% capture efficiency**
 - **Nontotal or partial – must measure capture efficiency**

Capture System Schematic

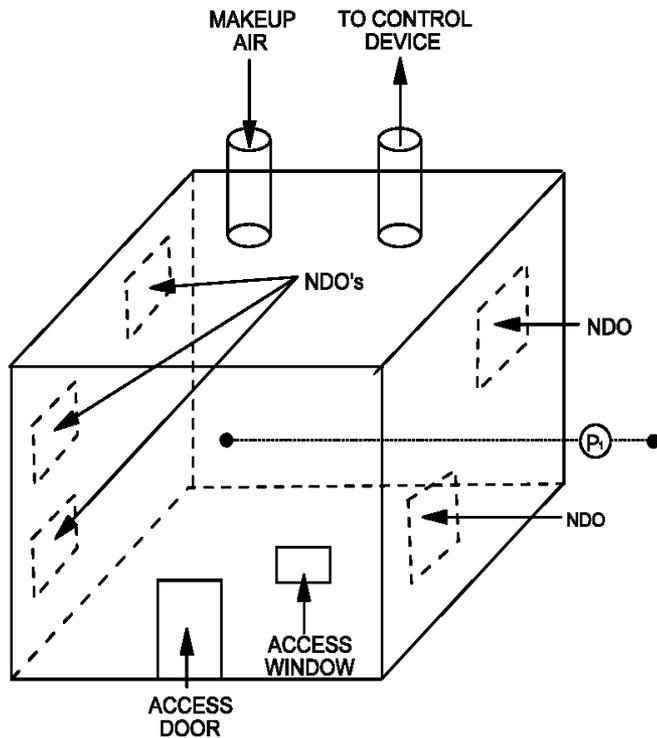

P1 = DIFFERENTIAL PRESSURE SENSOR (BETWEEN ENCLOSURE INTERIOR AND SURROUNDING AREA/ROOM)

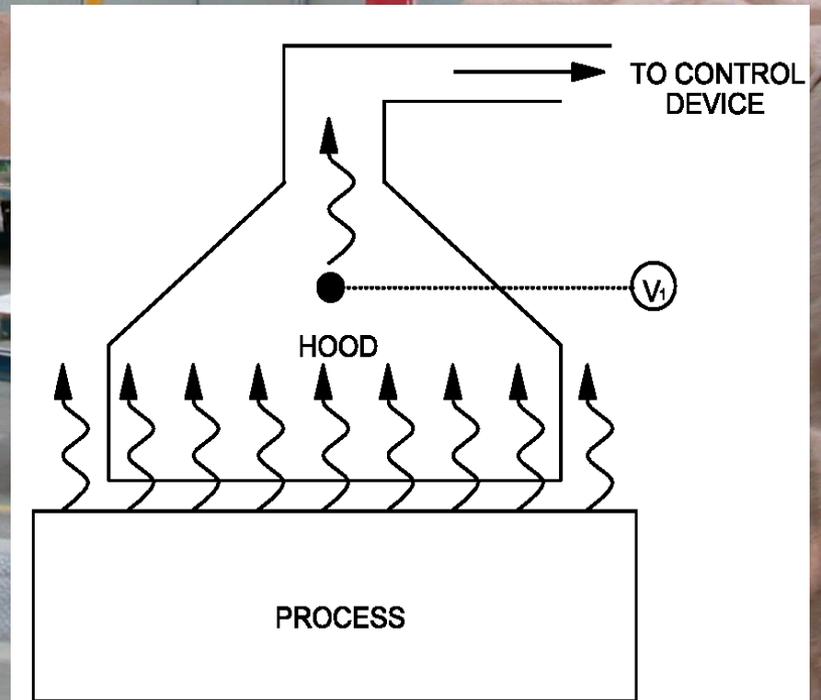

V1 = VELOCITY AT HOOD

VOC Control Techniques – Capture System

- **Performance indicators**
 - **Enclosures**
 - **Face velocity**
 - **Differential pressure**
 - **Average face velocity and daily inspections**

VOC Control Techniques – Capture System

- **Performance indicators (cont.)**

Exhaust Ventilation

- **Face velocity**
- **Exhaust flow rate in duct near hood**
- **Hood static pressure**


Any Concerns Here?



Let's Discuss Packed Column Absorbers (a.k.a Scrubbers)




Packed Bed Scrubber

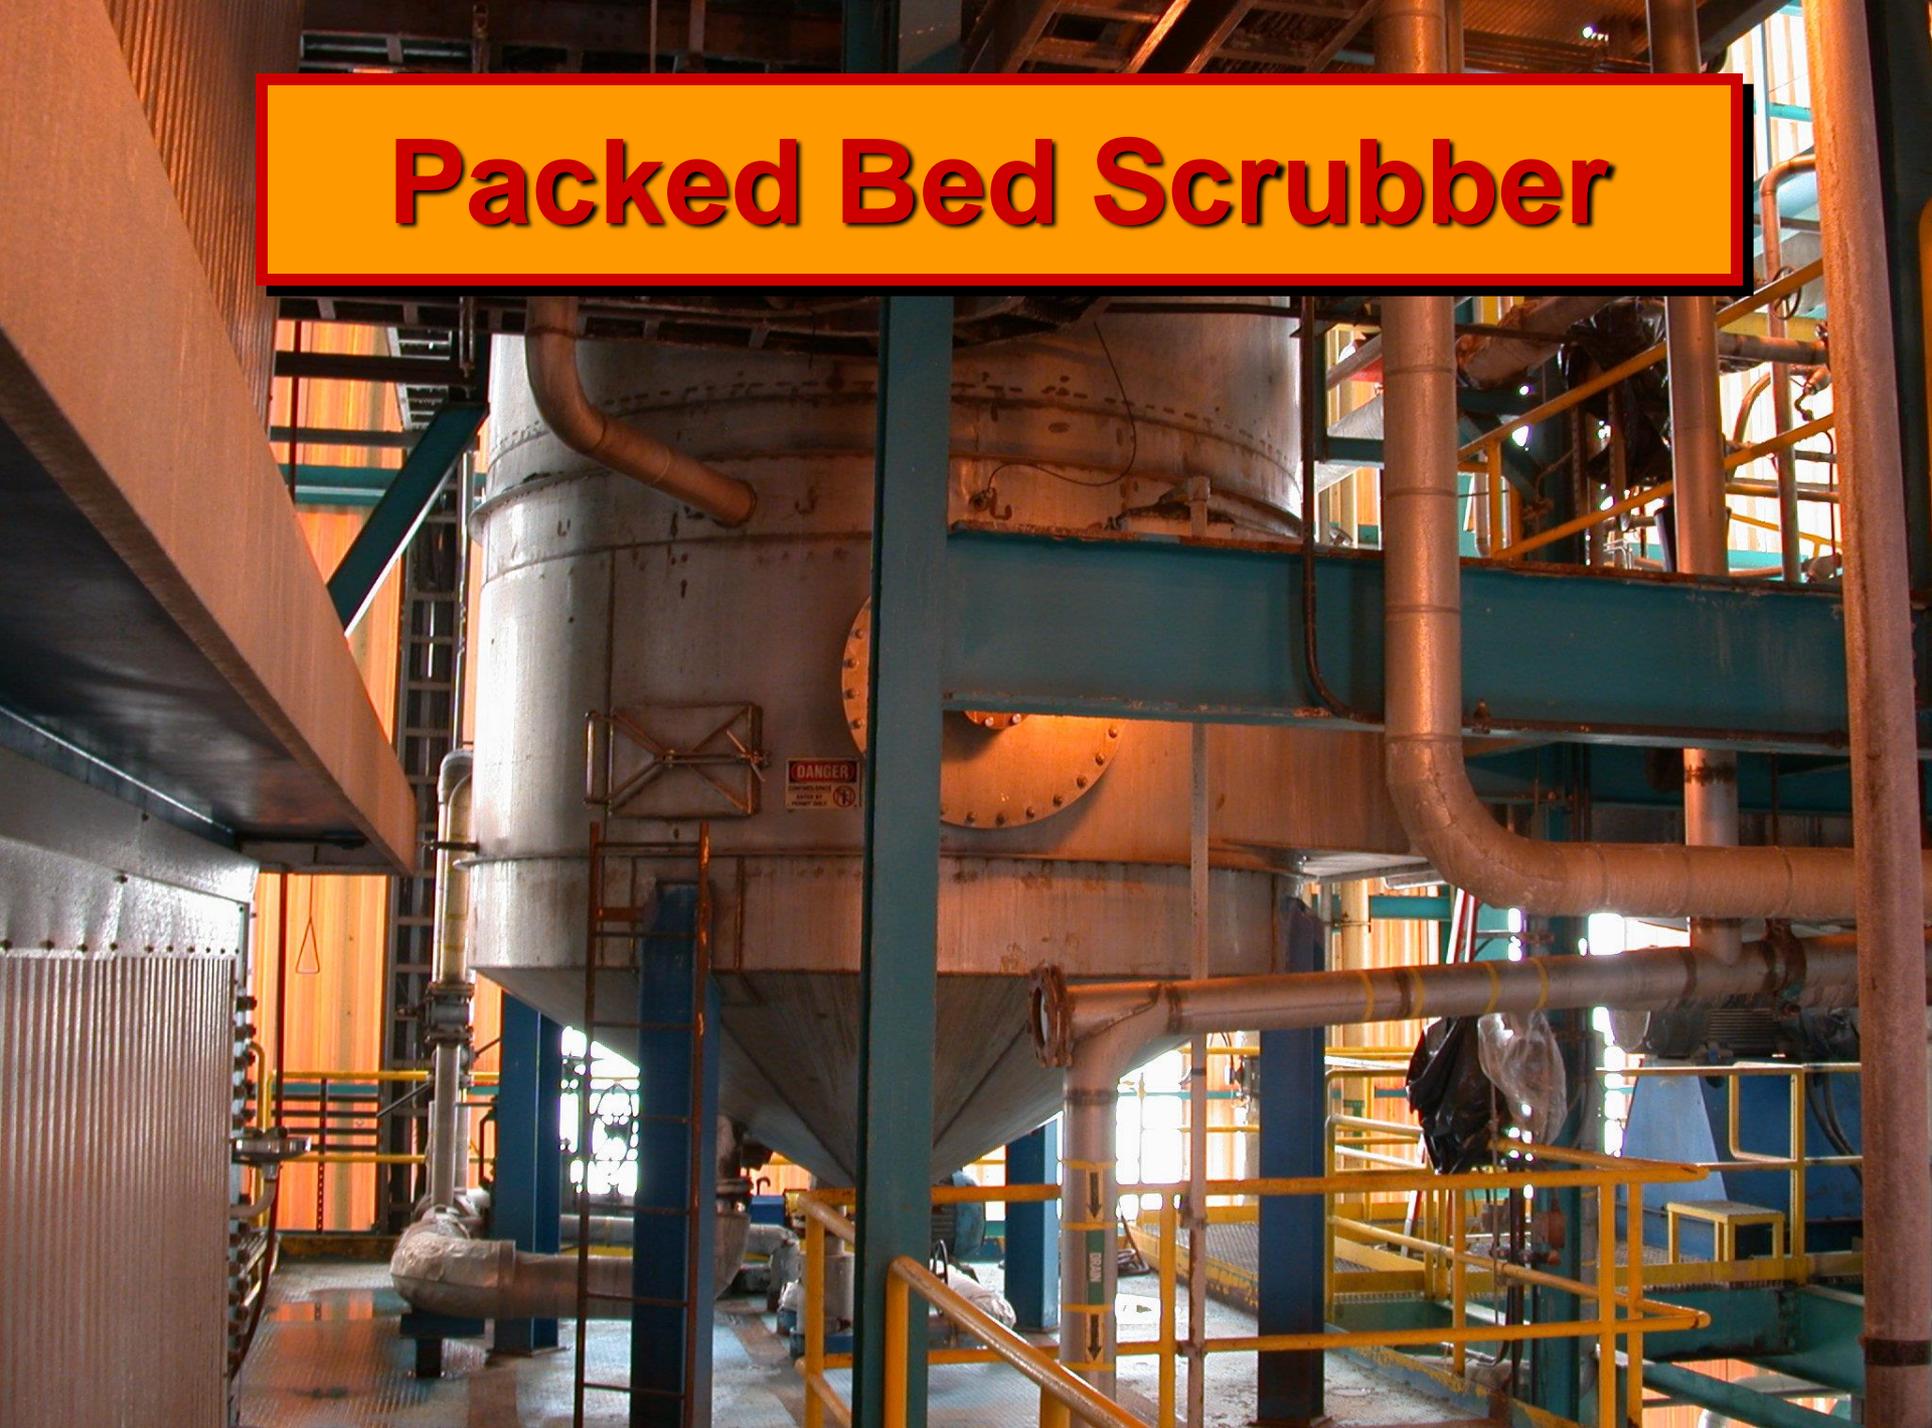

Typical packed scrubber

Liquor flow and pH monitoring

Recirculation liquid pumping system and liquor make-up

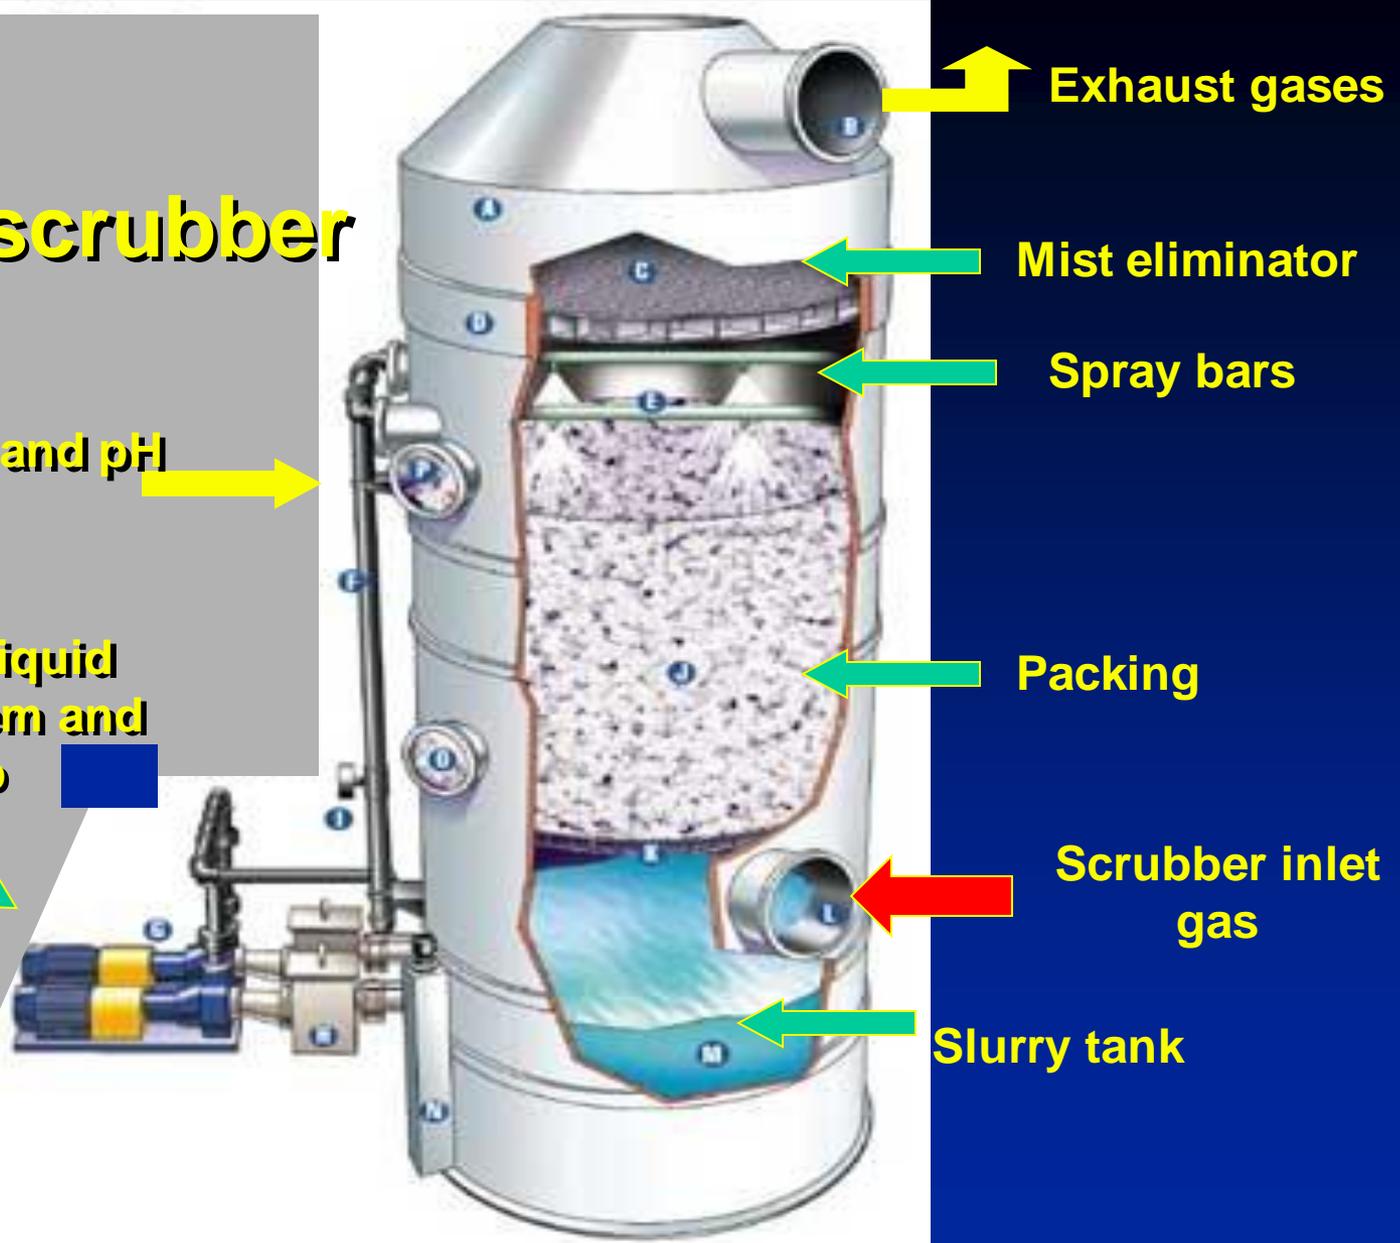

Typical Packing Material



Atomizing Spray Nozzles



Scrubbers

- **Used for a variety of pollutants**
 - Both particulates and VOCs
 - Acid gases
 - Odors (e.g. rendering operations)
- **Primary indicators**
 - Water (liquor) flow rate
 - pH
 - Outlet temperature
- **Secondary (longer term) indicators**
 - Inlet & water temperatures
 - Gas pressure drop

Monitoring Approach – SO₂

Indicator	Slurry pH	Slurry flow rate
Indicator range	<9.0 - corrective action, reporting	<175 – corrective action, reporting
Measurement location	Recirculation line	Recirculation line
QA/QC	Annual cal.	Annual cal.
Frequency	1/15 minutes	1/15 minutes
Averaging time	hourly	hourly



**Compliance
Concerns?**




**Scrubber Leaking
Liquor**

**Compliance
Concerns?**

Scrubber Liquor Pump



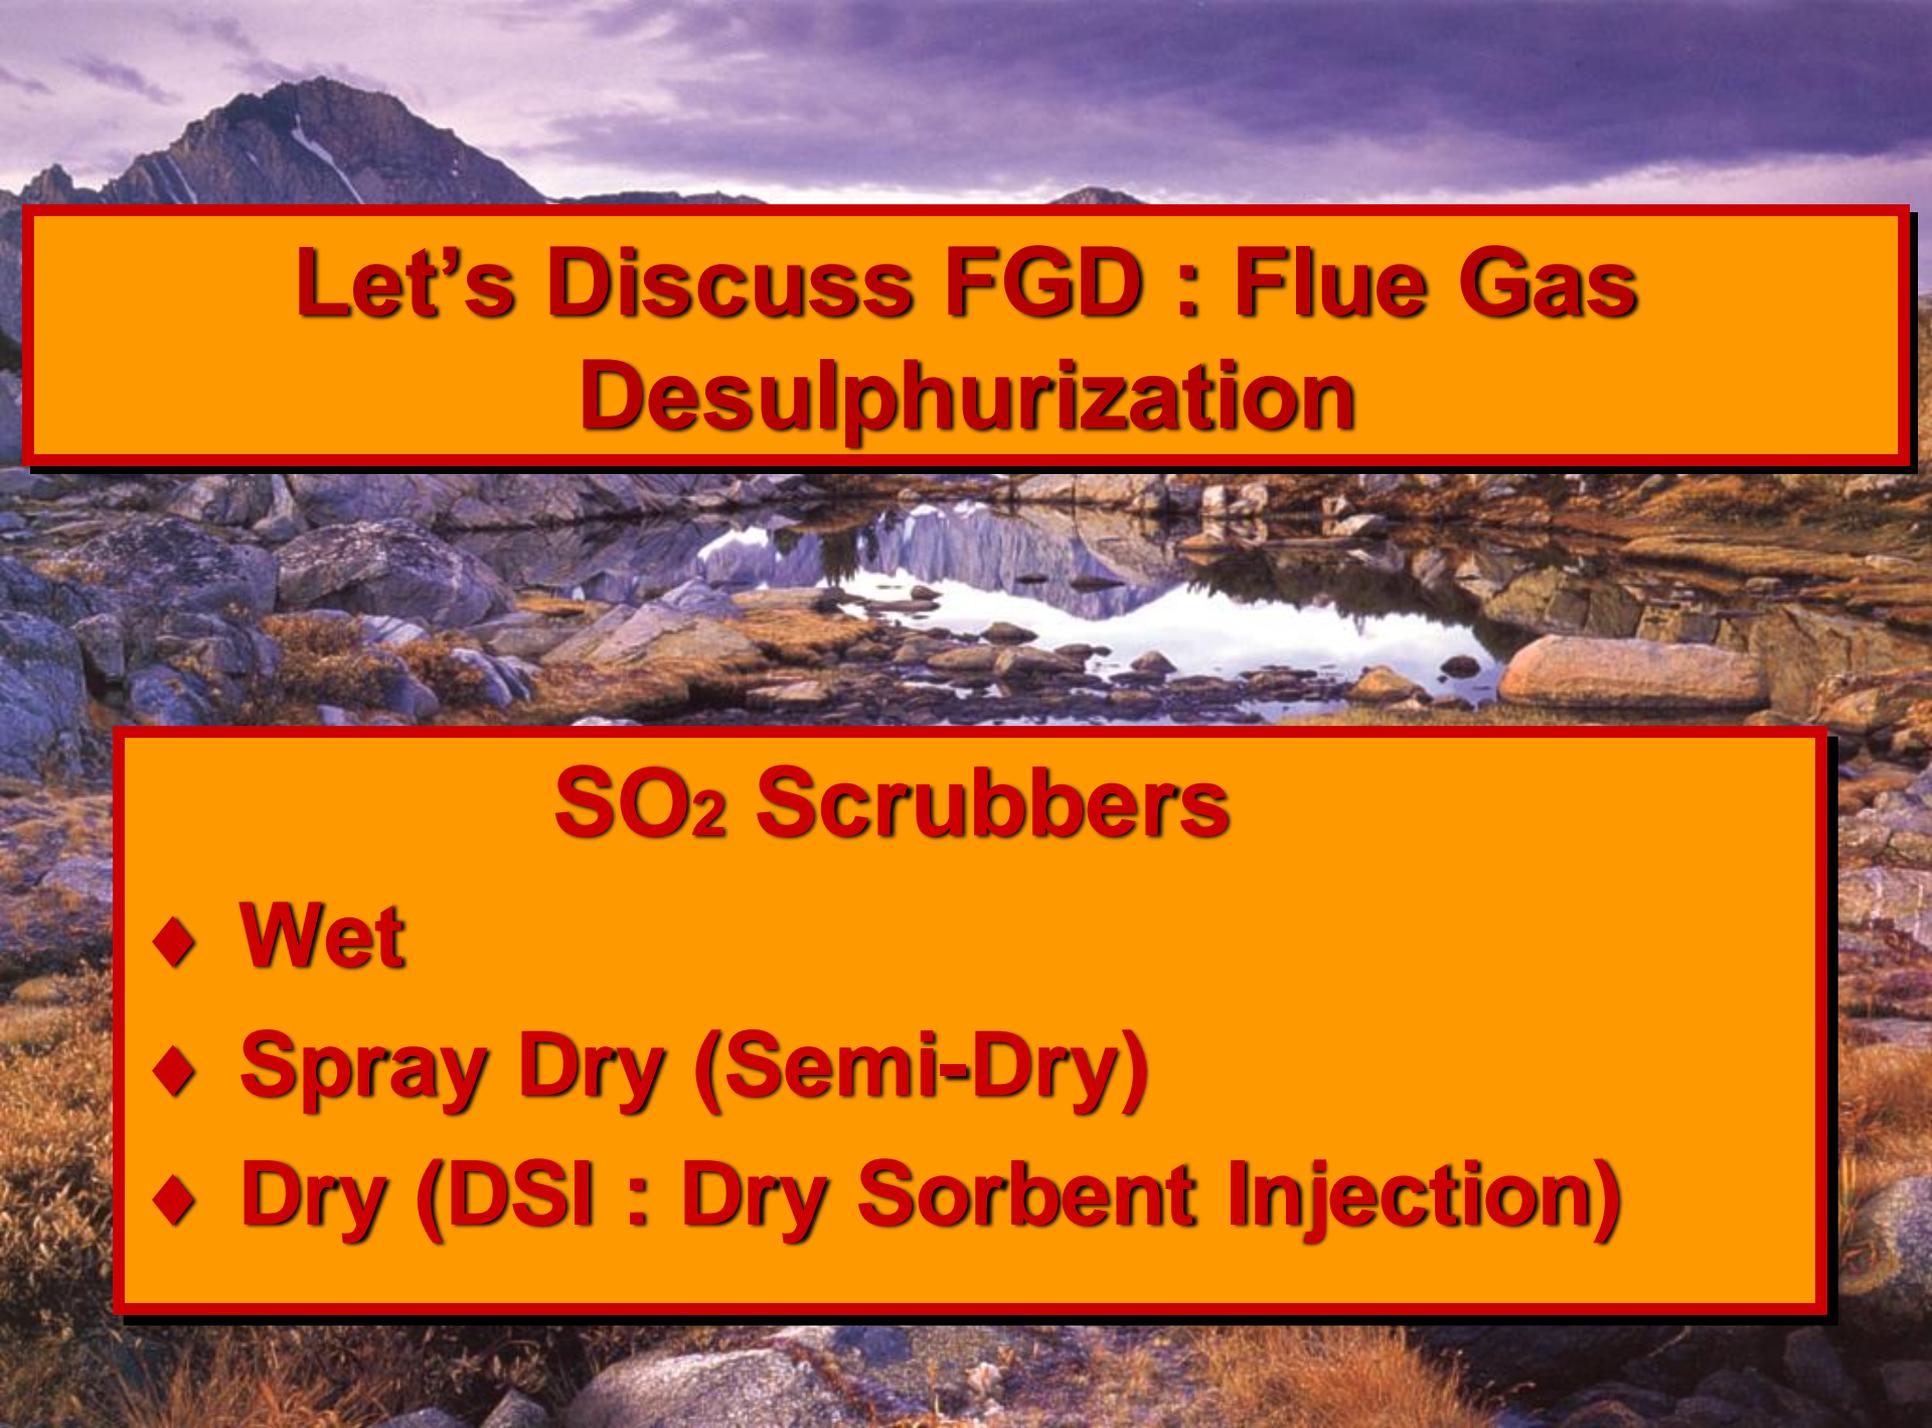


Let's Discuss FGD : Flue Gas Desulphurization

SO₂ Scrubbers

- ◆ **Wet**
- ◆ **Spray Dry (Semi-Dry)**
- ◆ **Dry (DSI : Dry Sorbent Injection)**

SO_x Control


Wet FGD

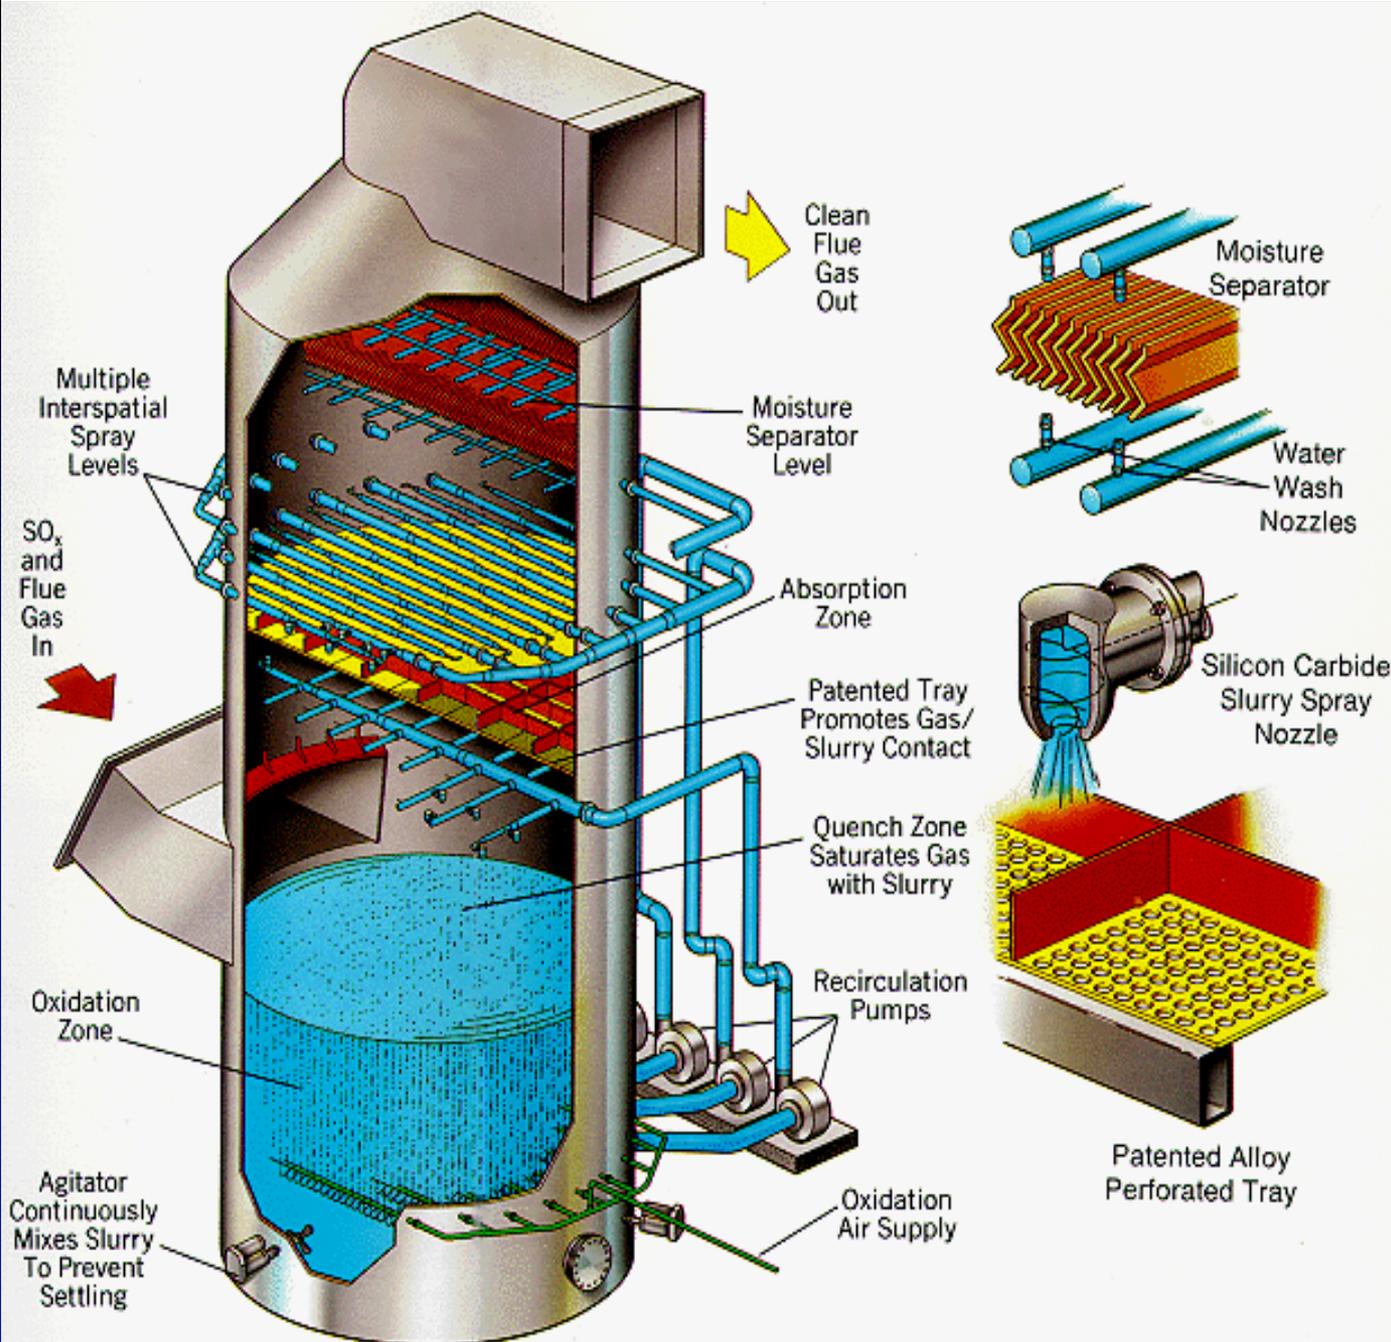


Five FGD Scrubber Modules on Utility Boiler




Spray Dryer Absorber

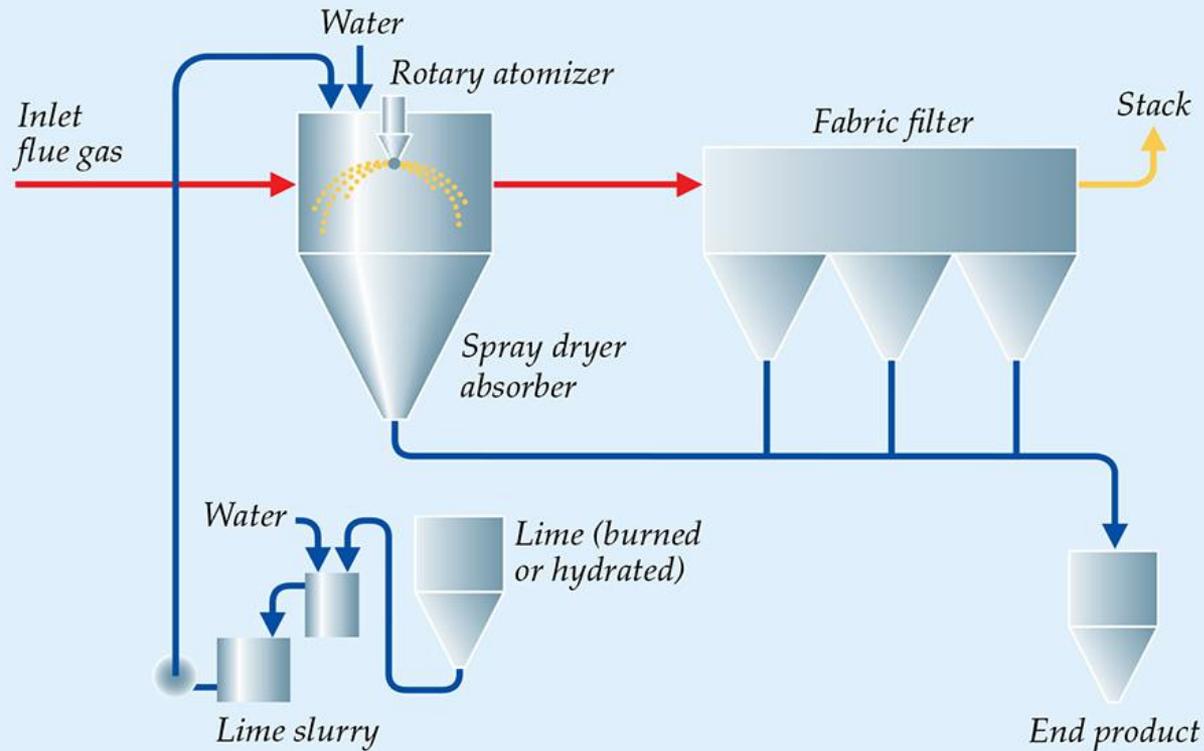


Spray Dryer Absorbers

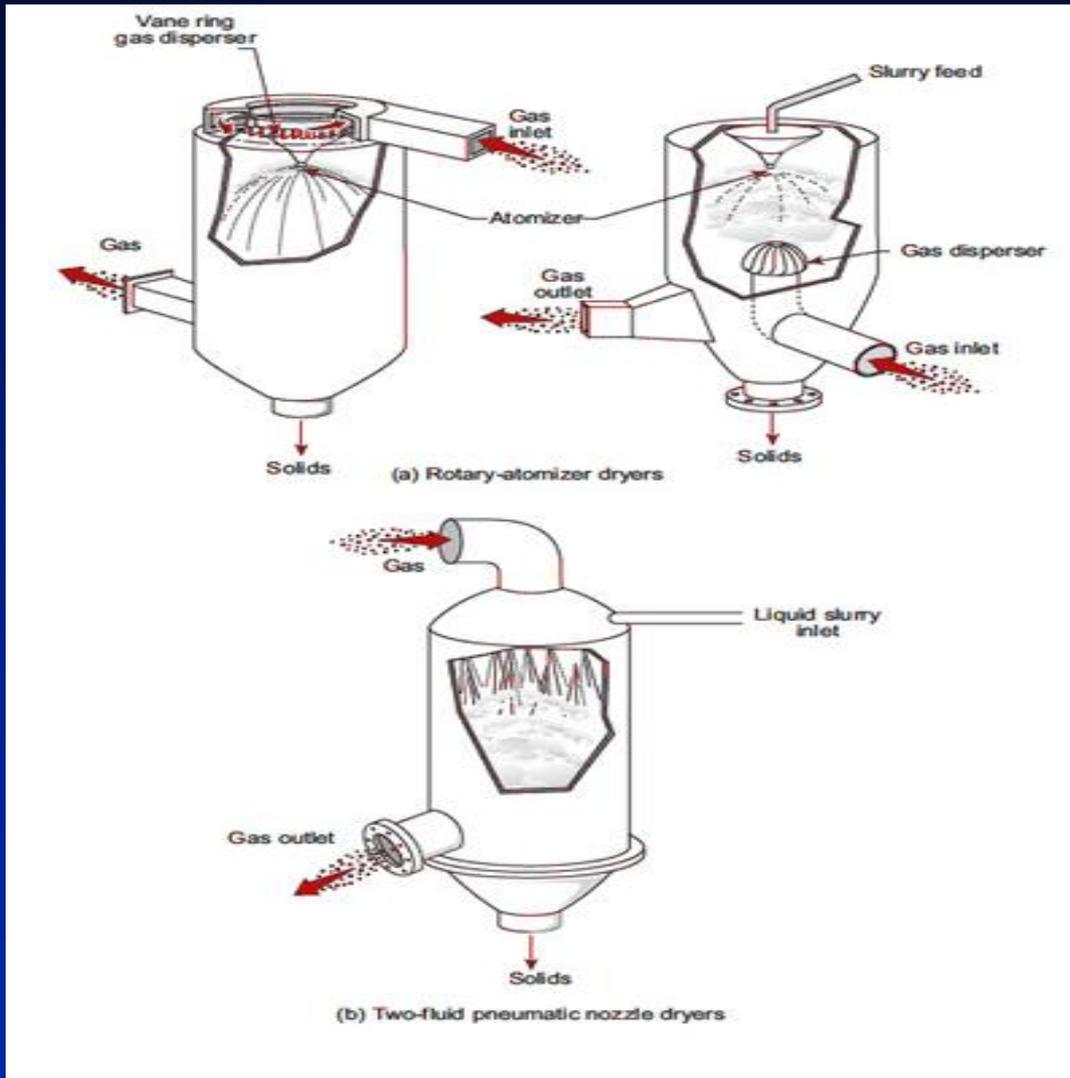


Dry Sorbent Injection

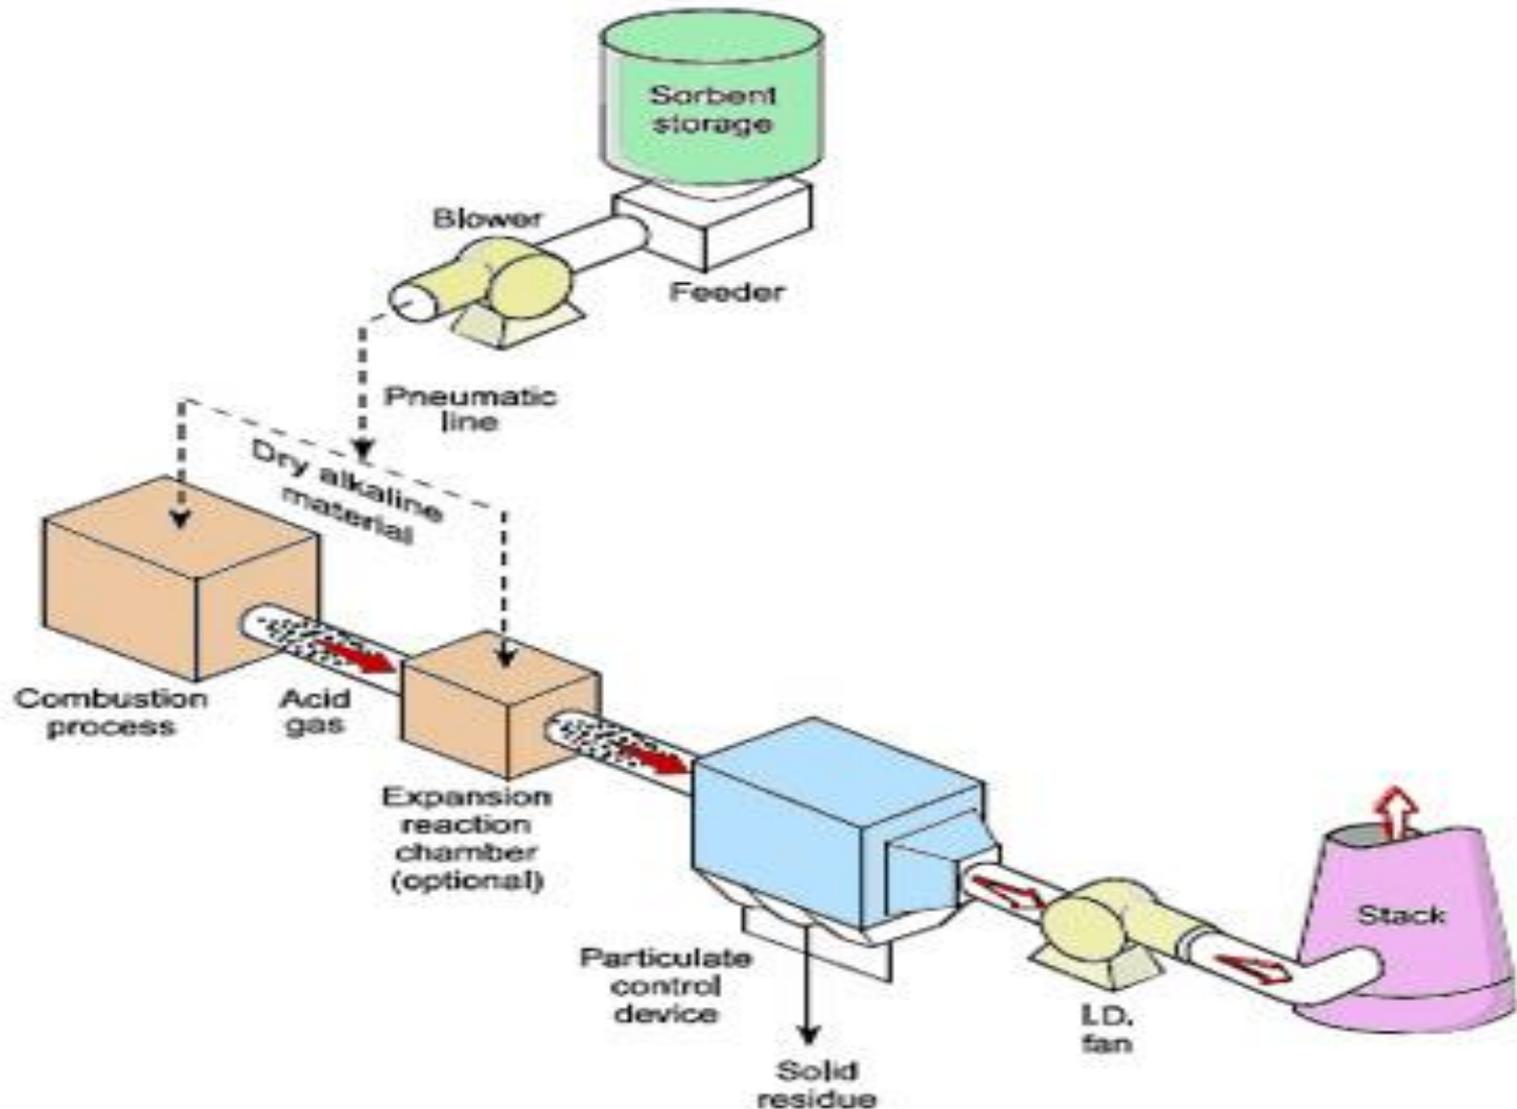


Dry Sorbent Injection

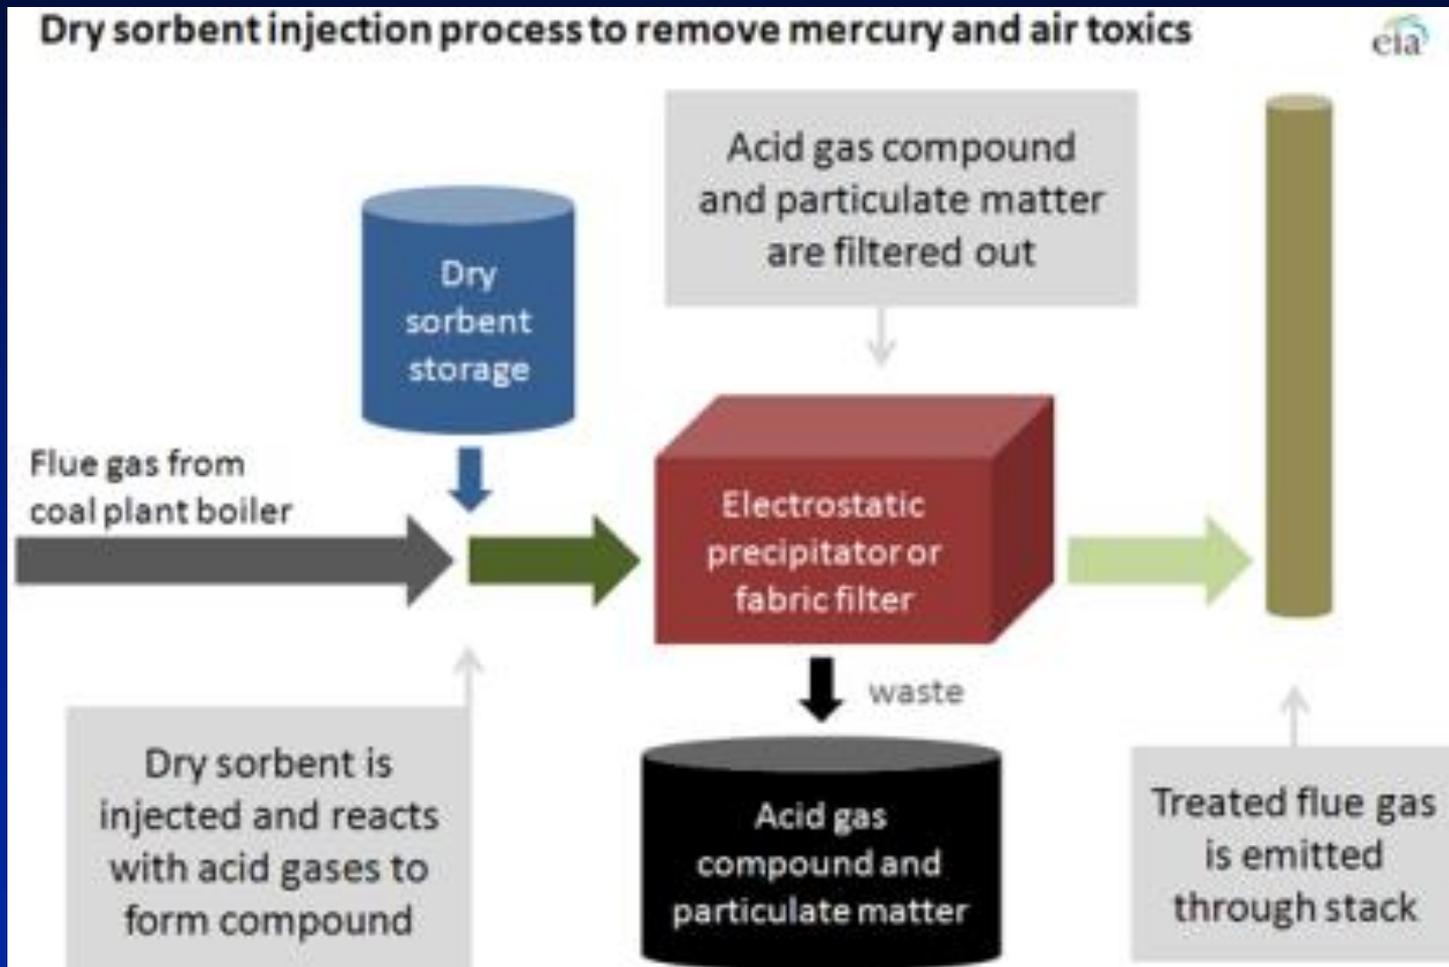


Pensacola's Gulf Power Scrubber



Dry Fork (Wyoming) Station



Mercury Control Activated Carbon Injection

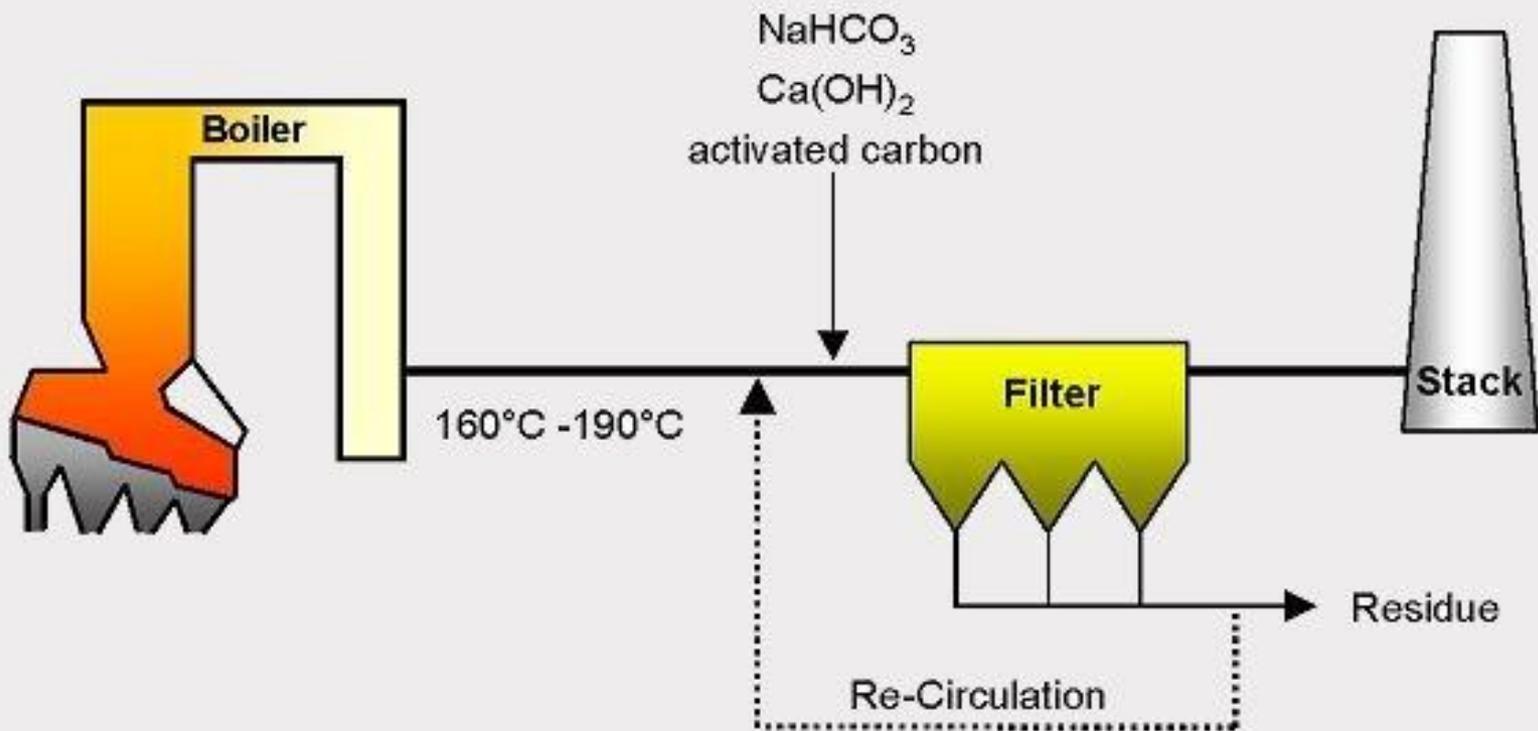



**Let's Discuss
Carbon Adsorption
Systems**


Carbon Adsorber





Carbon Adsorber – Fixed Bed Example



STANDARD CONFIGURATIONS

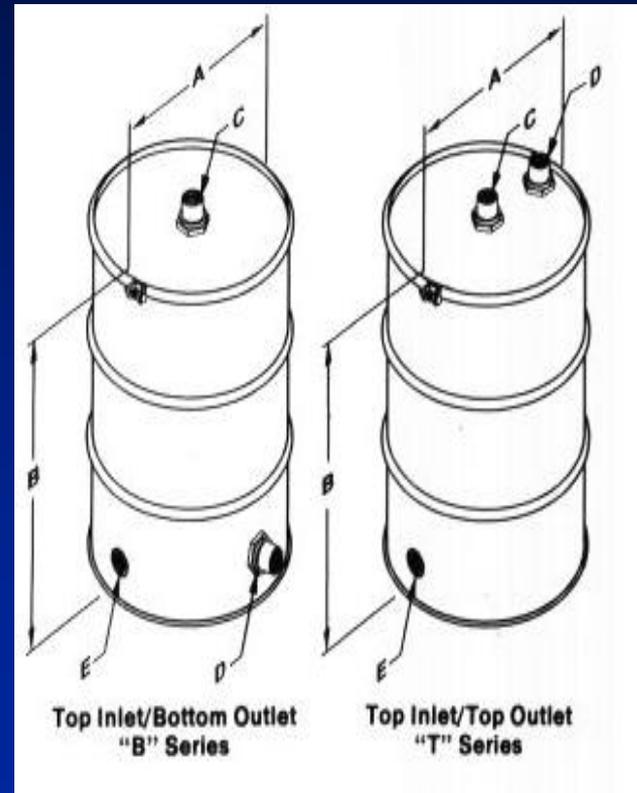

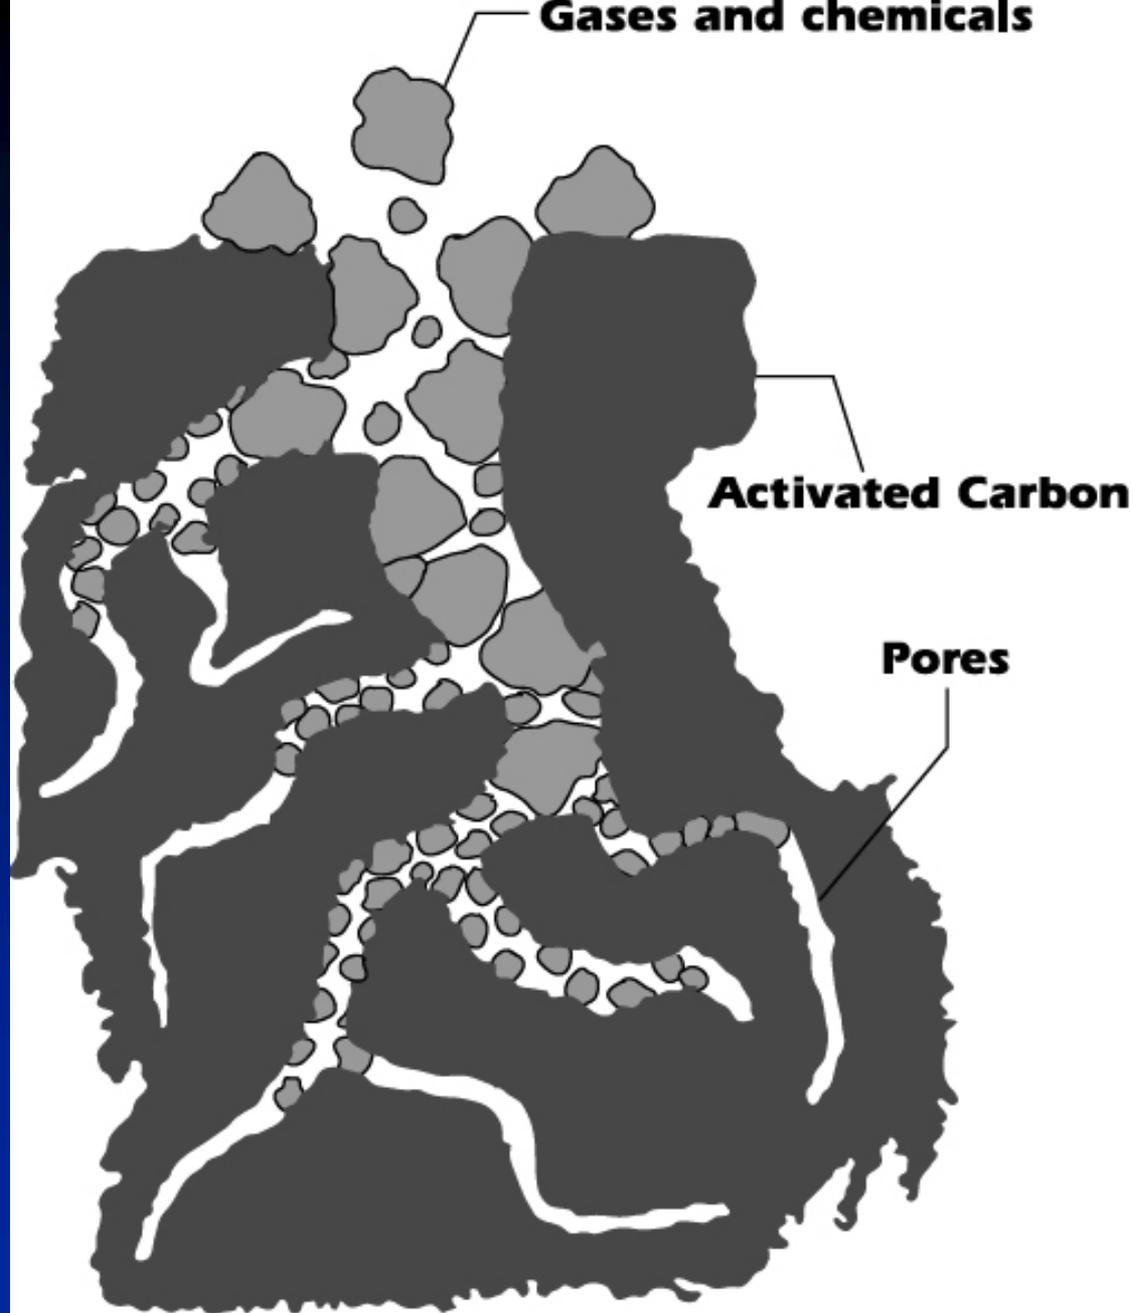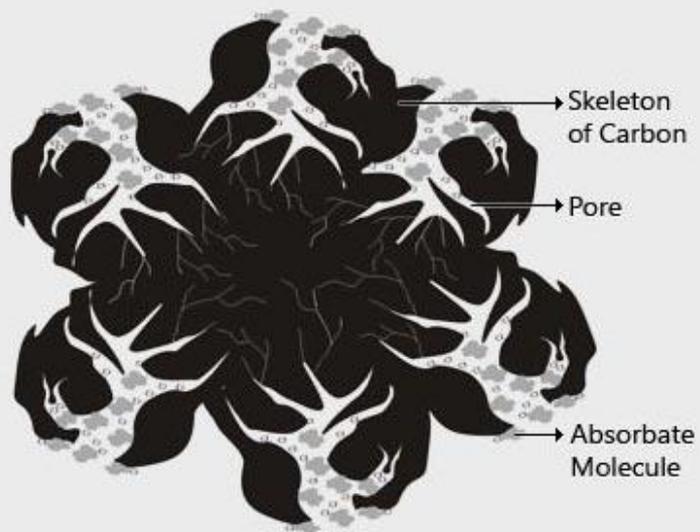

**Activated Carbon adsorbs
gases and chemicals**

Carbon Adsorber

- **General description**
 - **Gas molecules stick to the surface of a solid**
 - **Activated carbon often used as it**
 - **Has a strong attraction for organics**
 - **Has a large capacity for adsorption (many pores)**
 - **Relatively inexpensive**

Carbon Adsorber

- **Activated Carbon is typically made of charcoal**
 - Wood
 - Coal
 - Nutshells
 - Coconut shells
- **Other Common Types of Adsorbers**
 - Silica gel
 - Activated alumina
 - Zeolites


Carbon Adsorber


- **3 types – fixed bed (most common), moving bed, and fluidized bed**
 - Typically appear in pairs – prevent carbon breakthrough
 - Used for control as well as recovery

Carbon Adsorber

- **General description (continued)**
 - **Regeneration process**
 - **Steam**
 - **Hot gas**
 - **Vacuum**
 - **Work best if molecular weight of compound between 50 & 200 (depends on source of carbon raw material)**


Carbon Adsorber – Fixed Bed Schematic

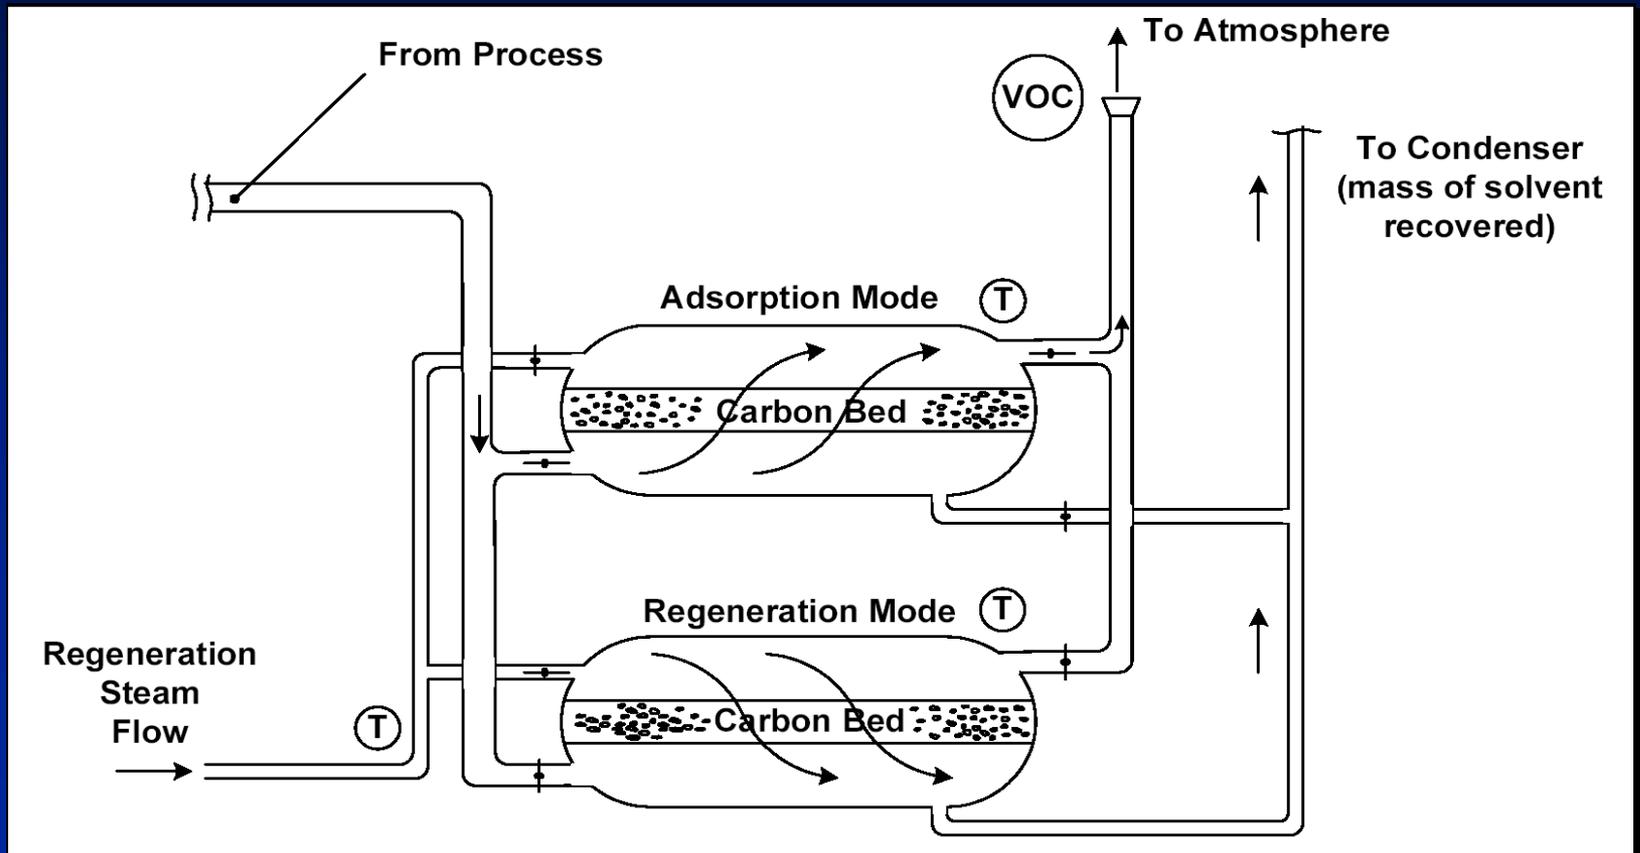

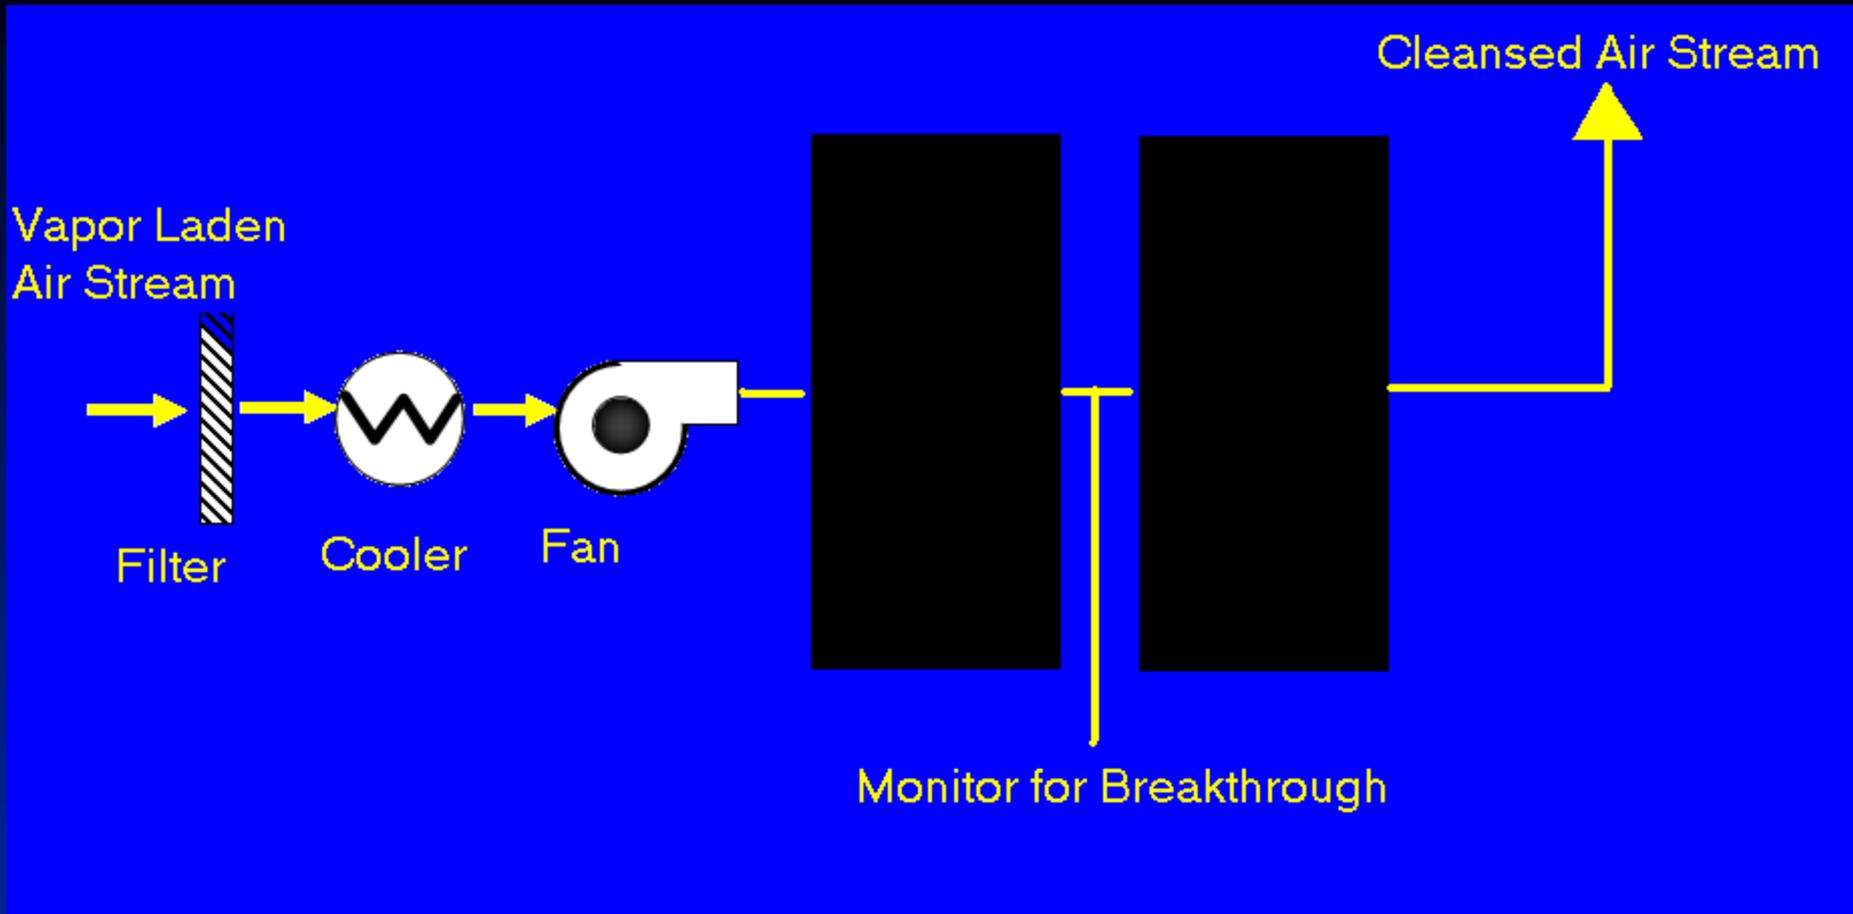

Carbon Adsorption System

Adsorber Breakthrough

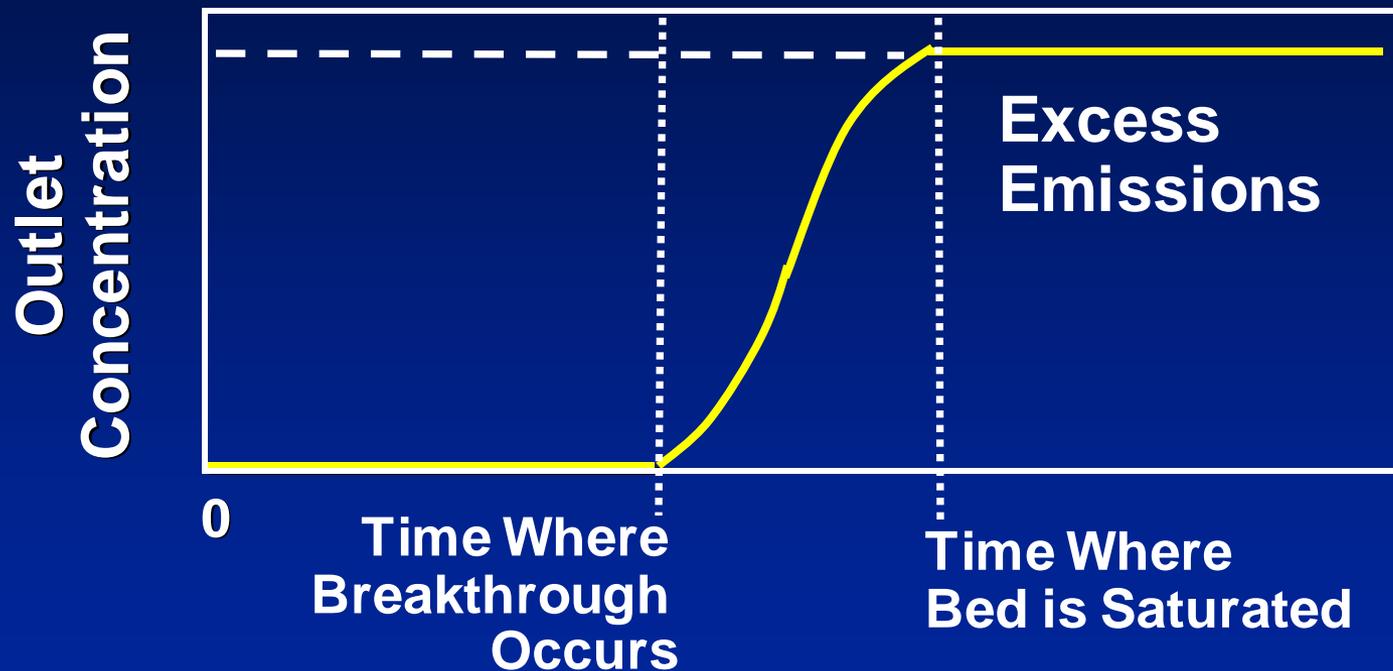

Carbon Adsorber

- **Factors affecting efficiency**
 - **Presence, polarity, and concentration of specific compounds**
 - **Flow rate & channeling**
 - **Temperature & fouling**
 - **Relative humidity**

Carbon Adsorber

- **Performance indicators**
 - **Outlet VOC concentration**
 - **Regeneration cycle timing or bed replacement frequency**
 - **Total regeneration stream flow or vacuum profile during regeneration cycle**
 - **Bed operating and regeneration temperature**

Carbon Adsorber

- **Performance indicators**
 - **Inlet gas temperature**
 - **Gas flow rate**
 - **Inlet VOC concentration**
 - **Pressure differential**
 - **Inlet gas moisture content**
 - **Leaks**

Carbon Adsorbers at a Soil Remediation Site



Absorber/Condenser/Adsorber Unit at Marketing Terminal



Monitoring Approach – VOC

Indicator	Vacuum	Carbon bed I/M	LDAR
Approach	Pressure transducer	Daily insp. And annual sample	Monthly leak check w. portable analyzer
Indicator range	<2.5 min @ - 27.5" Hg, shutdown	Failure to conduct, corrective action and reporting	> 10K ppm, corrective action and reporting

Monitoring Approach – VOC

Indicator	Vacuum	Carbon bed I/M	LDAR
Measuring location	Pump suction line	Visual, bed sample	Handheld monitor
QA/QC	Annual cal.	Training	Method 21
Frequency	Continuous during cycle	Daily and annual	Monthly




**VOC Control via
Incineration in Oxidizers**

Combustion Considerations

Remember the 3 T's of Combustion


- Residence Time
- Temperature
- Turbulence (mixing)
- Increase 3T's = more NO_x
- Decrease 3T's = more CO and uncontrolled pollutant

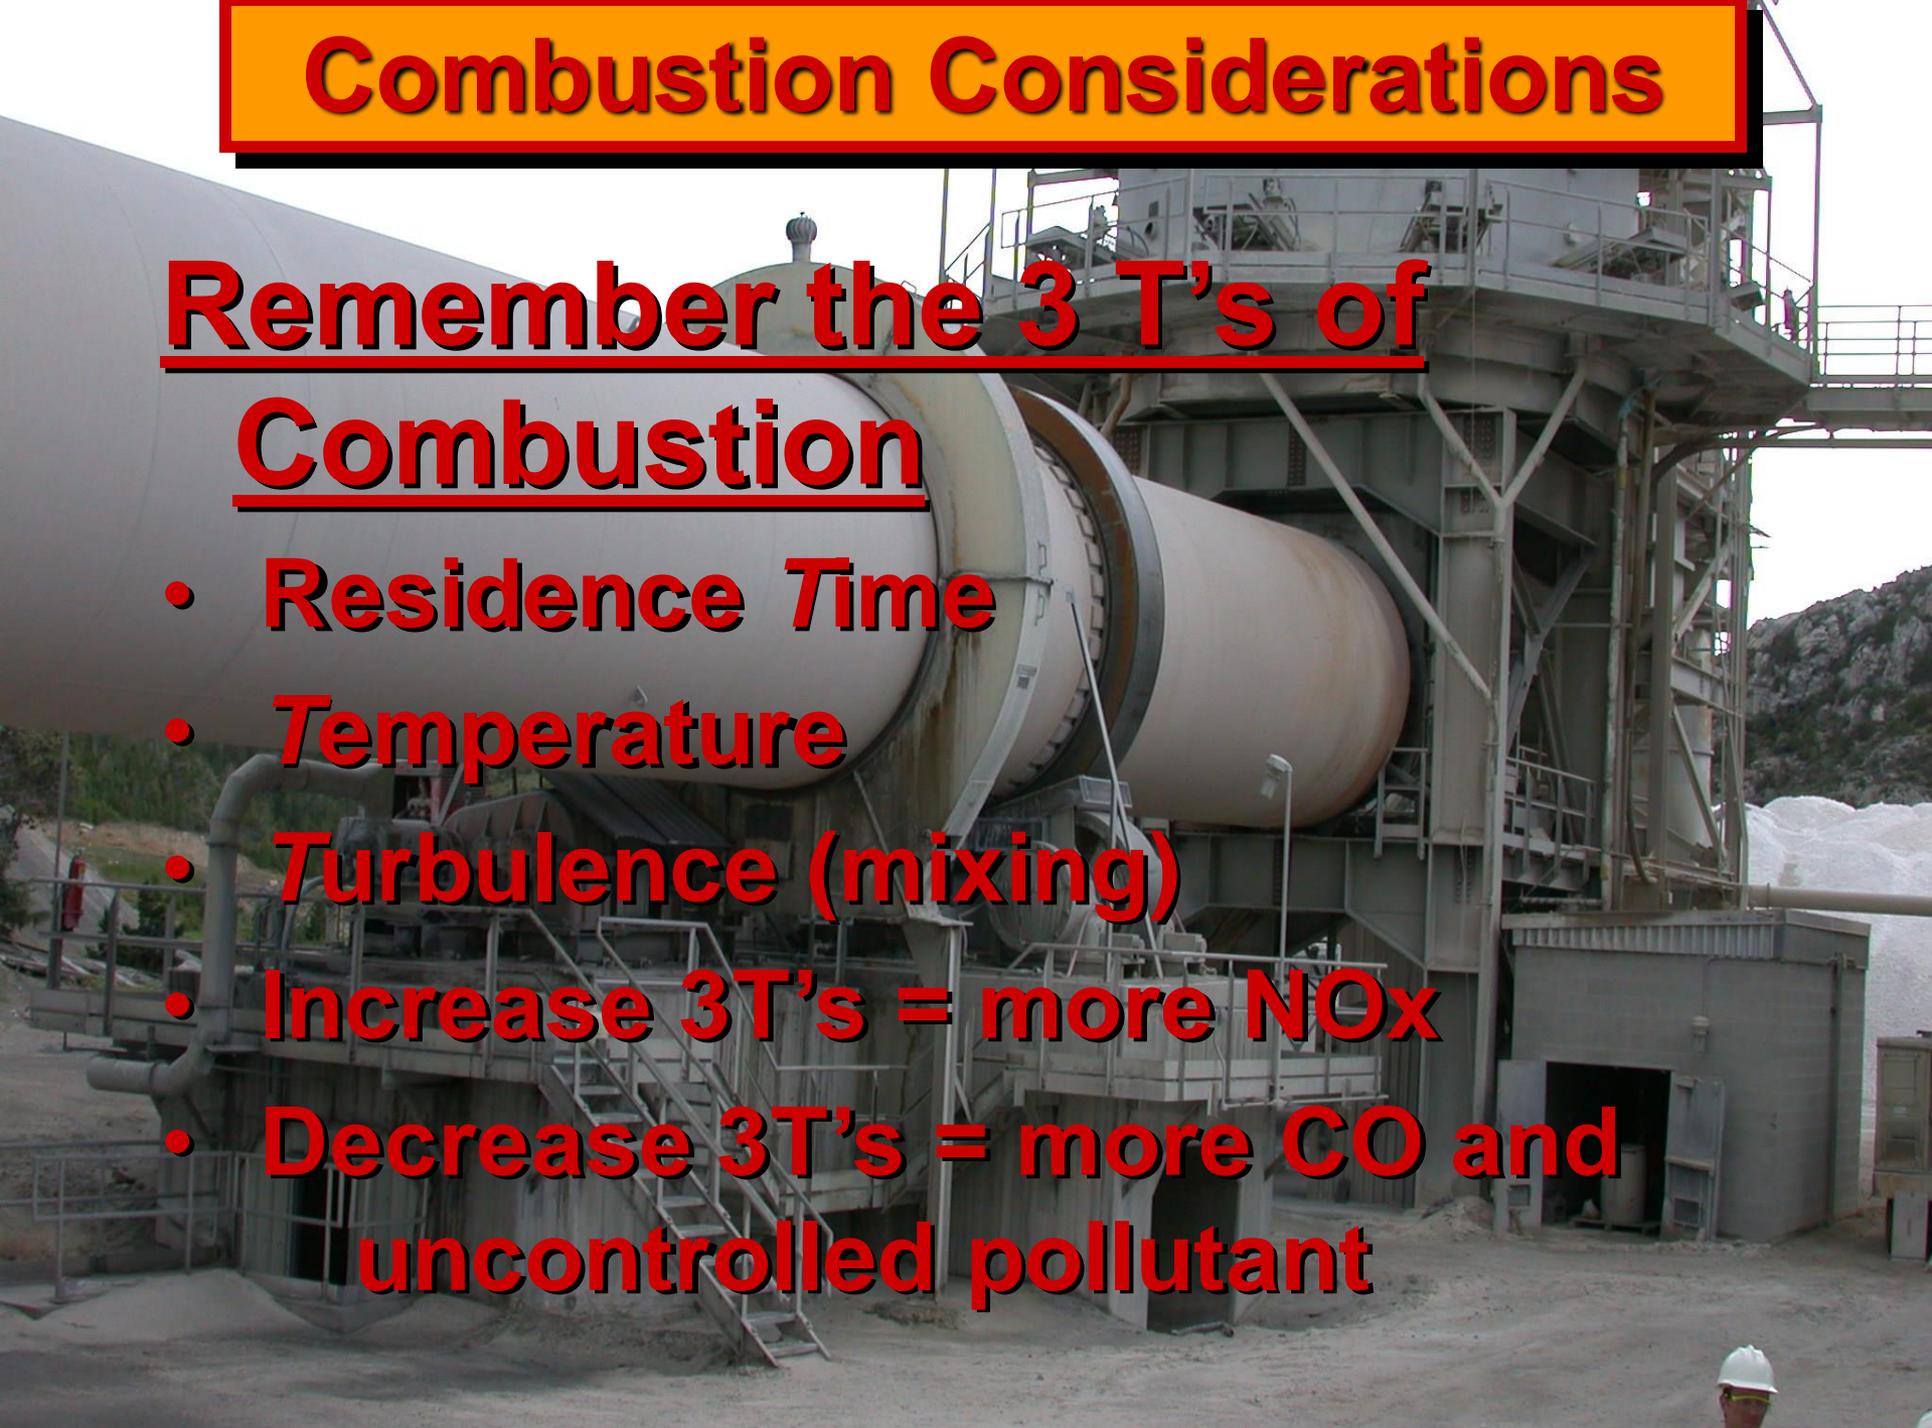

Thermal Oxidizer



Thermal Oxidizer/Afterburner

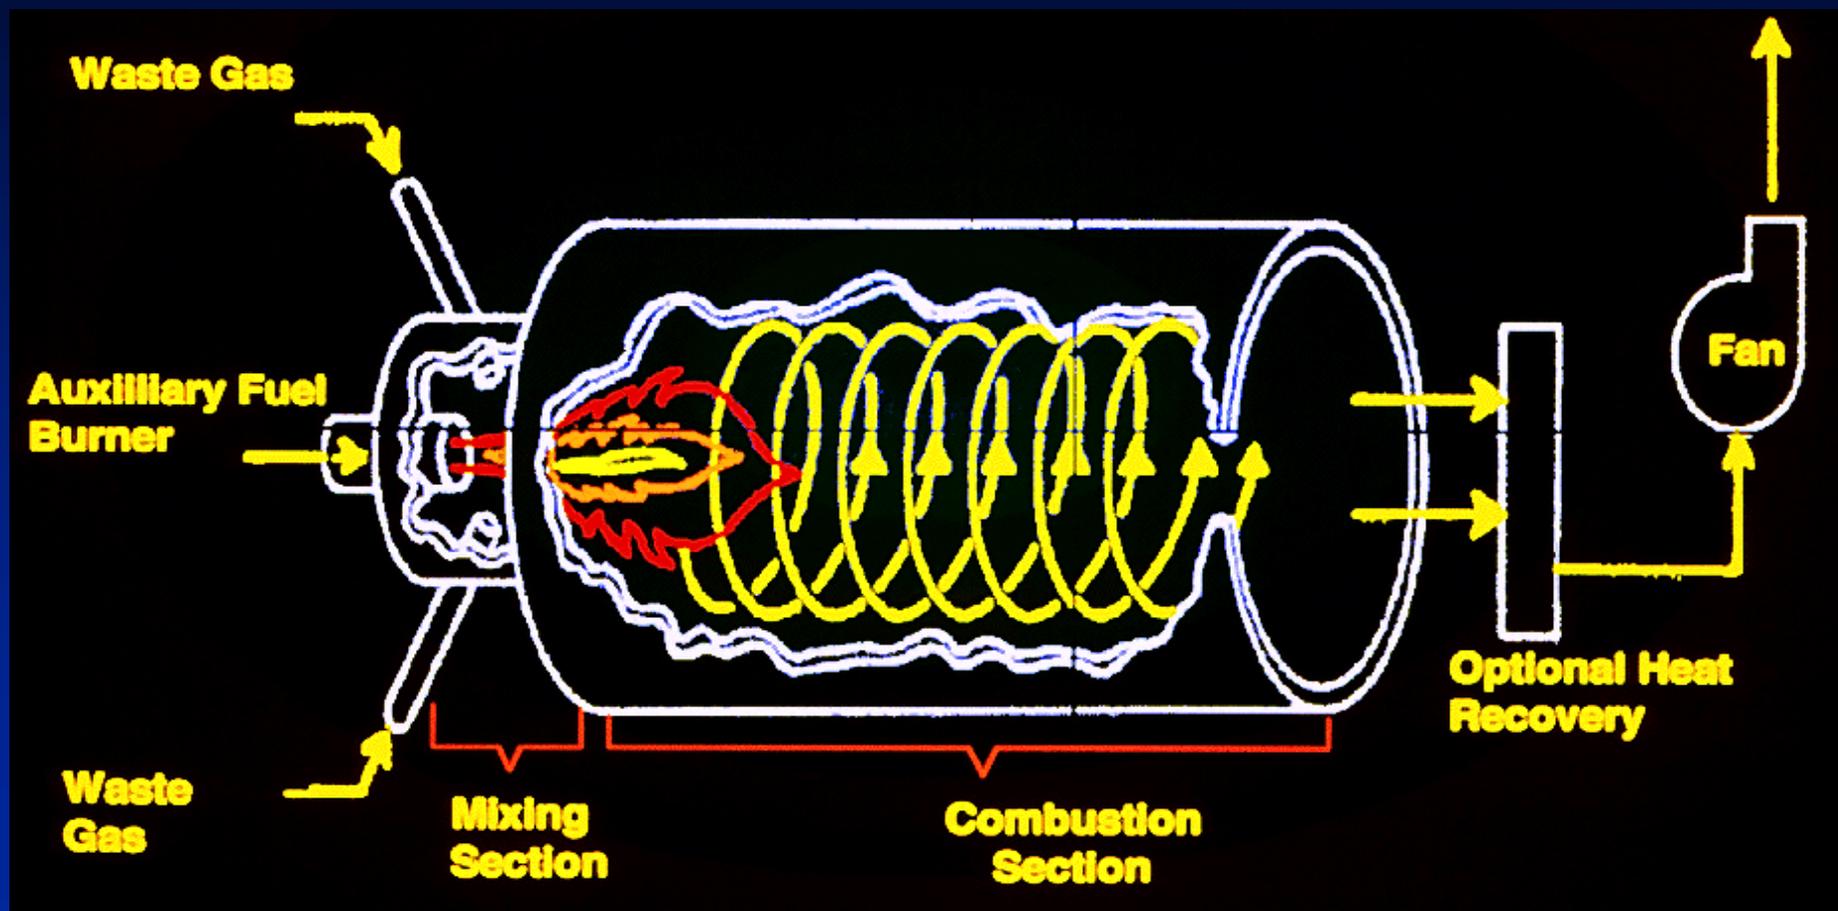

Thermal Oxidizer

- **General description**
 - VOC gas (& organic HAP) gets oxidized to H_2O and CO_2
 - Higher operating temperatures (~1400°F to 1800°F)
 - Typically requires auxiliary fuel (natural gas or propane)


Thermal Oxidizer

- **Good combustion requires**
 - **Adequate temperature**
 - **Turbulent mixing of waste gas with oxygen**
 - **Sufficient time for reactions to occur**
 - **Enough O₂ to completely combust waste gas**

Thermal Oxidizer

- **Only temperature and O₂ can be controlled after construction**
 - **Waste gas has to be heated to autoignition temperature**
 - **Common design relies on 0.2 to 2 seconds residence time, 2 to 3 length to diameter ratio, and gas velocity of 10 to 50 feet per second**

Thermal Oxidizer - Schematic

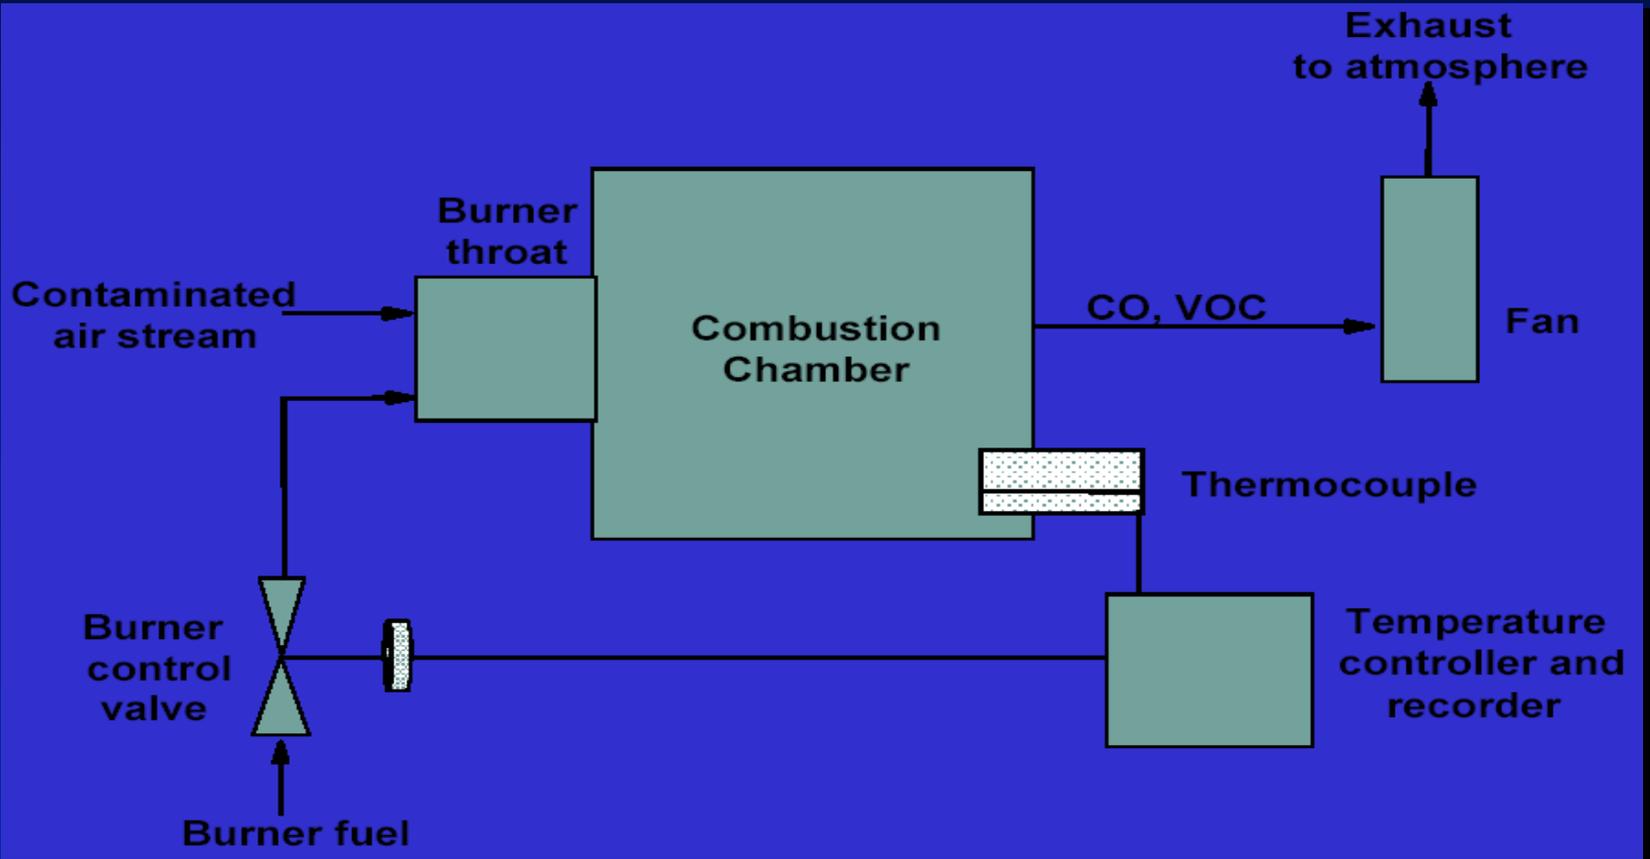


- **Factors affecting efficiency**

- **Waste gas flow rate**

- **Waste gas composition and concentration**

- **Waste gas temperature**

- **Amount of excess air**

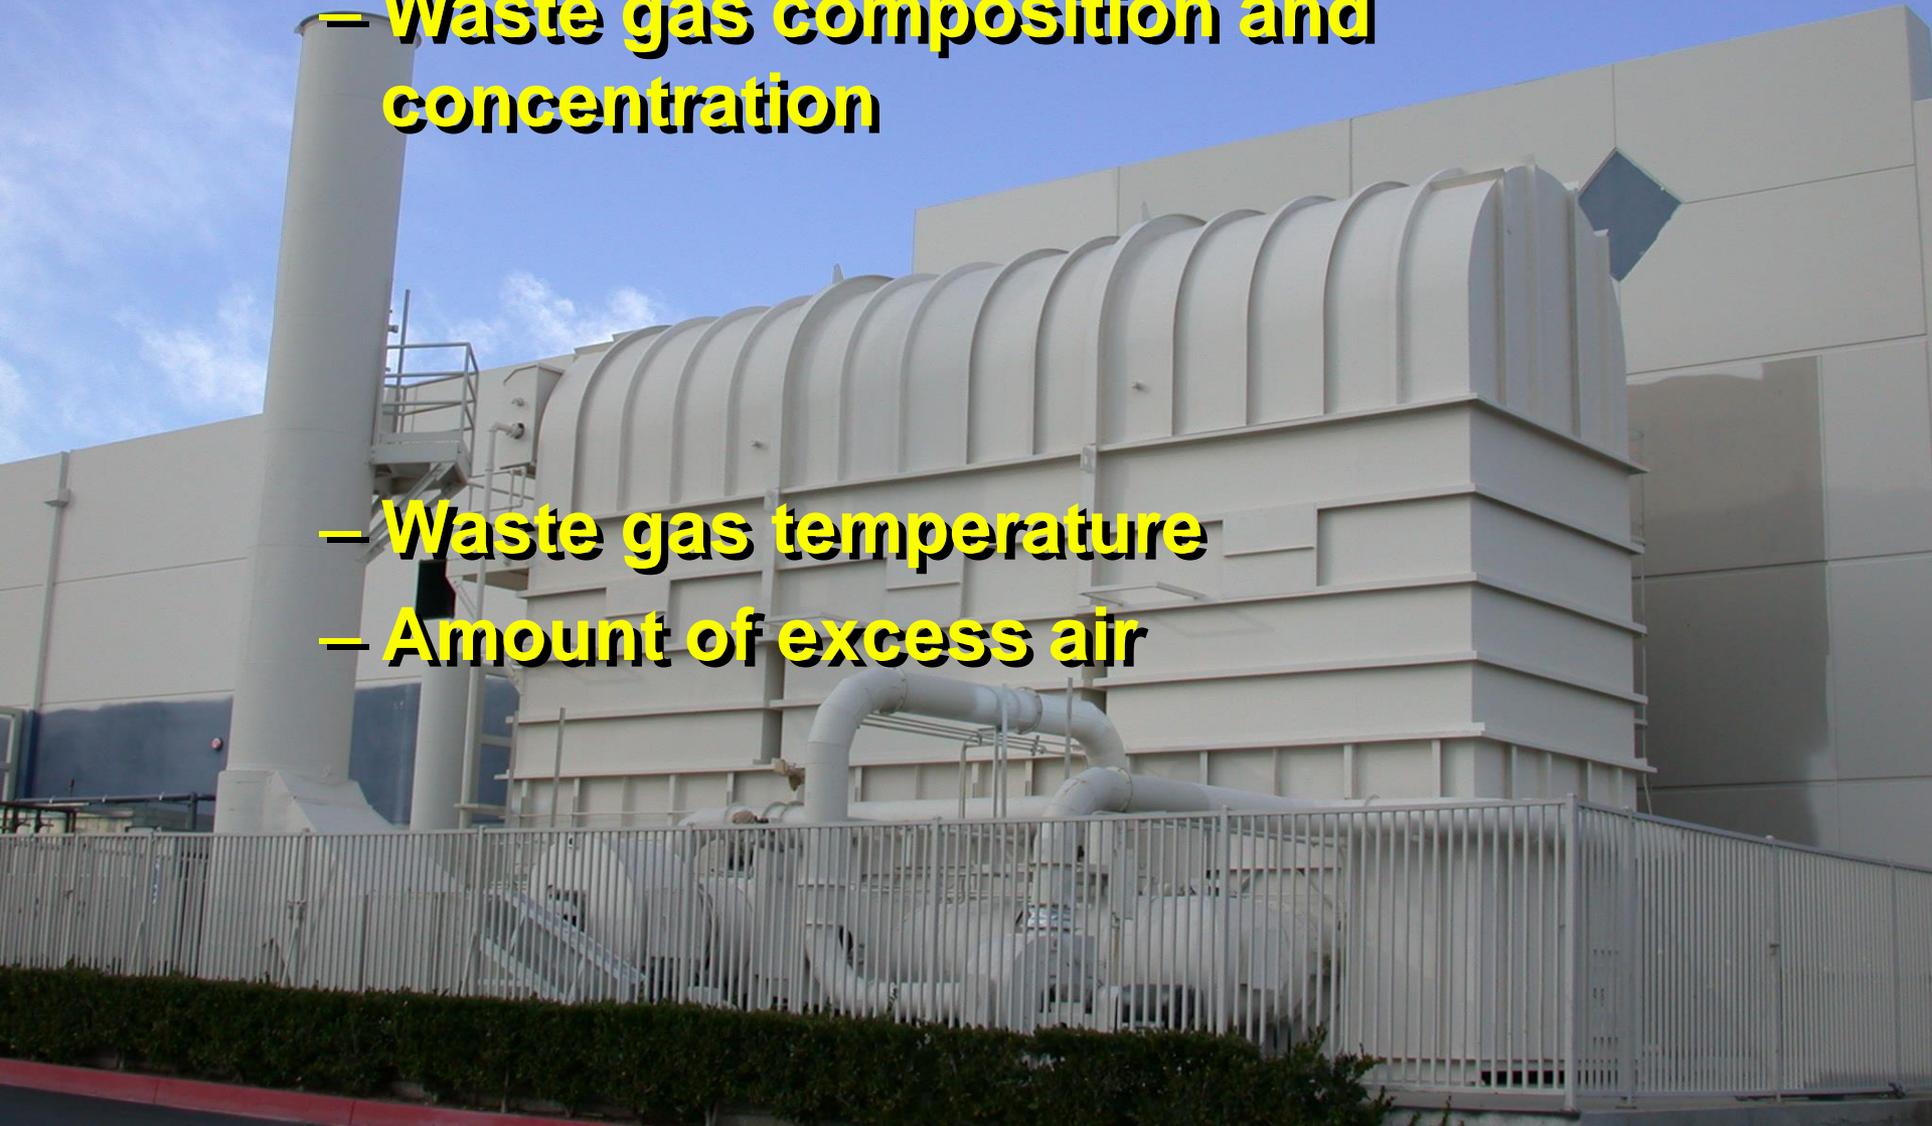

COMBUSTION FAN
DIFFERENTIAL PRESSURE
INDICATOR
PDI13




Oxidizer Performance Indicator

Thermal Oxidizer

- **Performance indicators**
 - **Outlet VOC concentration**
 - **Outlet combustion temperature**
 - **Outlet CO concentration**
 - **Exhaust gas flow rate**
 - **Outlet O₂ concentration**
 - **Inspections**

Catalytic Oxidizer/Incinerator

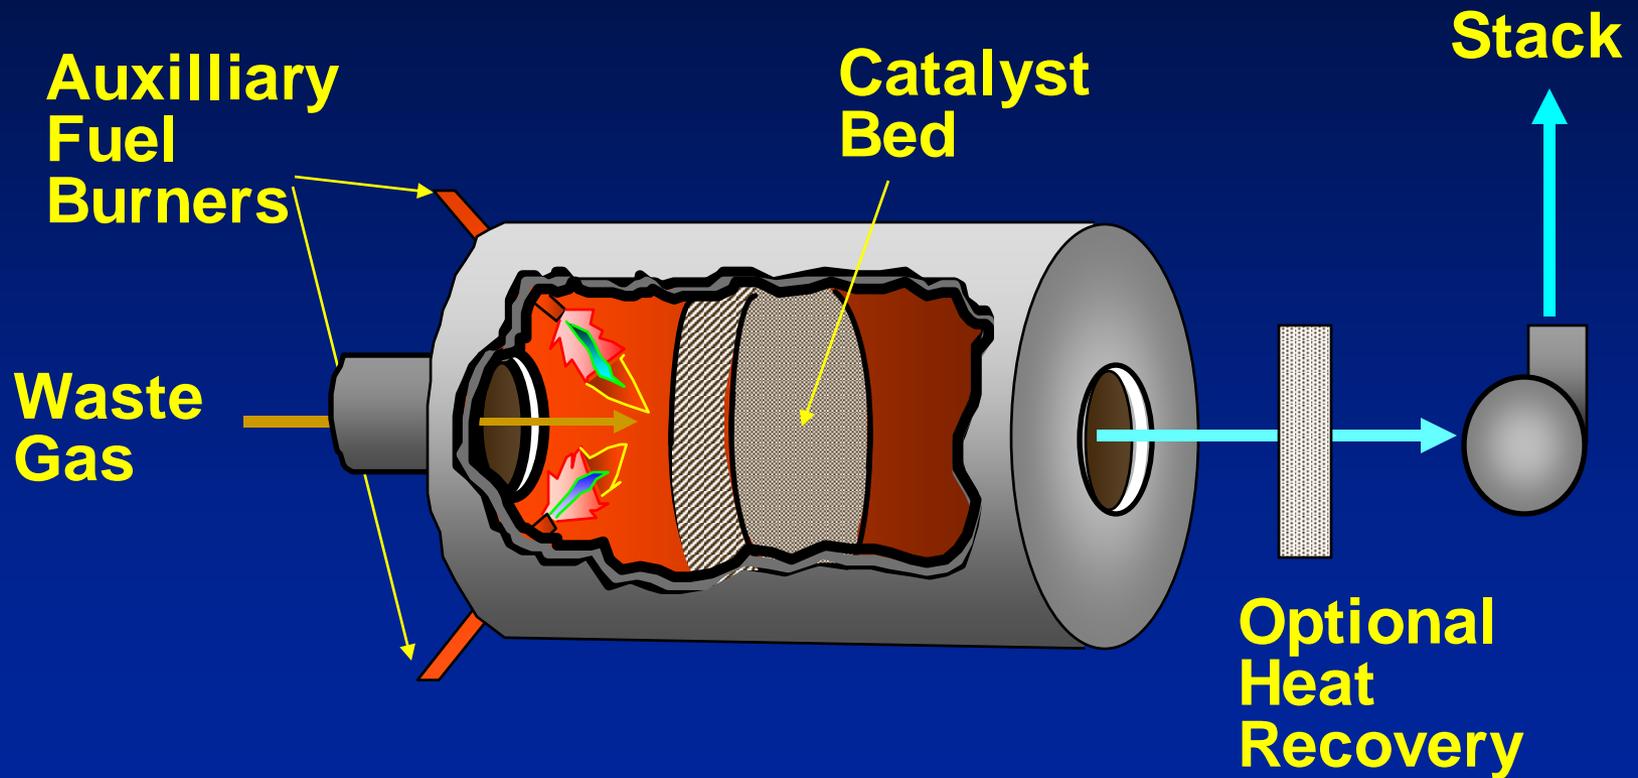

Catalytic Oxidizer/Incinerator

- **General description**
 - VOC gas (& organic HAP) gets oxidized to H_2O and CO_2
 - Catalyst causes reaction to occur faster and at lower temperatures
 - Saves auxiliary fuel


Catalytic Oxidizer/Incinerator

- **General description (continued)**
 - Catalysts allow lower operation temperatures (~ 600°F to 800°F)
 - Catalyst bed generally lasts from 2 to 5 years
 - Thermal aging, poisoning, and masking are concerns


Catalytic Oxidizer/Incinerator


- **General description (continued)**
 - **Excess air is added to assist combustion**
 - **Residence time and mixing are fixed during design**
 - **Only temperature and oxygen can be controlled after construction**

Catalytic Oxidizer Incinerator Examples

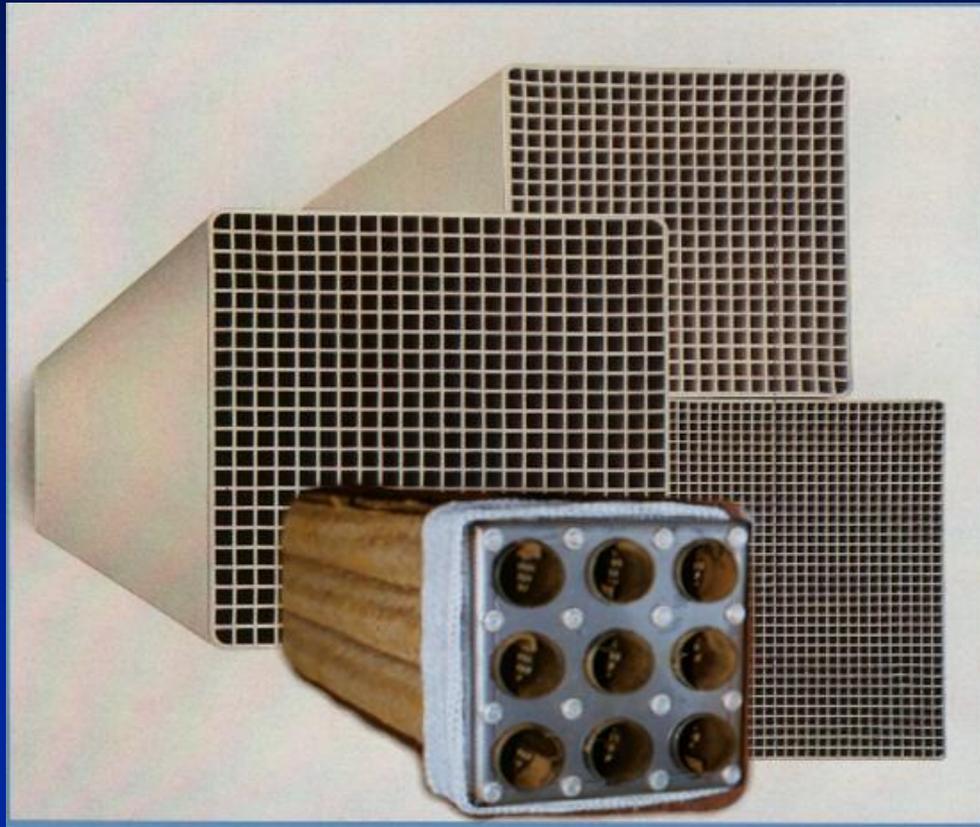

Catalytic Oxidizer Incinerator Schematic

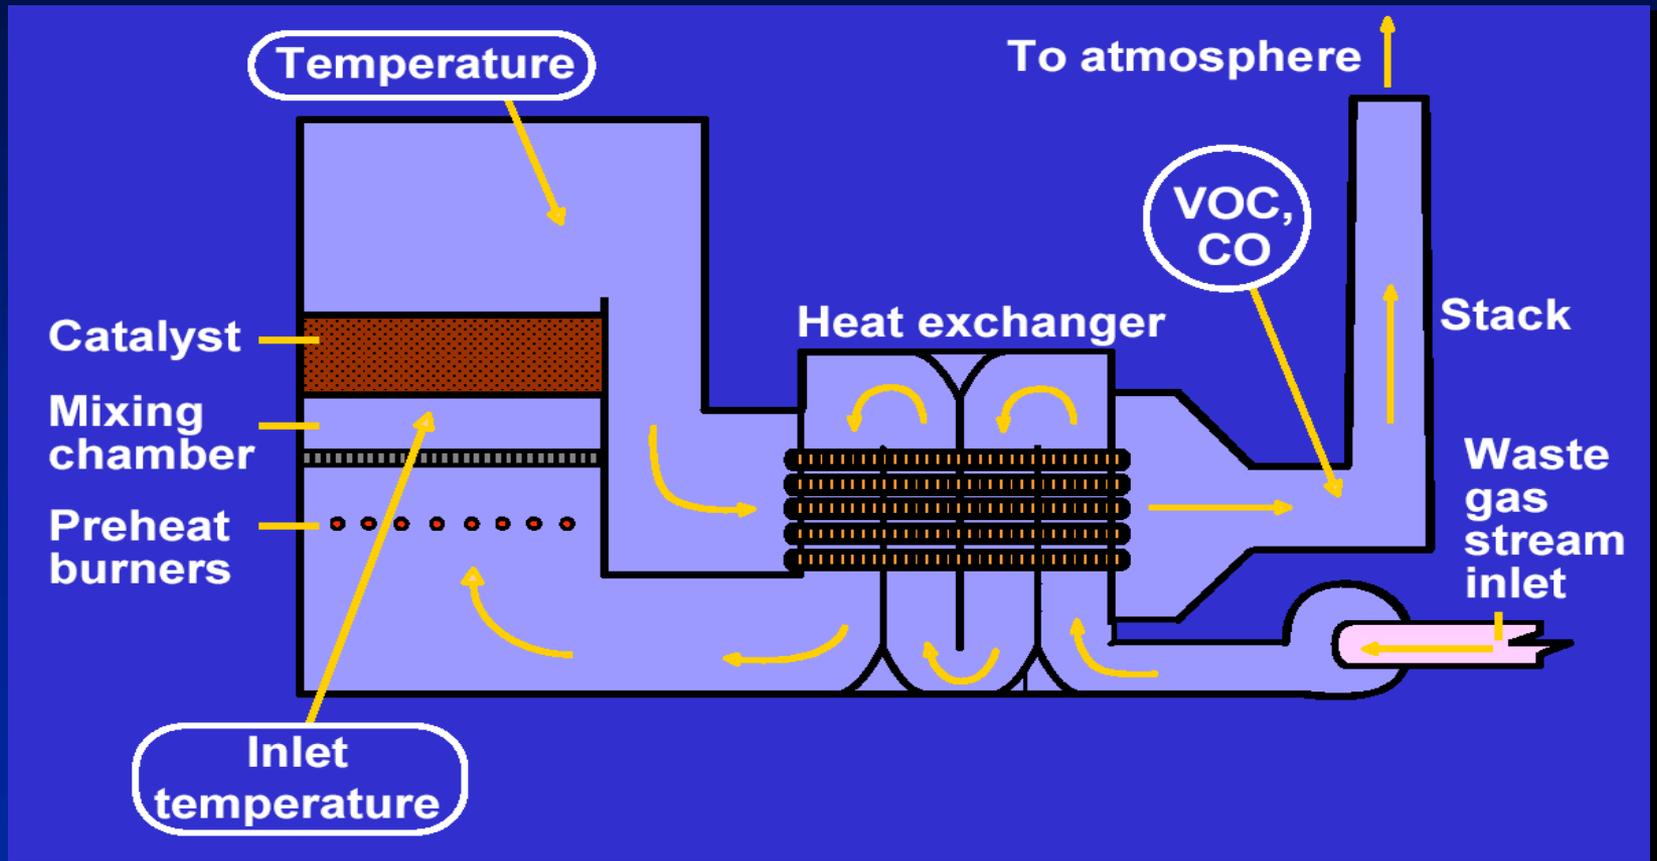

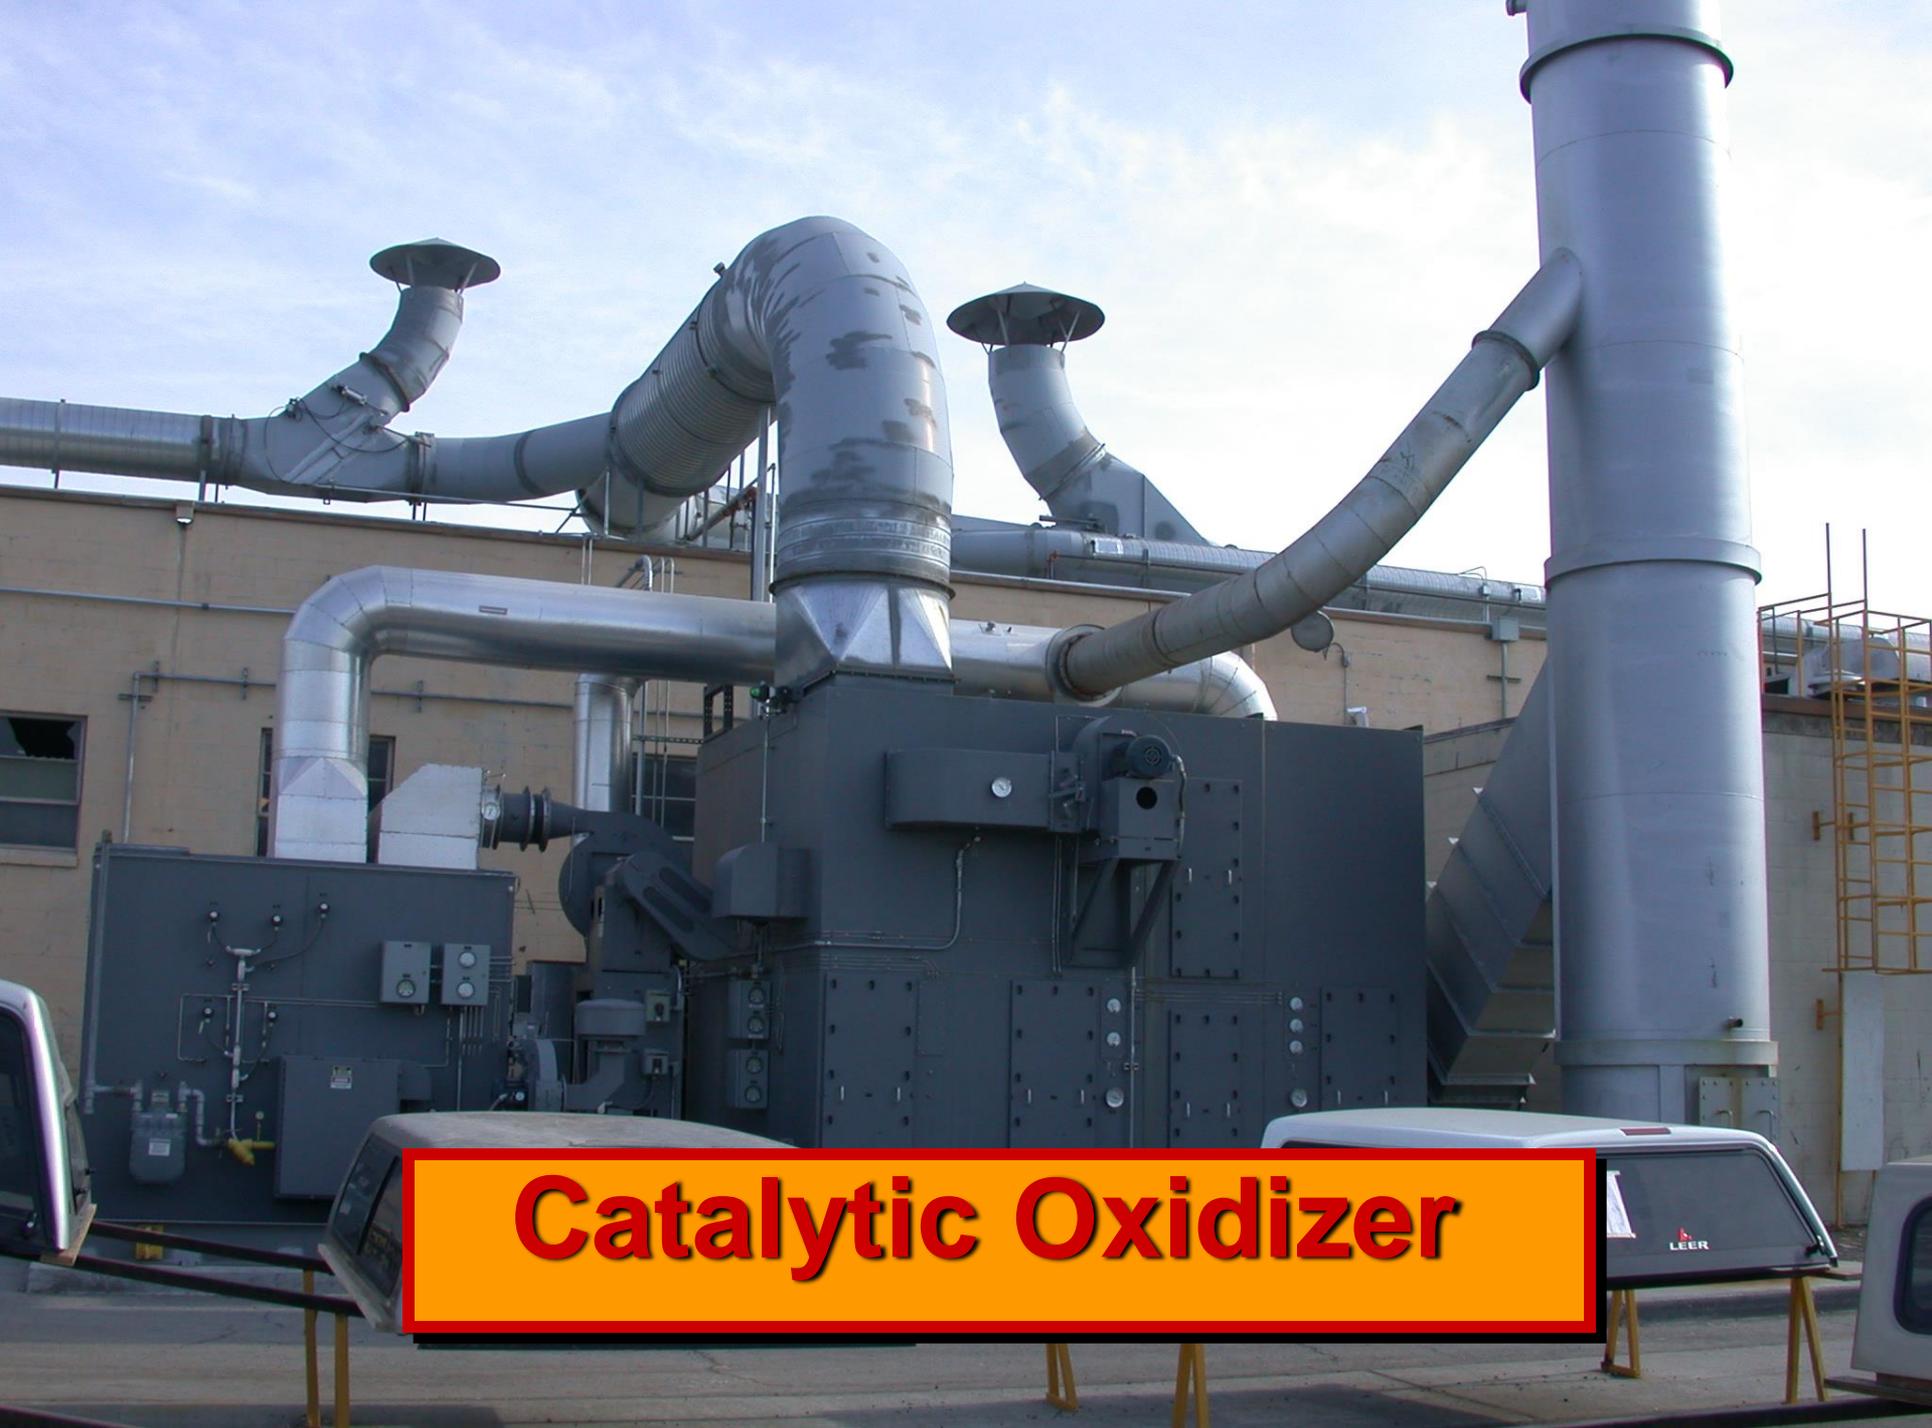

Catalytic Oxidizer

Catalytic Oxidizer/Incinerator

- **Factors affecting efficiency**
 - **Pollutant concentration**
 - **Flow rate**
 - **Operating temperature**
 - **Excess air**
 - **Waste stream contaminants**
 - **Metals, sulfur, halogens, plastics**

Catalytic Oxidizer/Incinerator

- **Performance Indicators**
 - **Outlet VOC concentration**
 - **Catalyst bed inlet temperature**
 - **Catalyst activity**
 - **Outlet CO concentration**
 - **Temperature rise across catalyst bed**
 - **Exhaust gas flow rate**

Catalytic Oxidizer/Incinerator


- **Performance Indicators (continued)**
 - Catalyst bed outlet temperature
 - Fan current
 - Outlet O₂ or CO₂ concentration
 - Pressure differential across catalyst bed

Catalytic Oxidizer – Monitoring Approach

- **Key Factors to Consider When Monitoring a Catalytic Oxidizer:**
 - **Catalyst bed operating temperature (inlet & outlet)**
 - **Catalyst activity (life) (core sampling & testing)**
 - **Periodic Inspection**
 - **Annual performance testing**

Catalytic vs. Thermal for VOC Control

Catalytic	Thermal
Lower Operating Temp. & Lower Fuel Usage	Higher Operating Temp. & Higher Fuel Usage
Higher Capital & Maintenance Costs	Lower Capital & Maintenance Costs
Catalyst Fouling & Poisoning	No Catalyst Involved Here

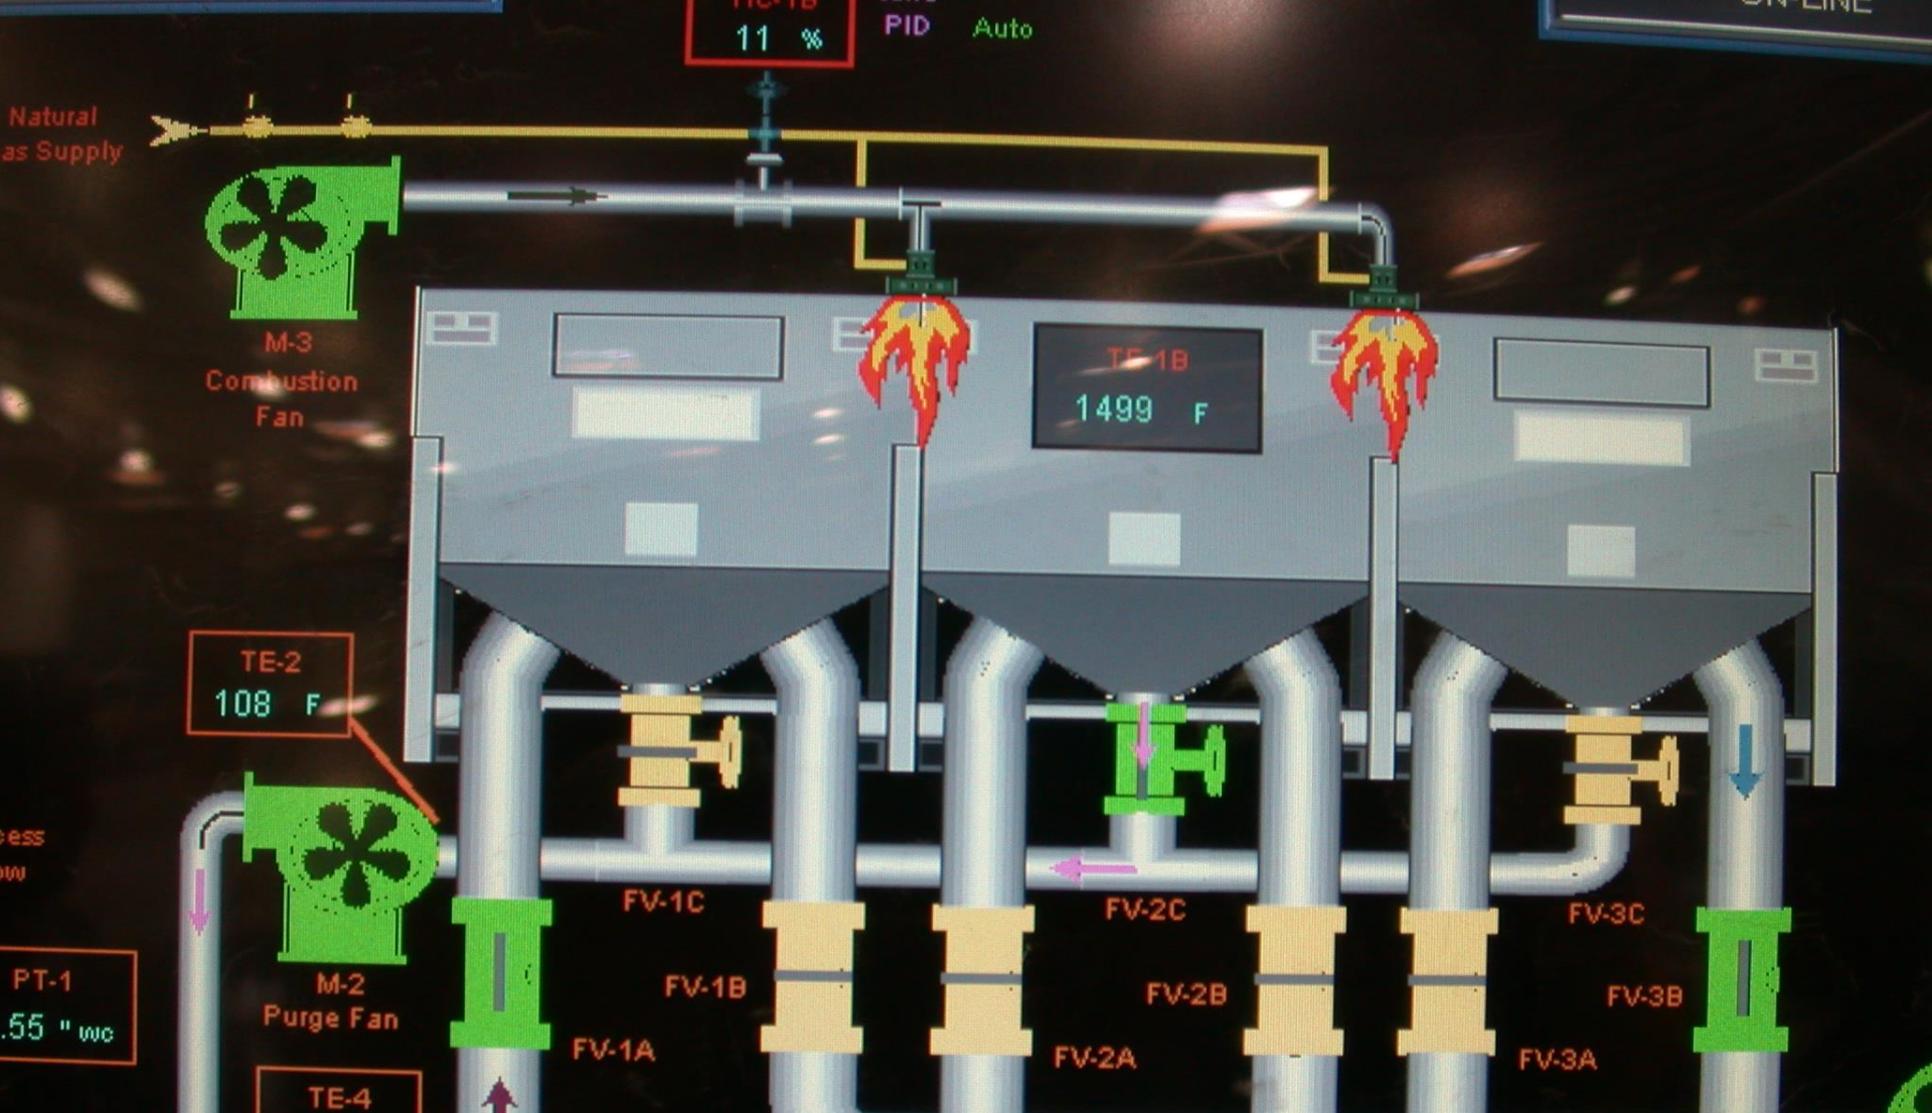


Heat Exchangers (Thermal and Catalytic Oxidizers)

Thermal & Catalytic Oxidizer Heat Exchangers

There are two basic types of heat exchangers used for thermal or catalytic oxidizers

- Metal Heat Exchangers or “recuperative heat exchangers”**
- Ceramic Bed Heat Exchangers or “regenerative heat exchangers”**


Recuperative TO

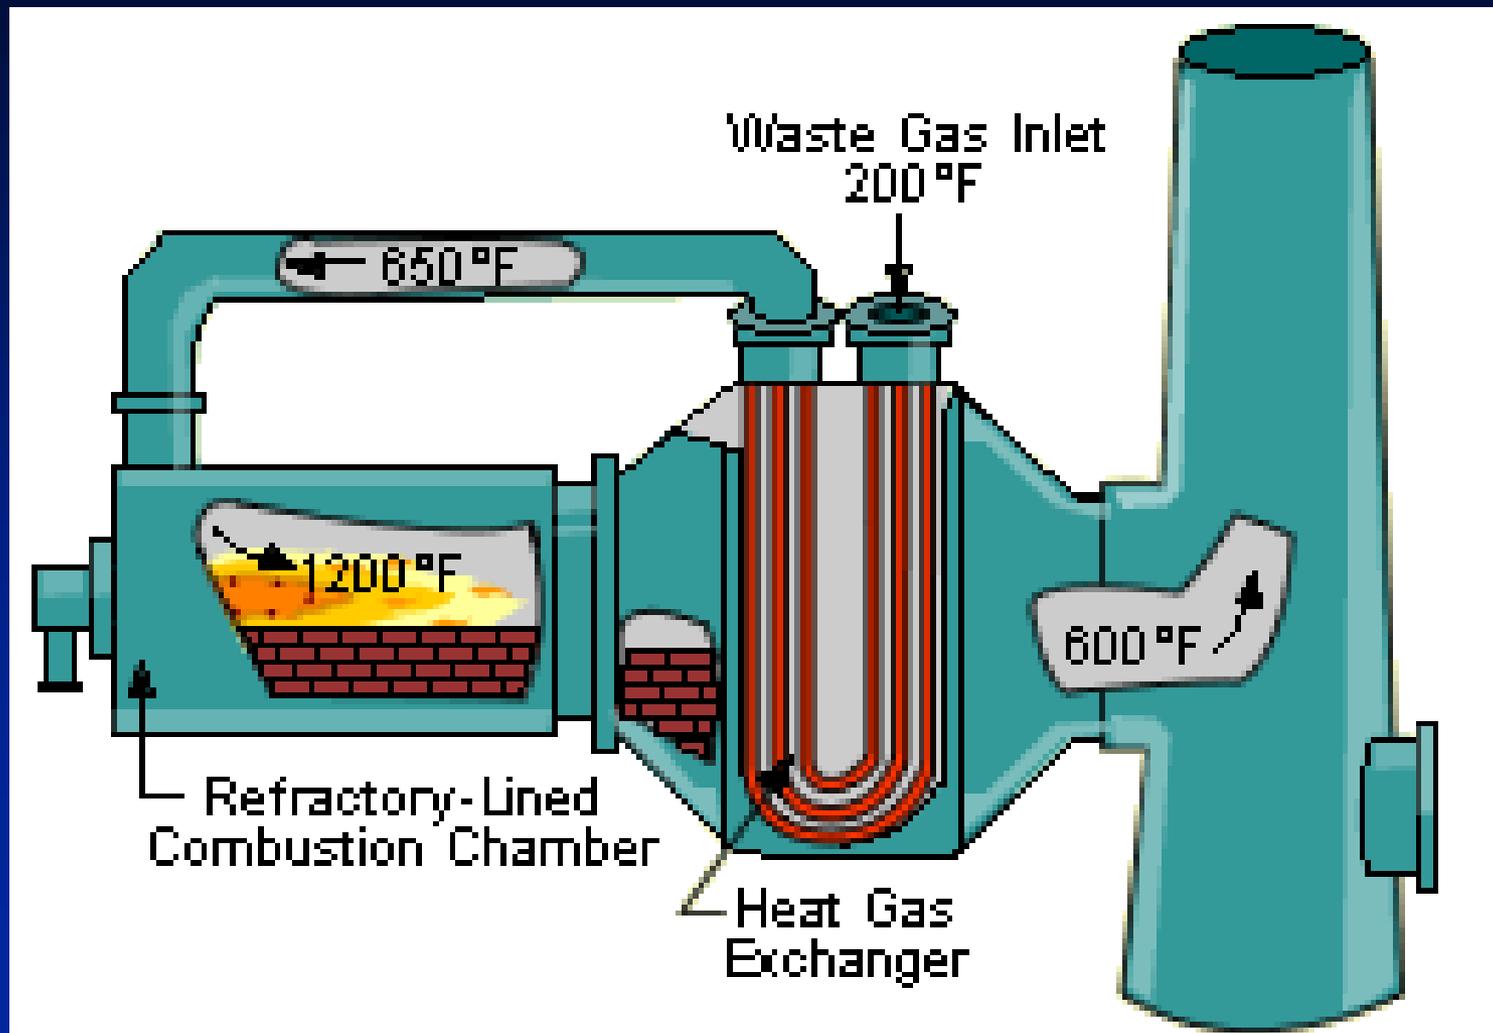

TO with Recuperative Heat Exchangers

- **Thermal efficiency range of 30% to 70%**
- **Shell & tube or plate-type**
- **Usually constructed of alloy steel**
- **Welded systems have very low leakage rates when new**
- **Susceptible to cross-leakage as heat exchanger ages**
- **Not typically used with acid gases**
- **Susceptible to thermal shock on startup and shutdown**

Catalytic Recuperative

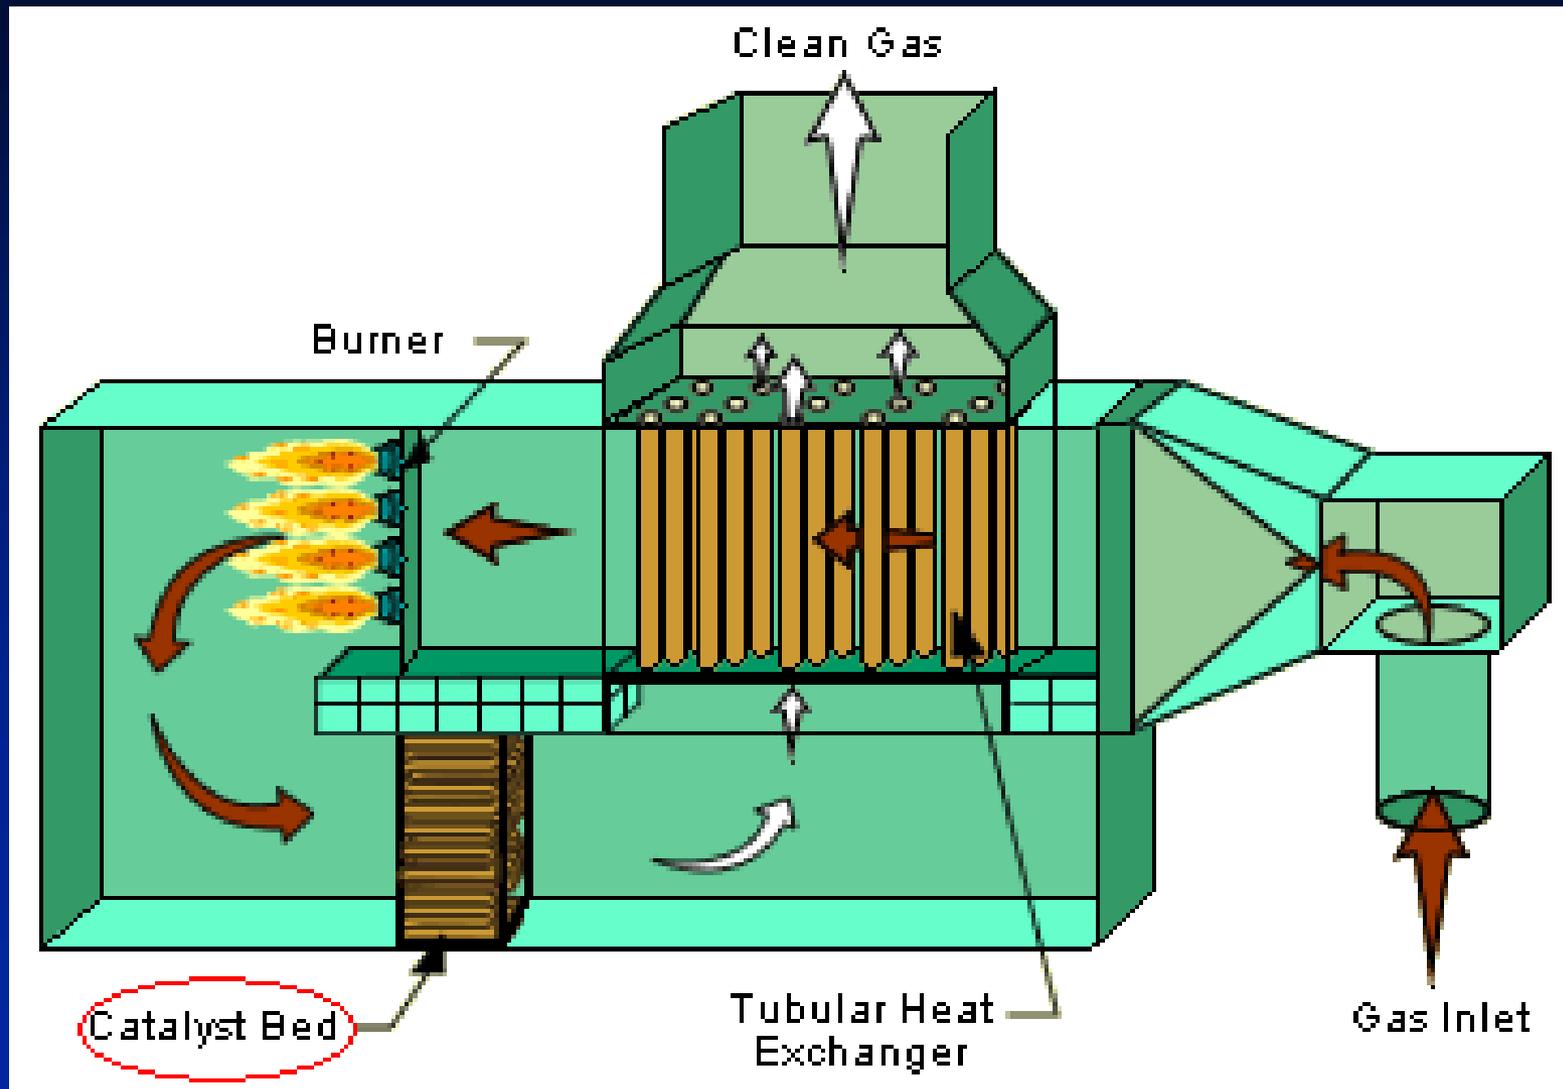


Recuperative TO – Monitoring Approach



- **Key Factors to Consider When Monitoring a Recuperative TO:**
 - **Annual inspection and/or testing of heat exchanger to assess leakage per manufacturer's recommendations.**

Regenerative Thermal Oxidizers




Regenerative TO

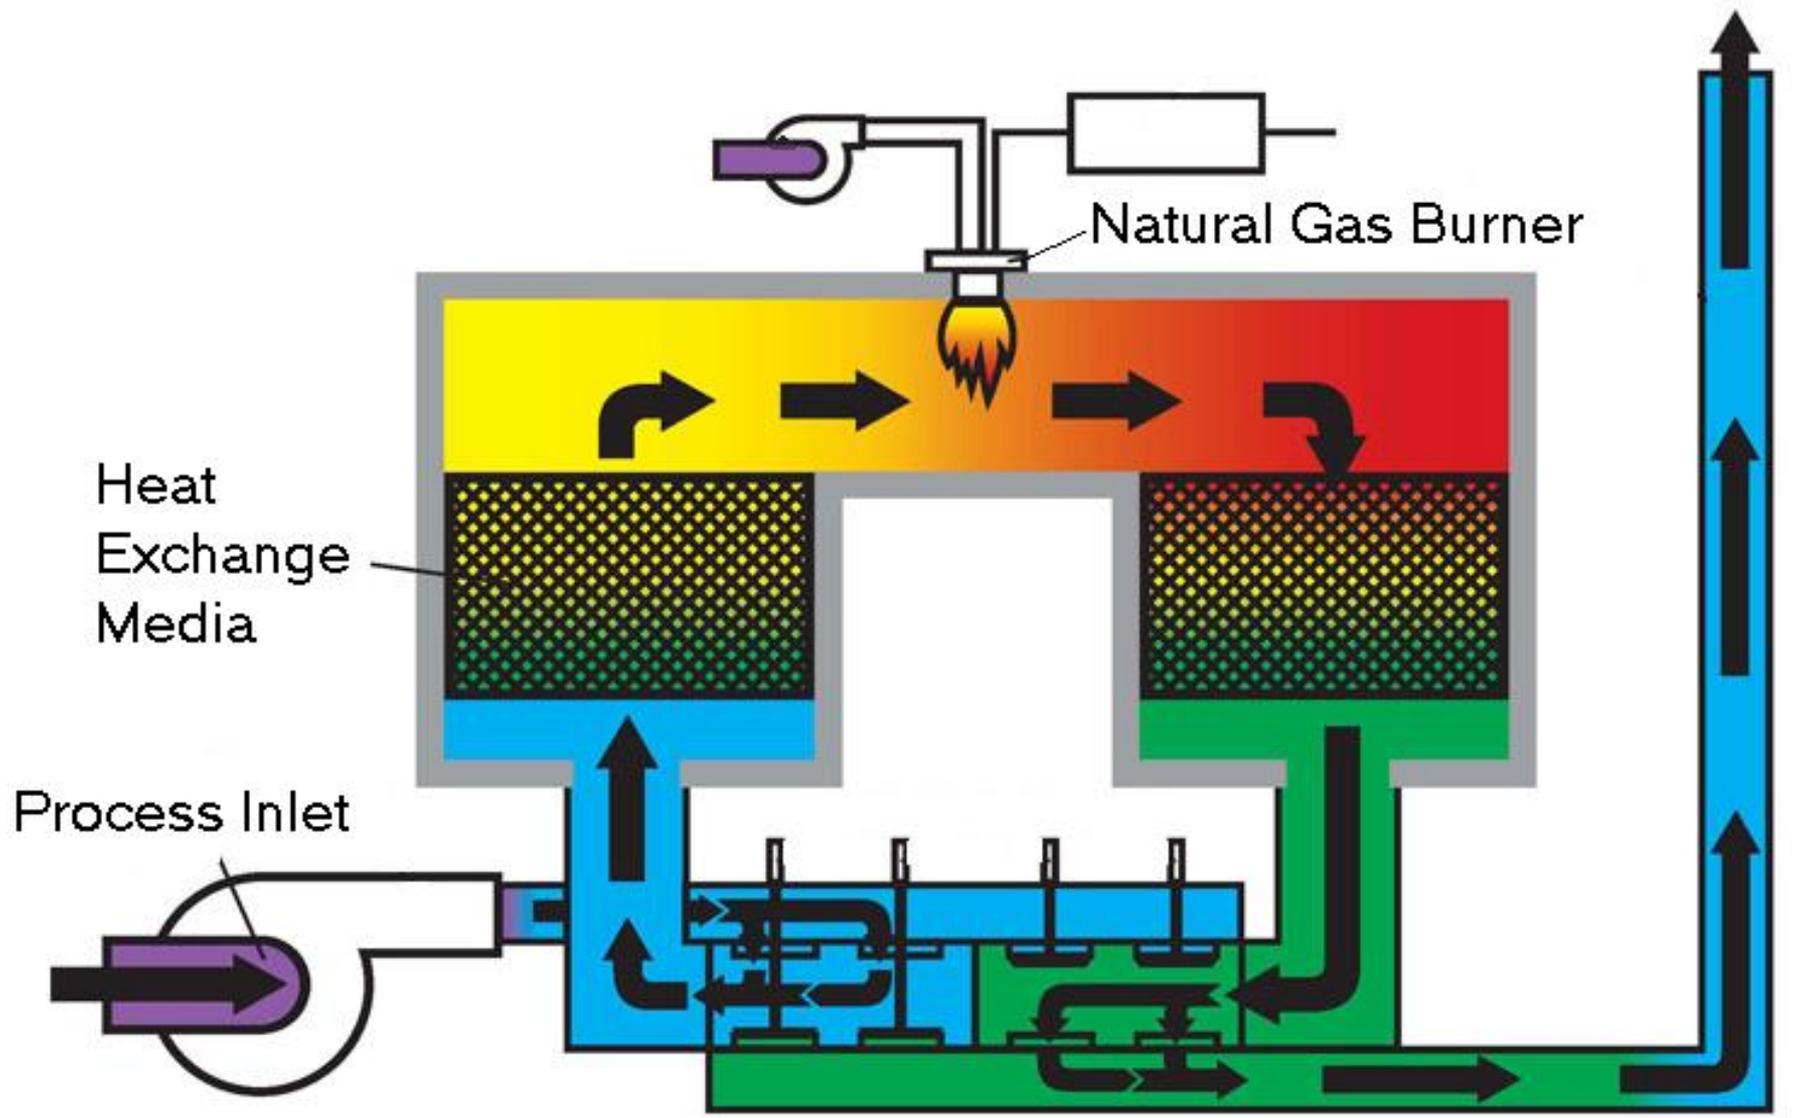

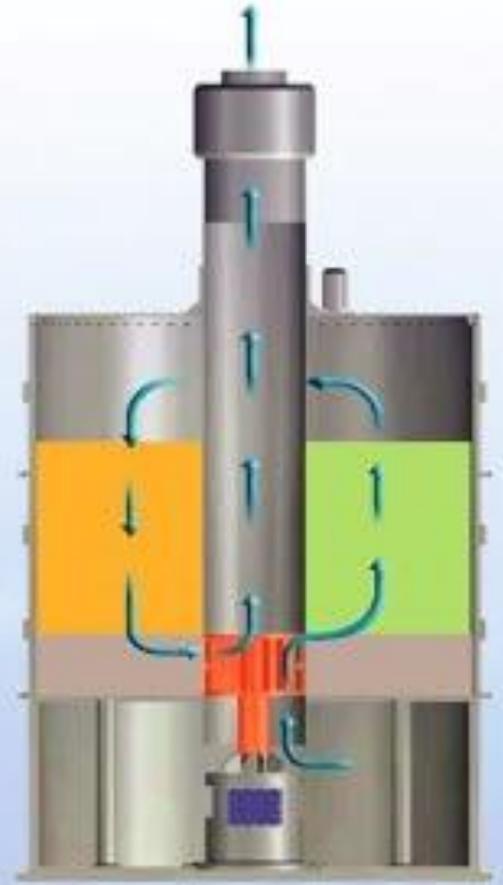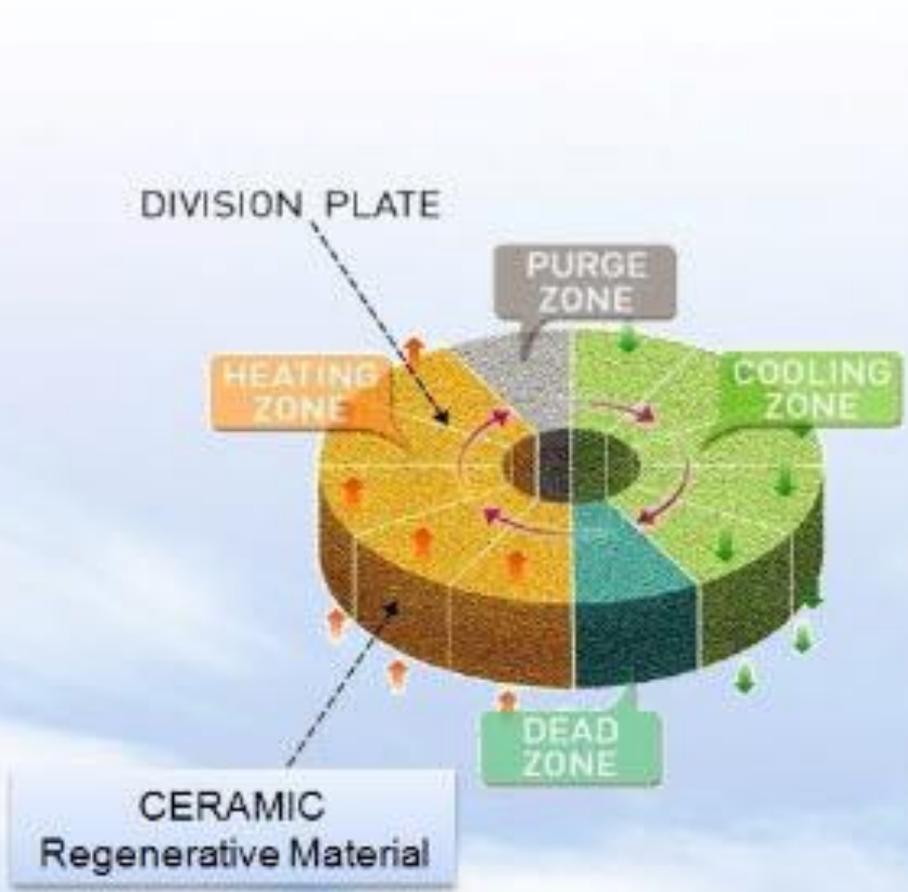

ONE CAN TYPE RTO

Can Type RTO

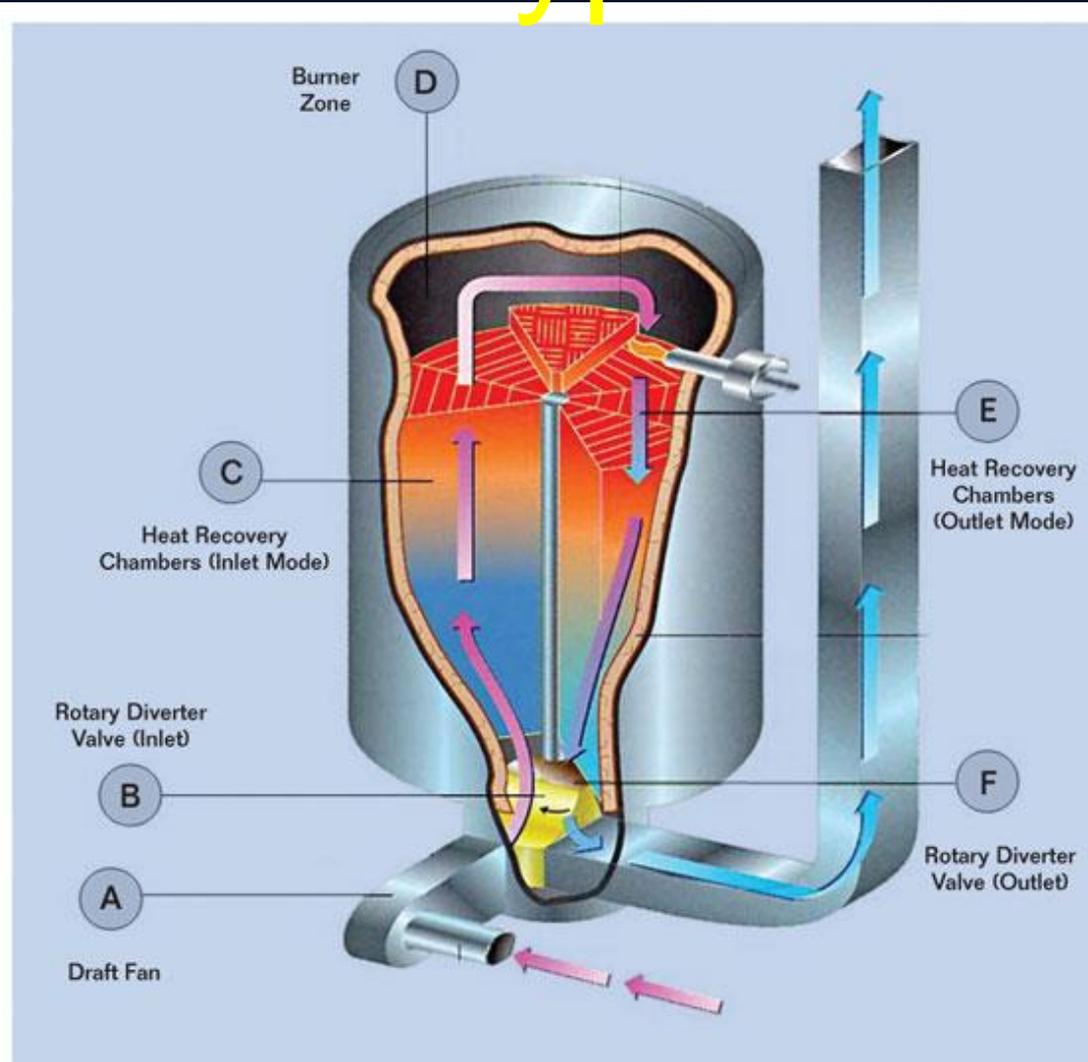


In the regenerative thermal oxidizer, the single rotary valve indexes across an open air path and methodically seals it off by reaching the next set position. A continuous air purge captures any scavenging dirty air in the switch and returns it for treatment in the oxidizer.

Regenerative Thermal Oxidizer (RTO)

- ◆ Thermal efficiency range of 80% to 95%
- ◆ Can be random packing or structured
- ◆ Extremely tolerant of very high temperatures
- ◆ Highly resistant to thermal shock
- ◆ Can resist corrosion by many acid gases
- ◆ May be susceptible to fouling or plugging
- ◆ Subject to cross-leakage because of geometry
- ◆ May be used with catalysts (RCOs)

RTO Operation

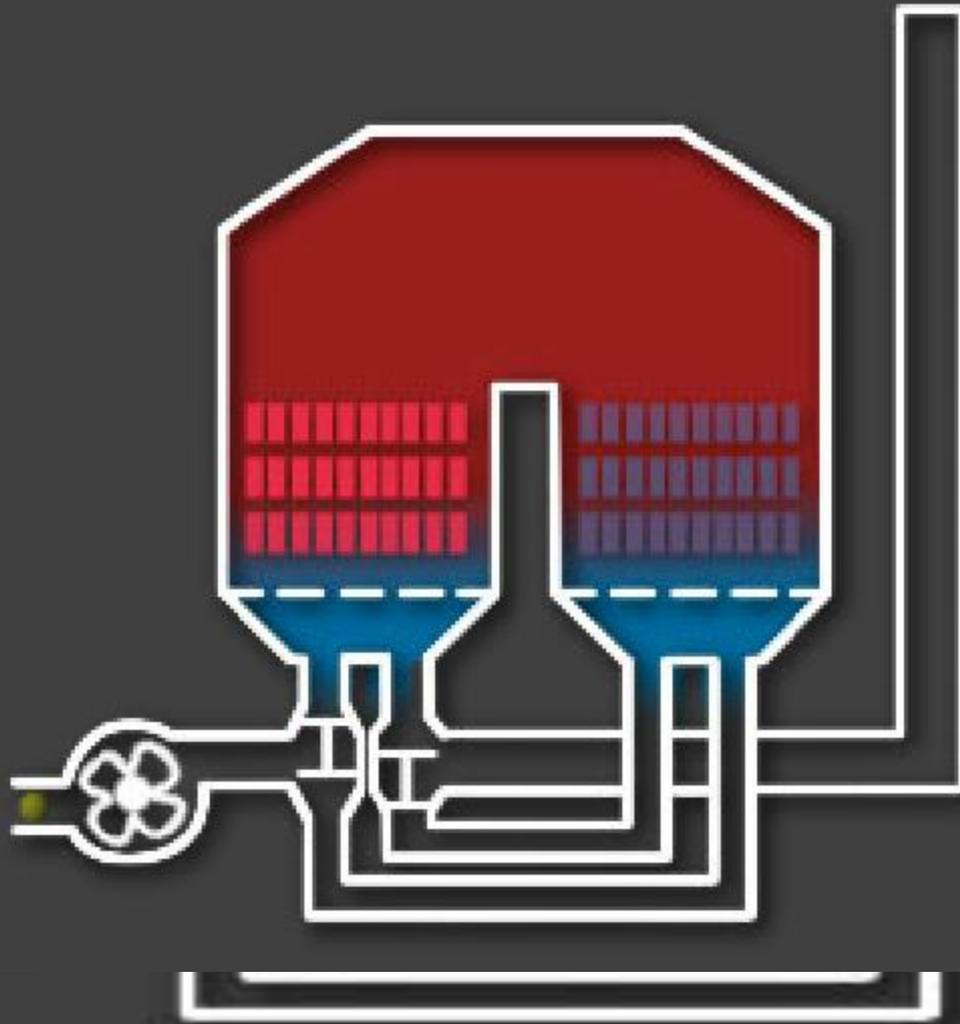

Regenerative Thermal Oxidizer Monitoring Approach

- **Key Factors to Consider When Monitoring a Regenerative TO:**
 - **Assessment of proper closure of valves: Annual inspection/testing**
 - **Annual documentation of valve timing control system parameters**

Heat Exchange Problems

- **Any cracks or leaks in a recuperative HX will bleed emissions into the clean side**
- **Uncoordinated valves in a regenerative HX will transfer emissions into the clean air.**
- **A regenerative HX usually burps some emissions into the clean air each time the valves switch the flow.**

Compliance Issues?







Let's Discuss PM Control

- ◆ Cyclones
- ◆ Baghouses
- ◆ ESPs
- ◆ Scrubbers
- ◆ Particulate Filters


Cyclones



Multi-Cyclone

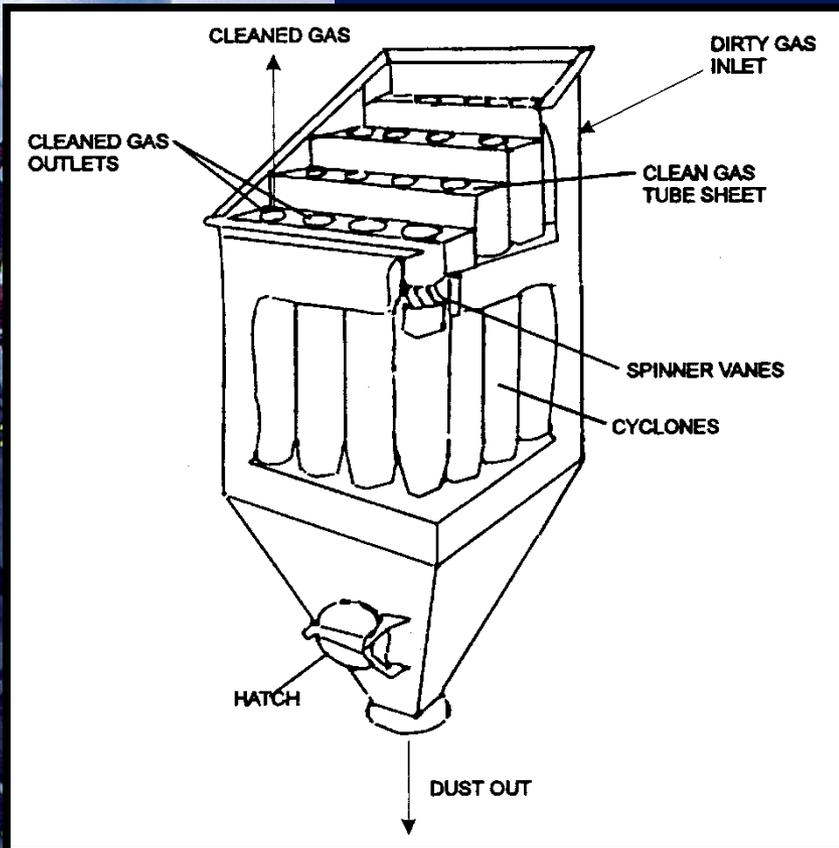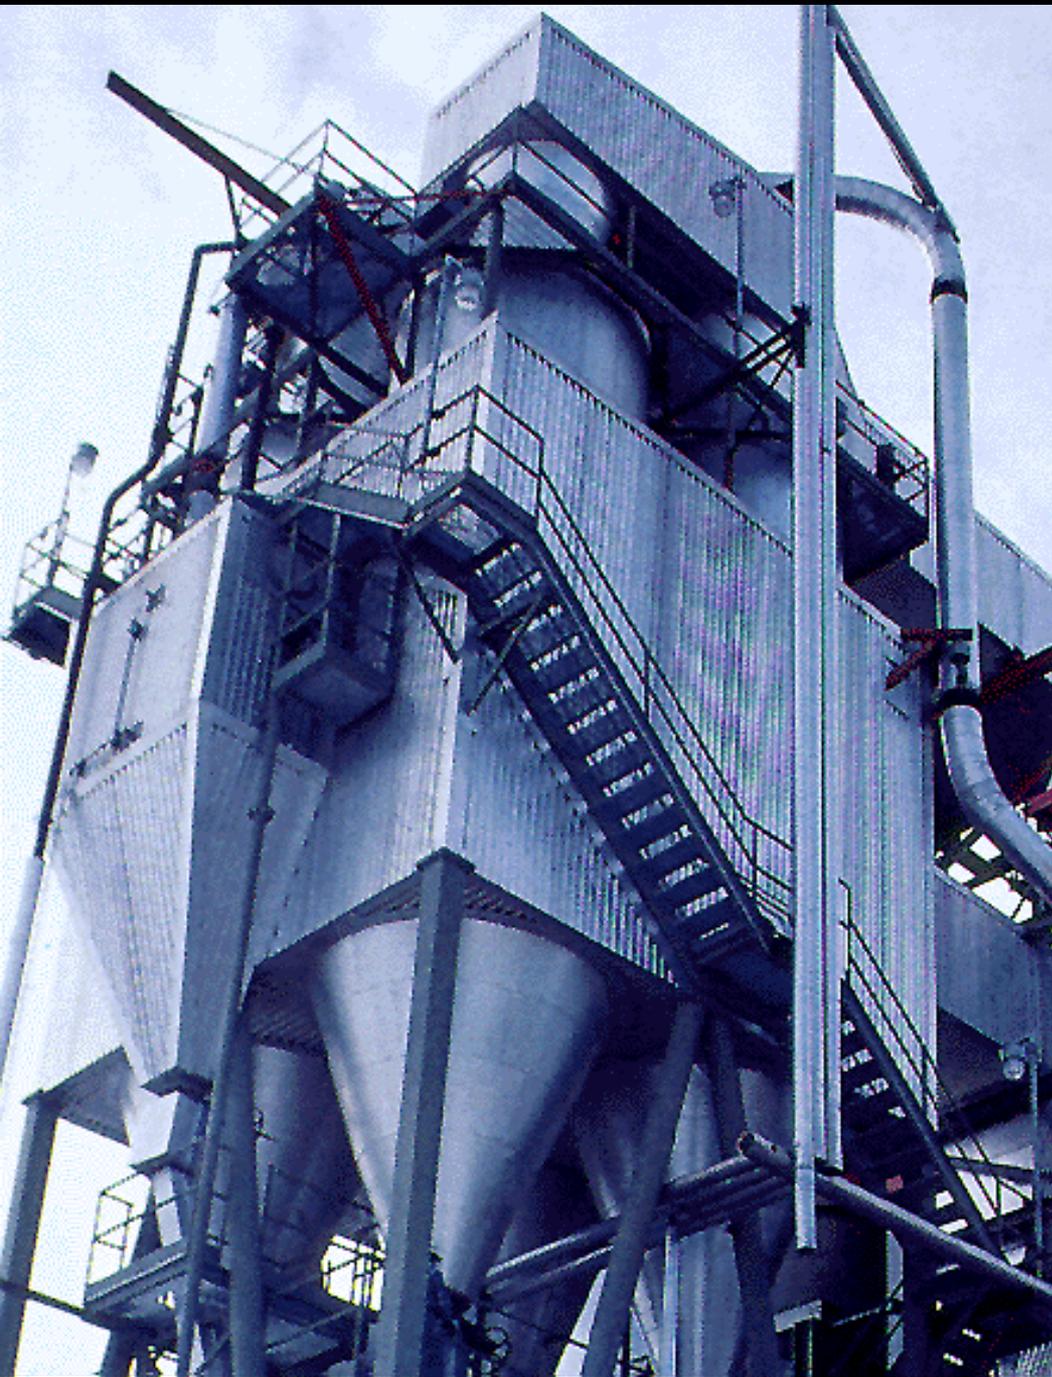

PM Control Techniques - Cyclone

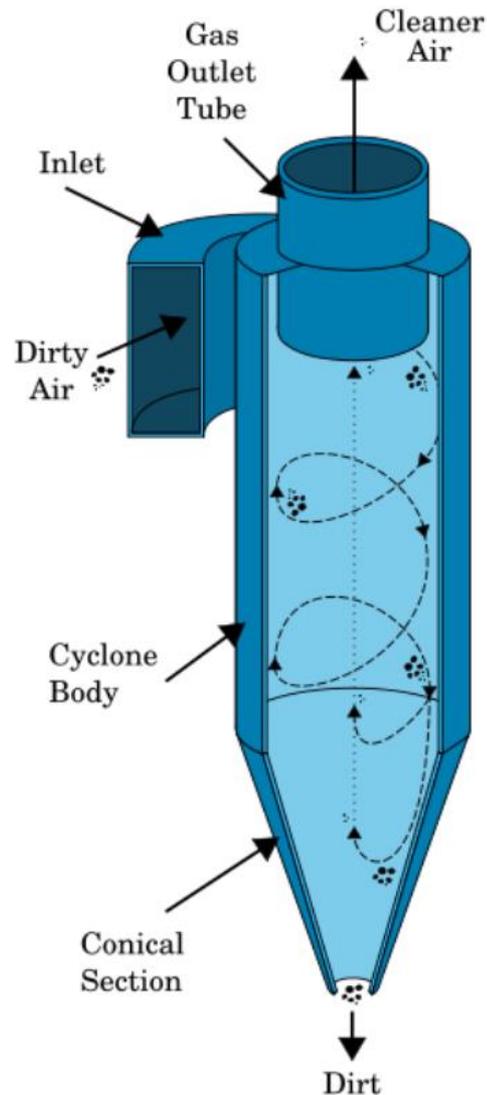

How a Cyclone Works



PM Control Techniques - Cyclone

- **General description**
 - **Particles hit wall sides and fall out**
 - **Often used as precleaners**
 - **Especially effective for particles larger than 20 microns**
 - **Inexpensive to build and operate**
 - **Can be combined in series or parallel**

Cyclone - Classification

1D-2D vs.
1D-3D

Cyclone – Control Efficiency

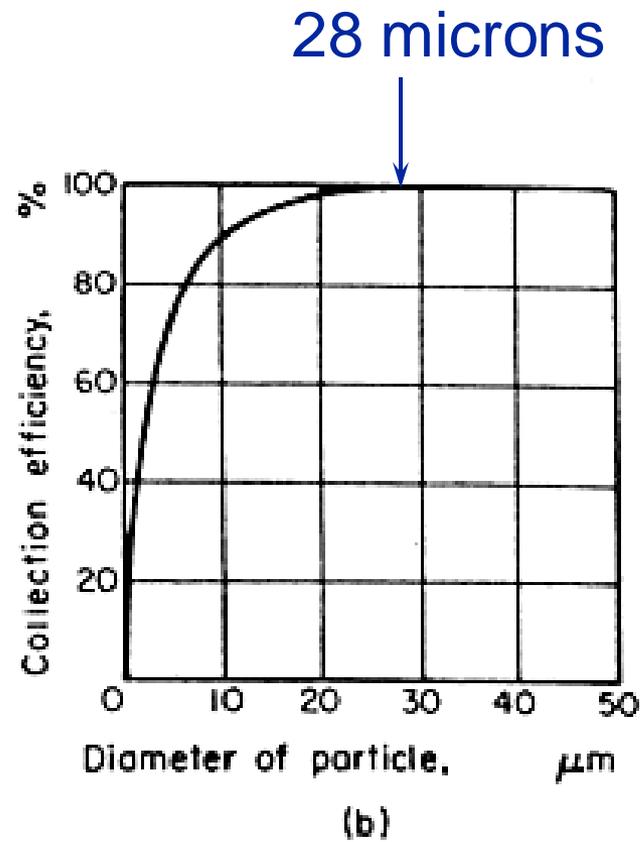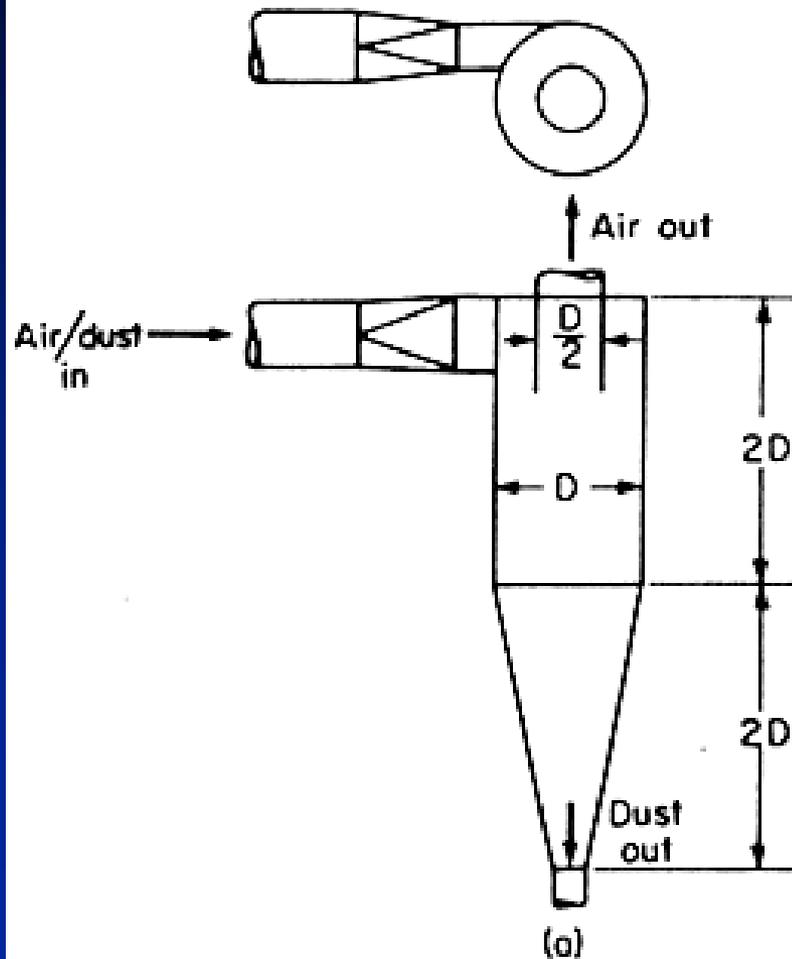

Cyclone – Control Efficiency


- Conventional Cyclones
 - 30-90% for PM_{10}
 - 0-40% for $PM_{2.5}$
- High Efficiency Single Cyclones
 - 60-95% for PM_{10}
 - 20-70% for $PM_{2.5}$
- Multi-Cyclones
 - 80-95% for PM_5

Cyclone – Failure Modes

- Failure Modes
 - Inlet and outlet plugging
 - Air leakage
 - Component erosion
 - Acid gas corrosion


PM Control Techniques - Cyclone

- Performance indicators
 - Opacity (VEE)
 - Pressure differential

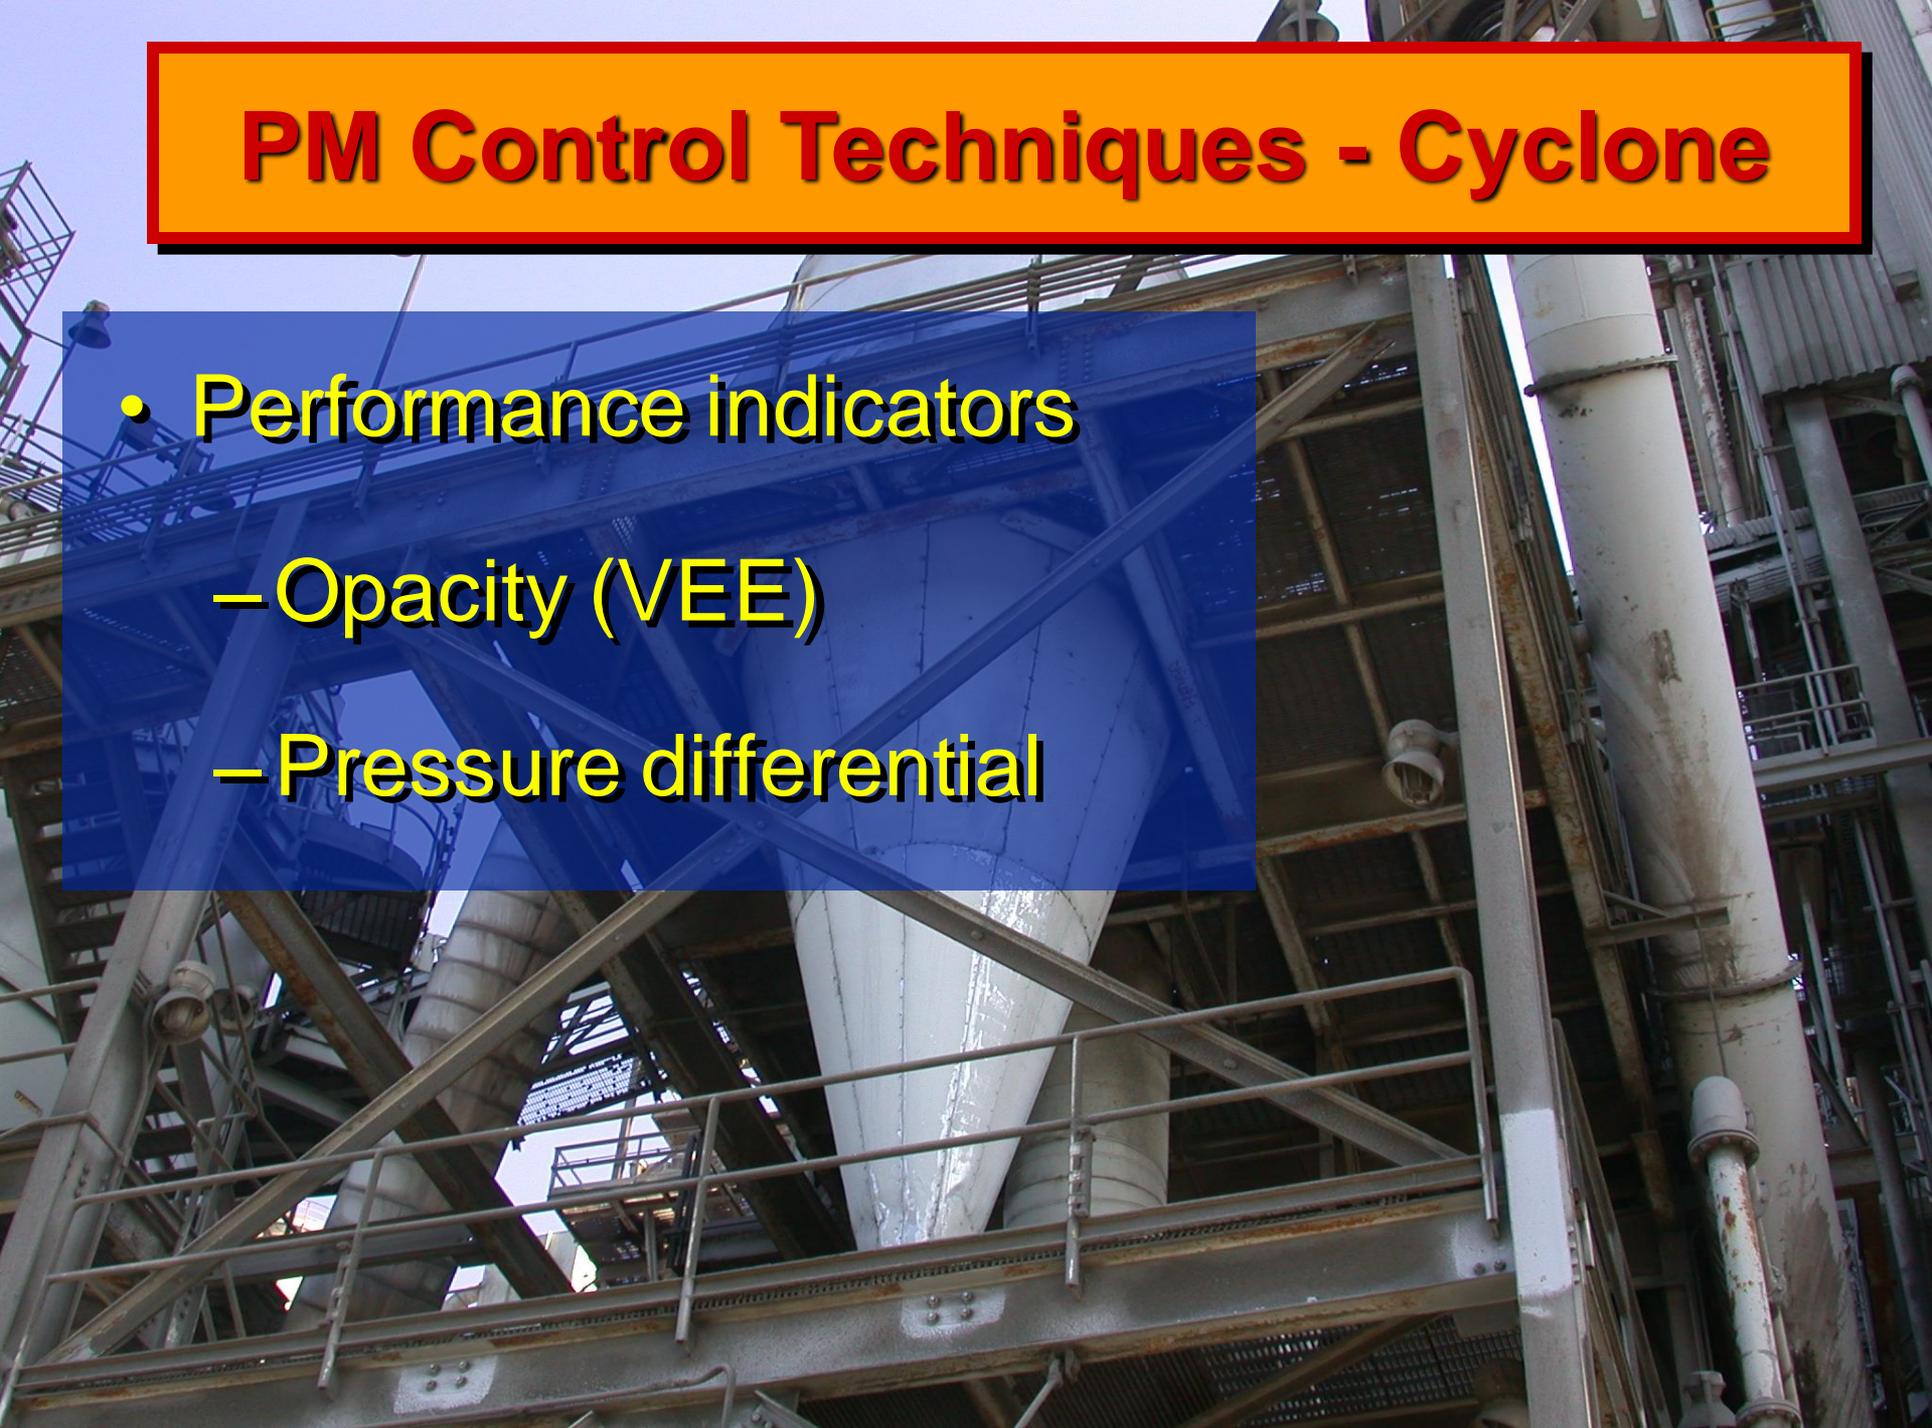

PM Control Techniques - Baghouses



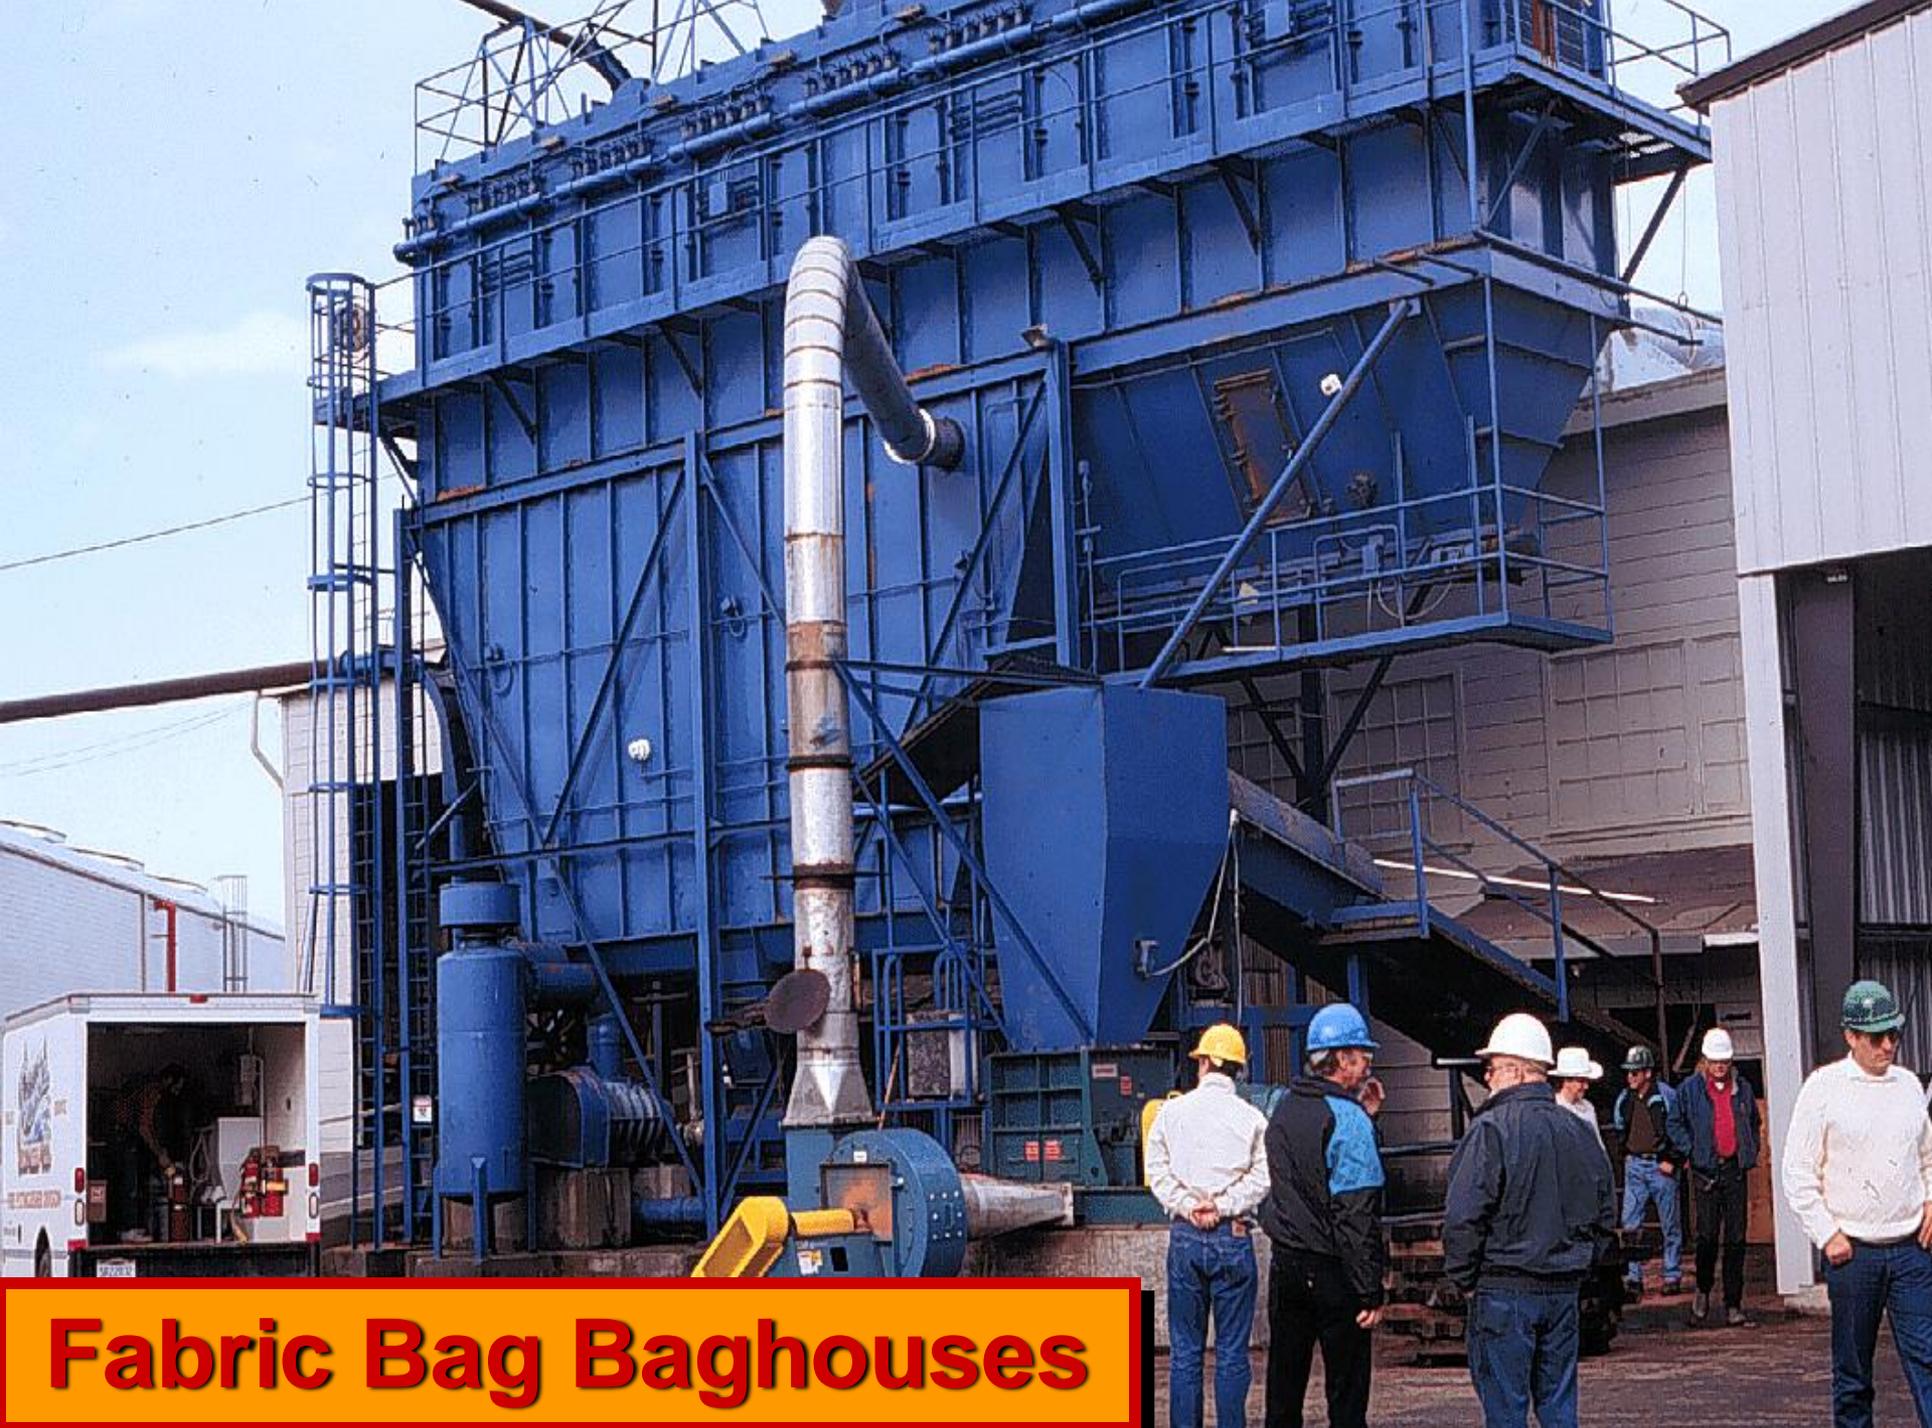


Fabric Bag Baghouses

Mac2flo

MAC

GREEN
↑
BEAN

Cartridge Type Baghouse

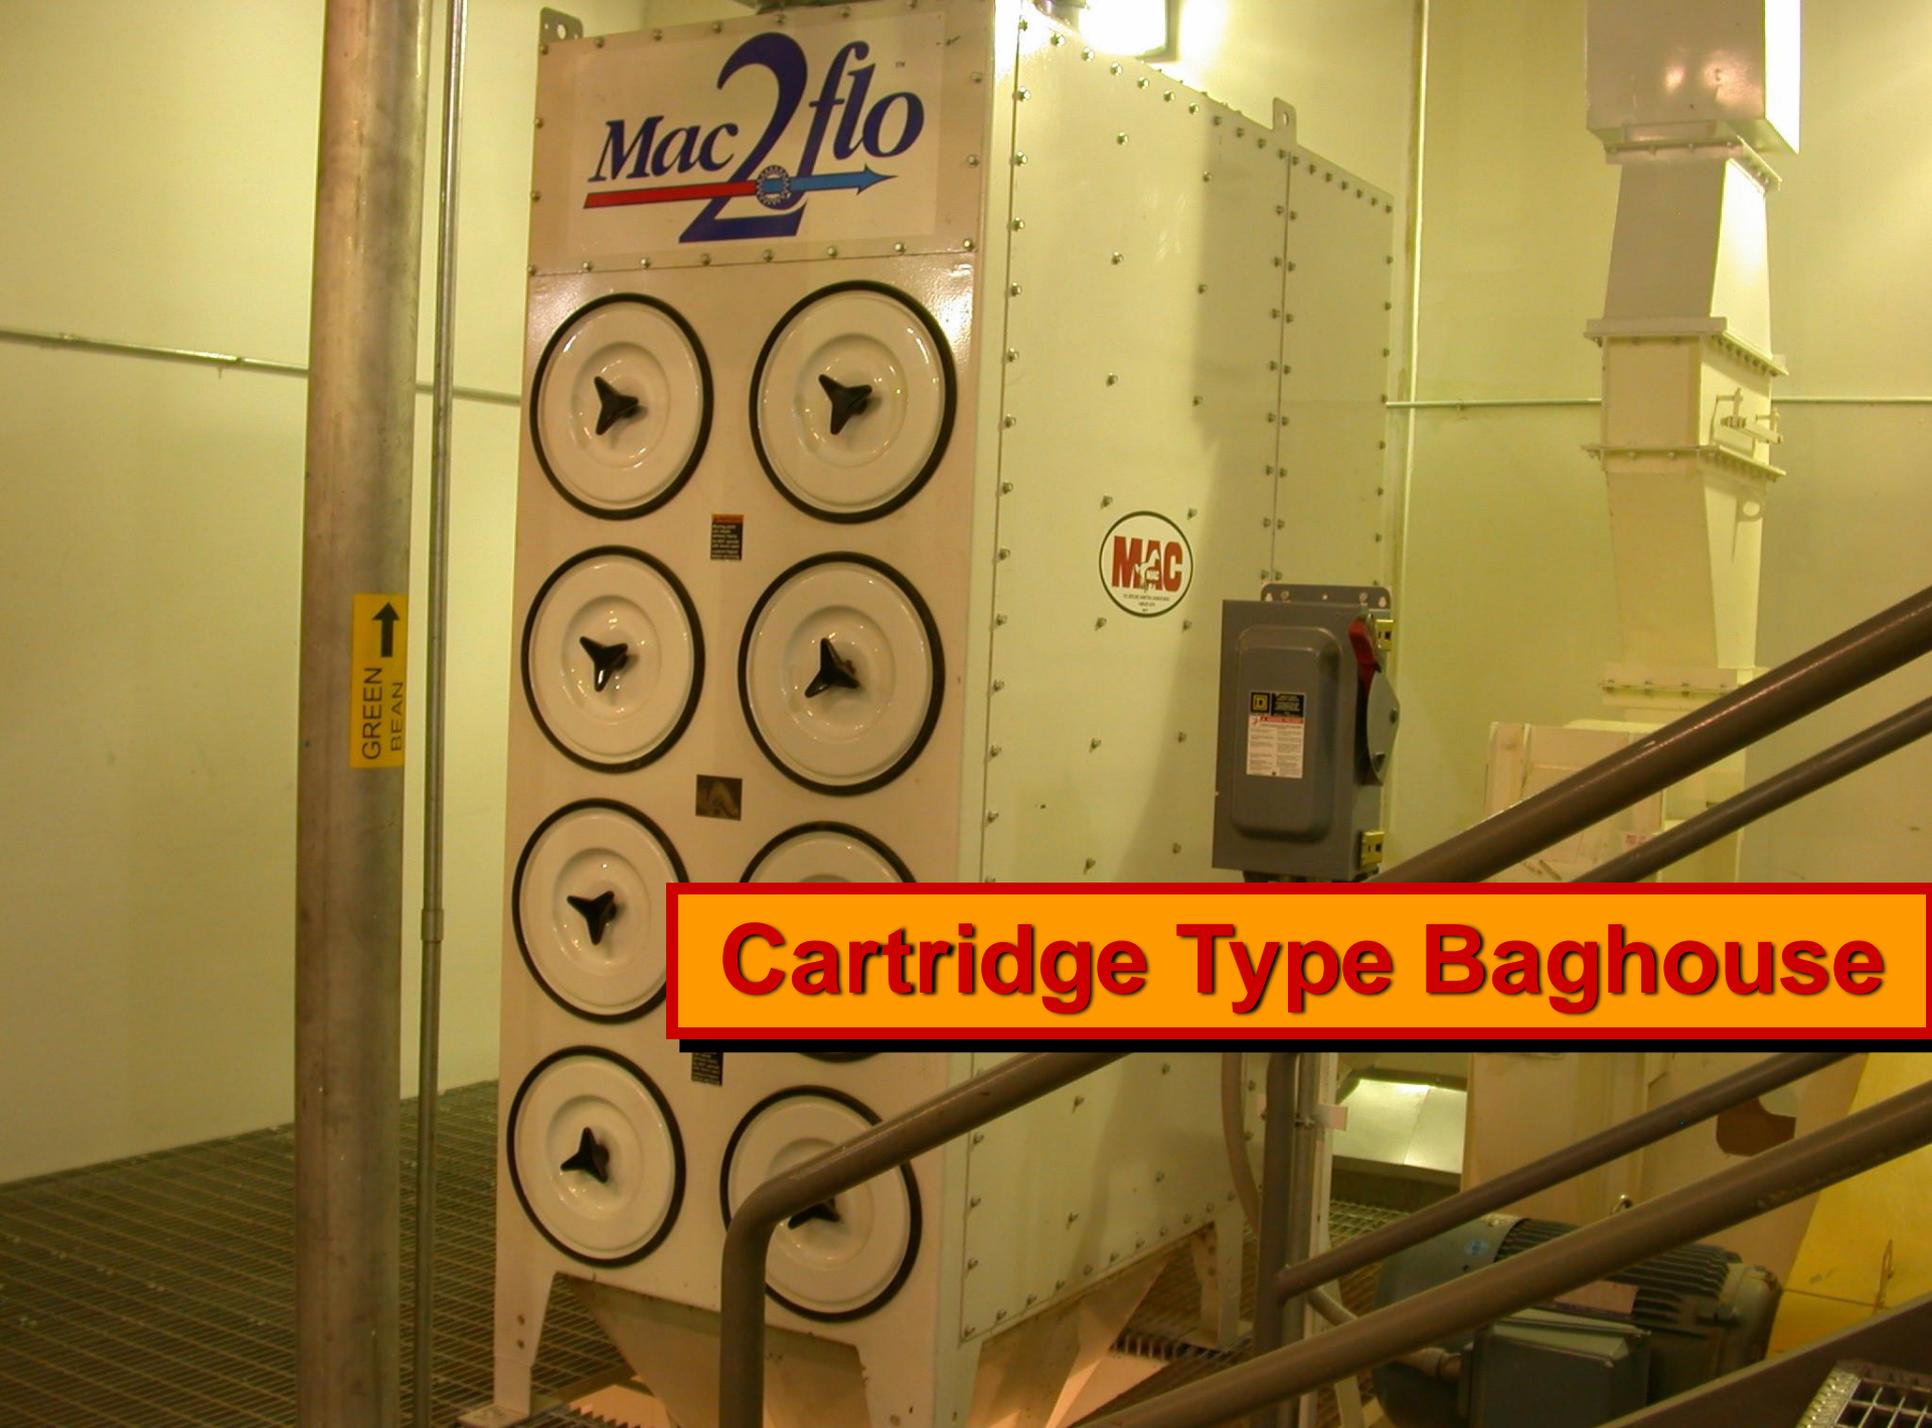

PM Control Techniques – Baghouse

- **General description**
 - **Generic name - dust collectors**
 - **Particles trapped on filter media, then removed**
 - **Either interior or exterior filtration systems**
 - **Forced Draft or Induced Draft fan**
 - **Require a cleaning mechanism**

PM Control Techniques – Baghouse

Forced Draft vs. Induced Draft

Fan Type	Pros	Cons
Forced	<ul style="list-style-type: none">• Smaller motor• Less expensive• Easy to identify leaks	<ul style="list-style-type: none">• Fan Blade Erosion
Induced	<ul style="list-style-type: none">• Fan on clean side• Particulate Contained	<ul style="list-style-type: none">• Larger motor• More expensive• Harder to indentify leaks

PM Control Techniques – Baghouse


- **Cleaning Mechanisms**

- 4 Types**

- **Mechanical Shaker (off-line)**
 - **Reverse air (low pressure, long time, off line)**
 - **Pulse jet (60 to 120 psi air, on line)**
 - **Sonic horn (150 to 550 Hz @ 120 to 140 dB, on line) – rarely used alone**

Baghouse Cleaning Methods



Mechanical Shaker

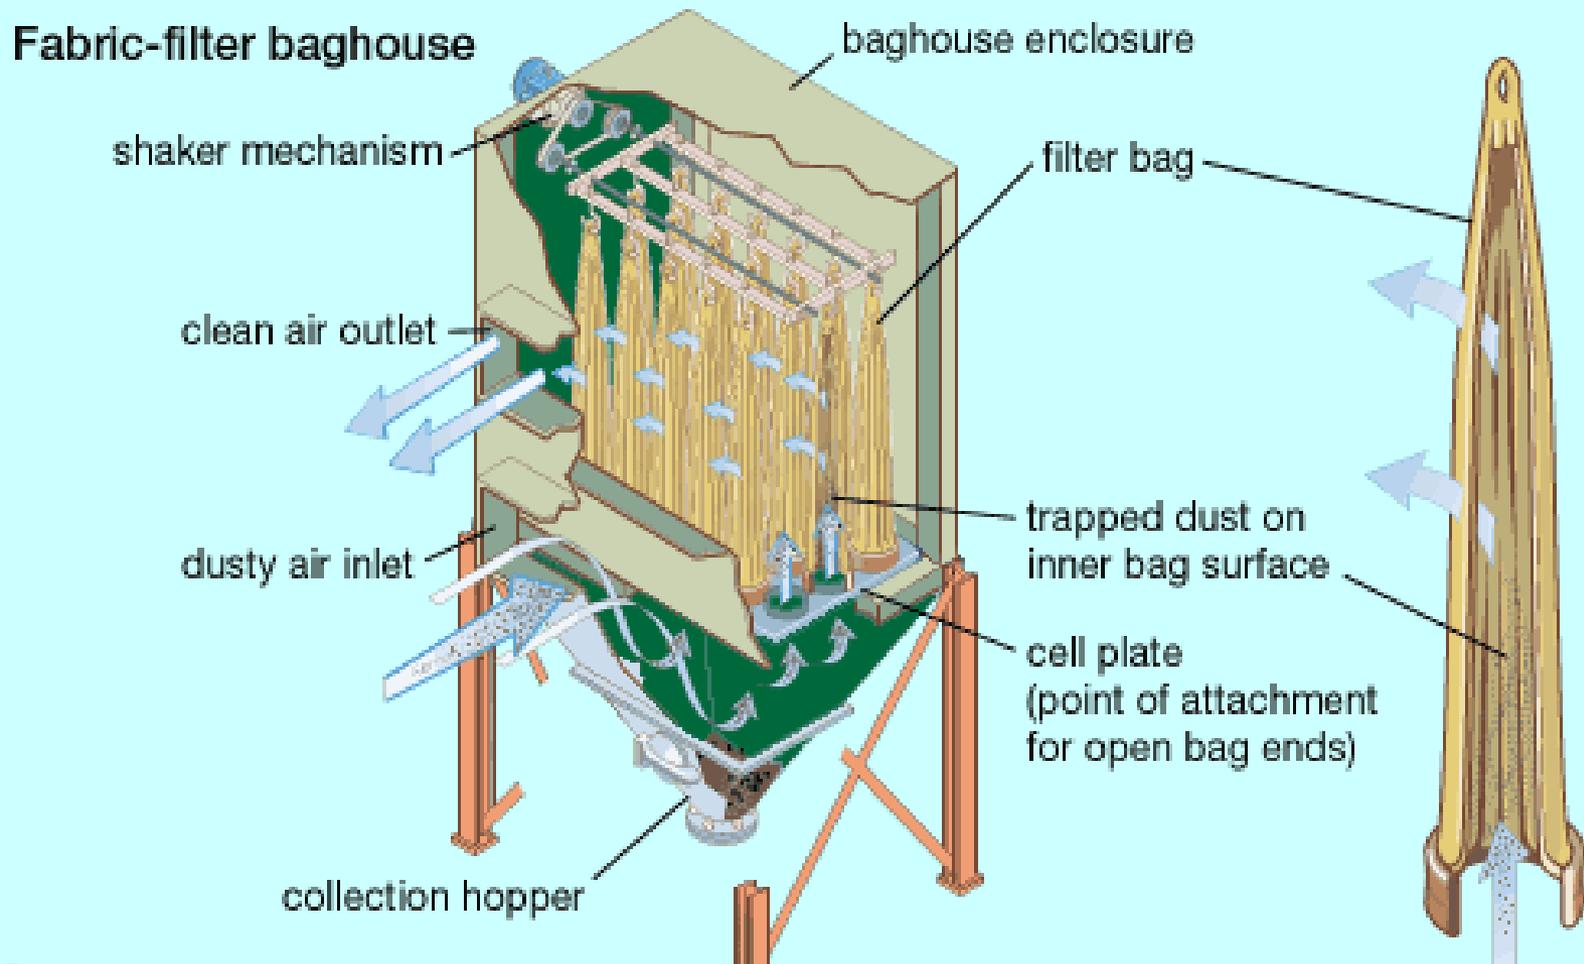

Baghouse Cleaning Methods

Reverse Air


SINGLE BAG SCHEMATIC

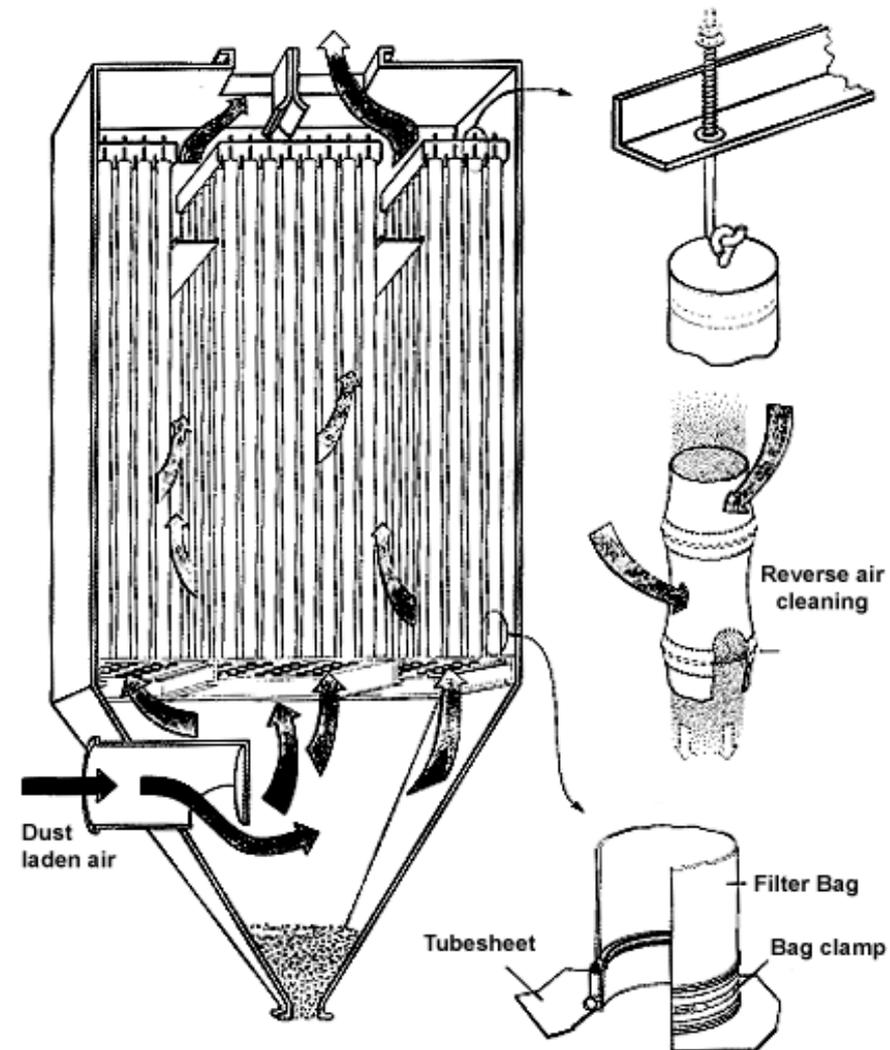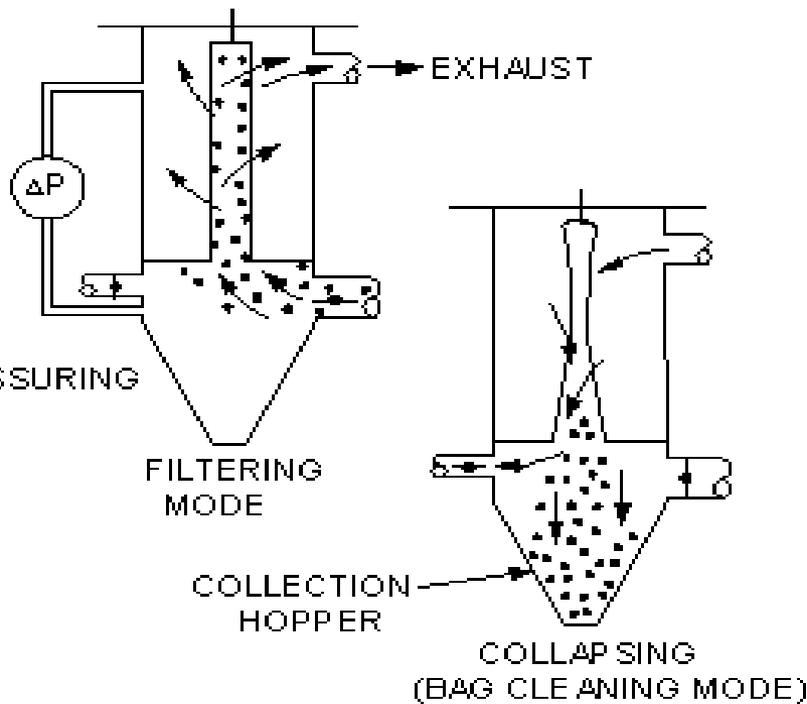

Baghouse Cleaning Methods


Sonic Horns



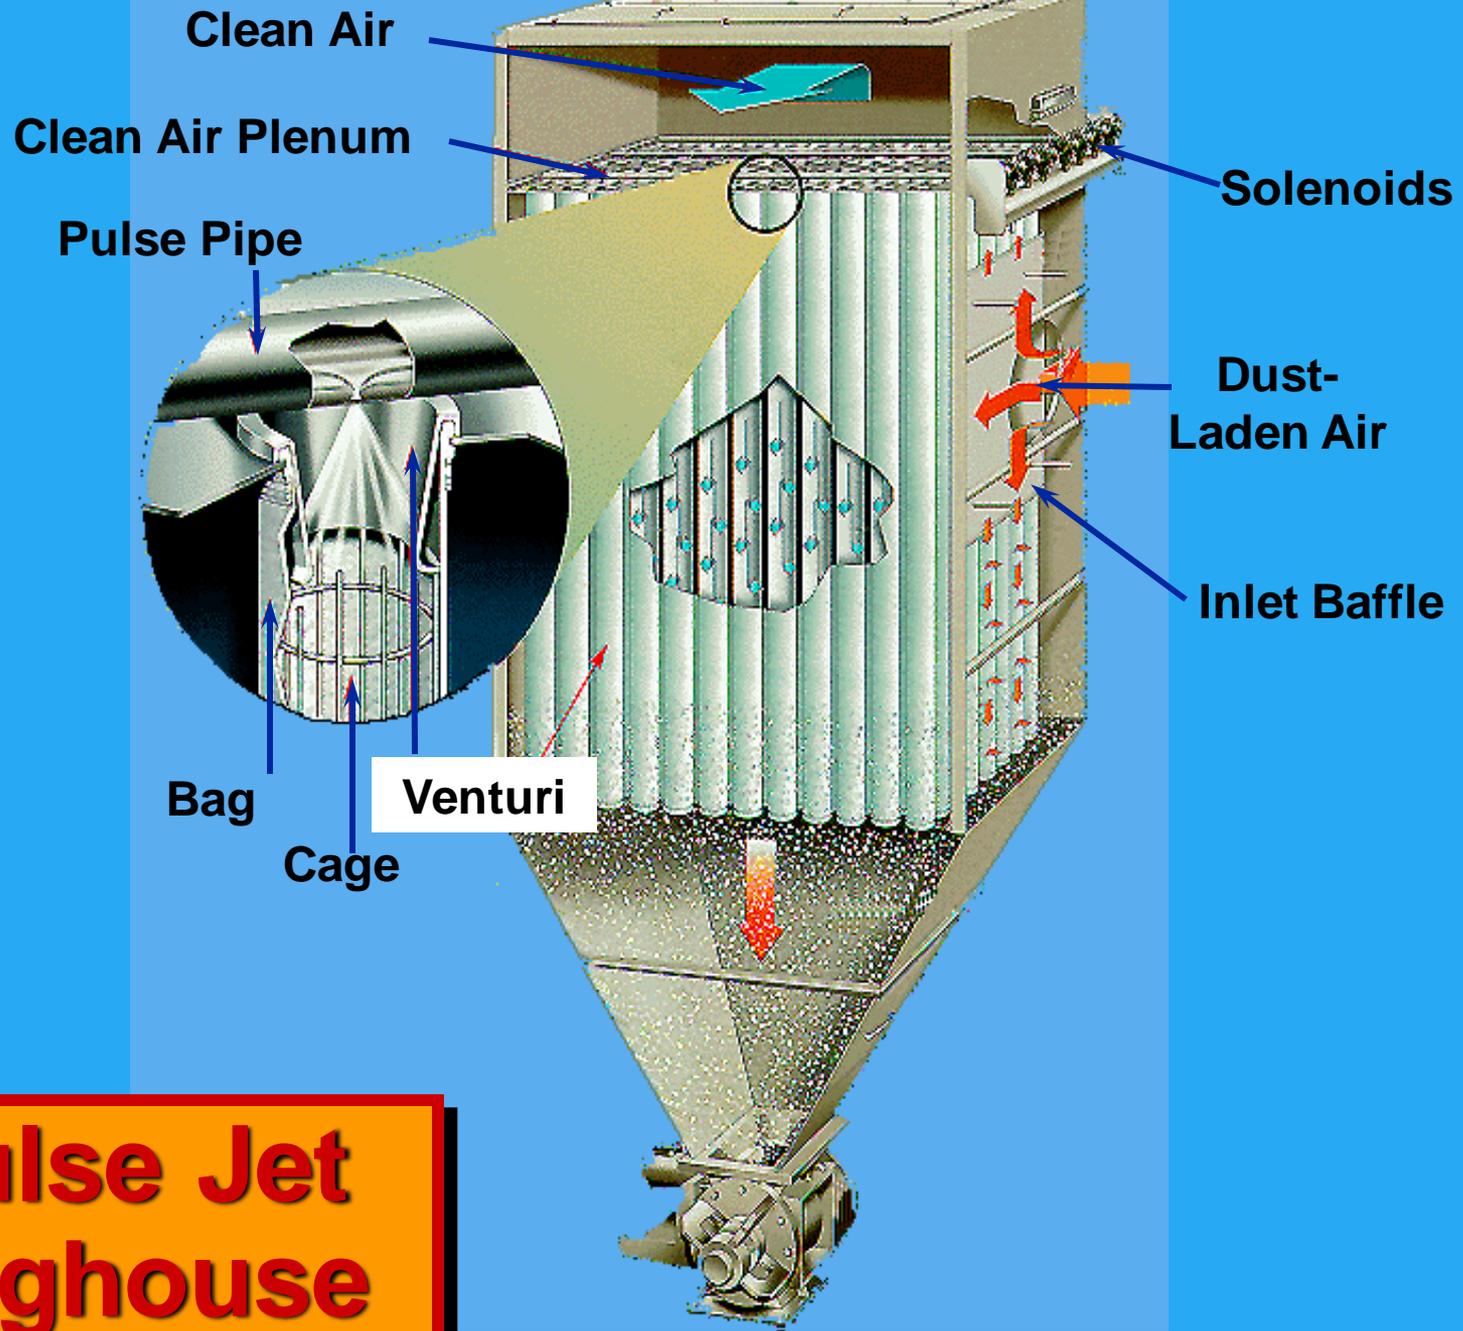


Pulse Jet Baghouse

Inside a Pulse Jet Baghouse

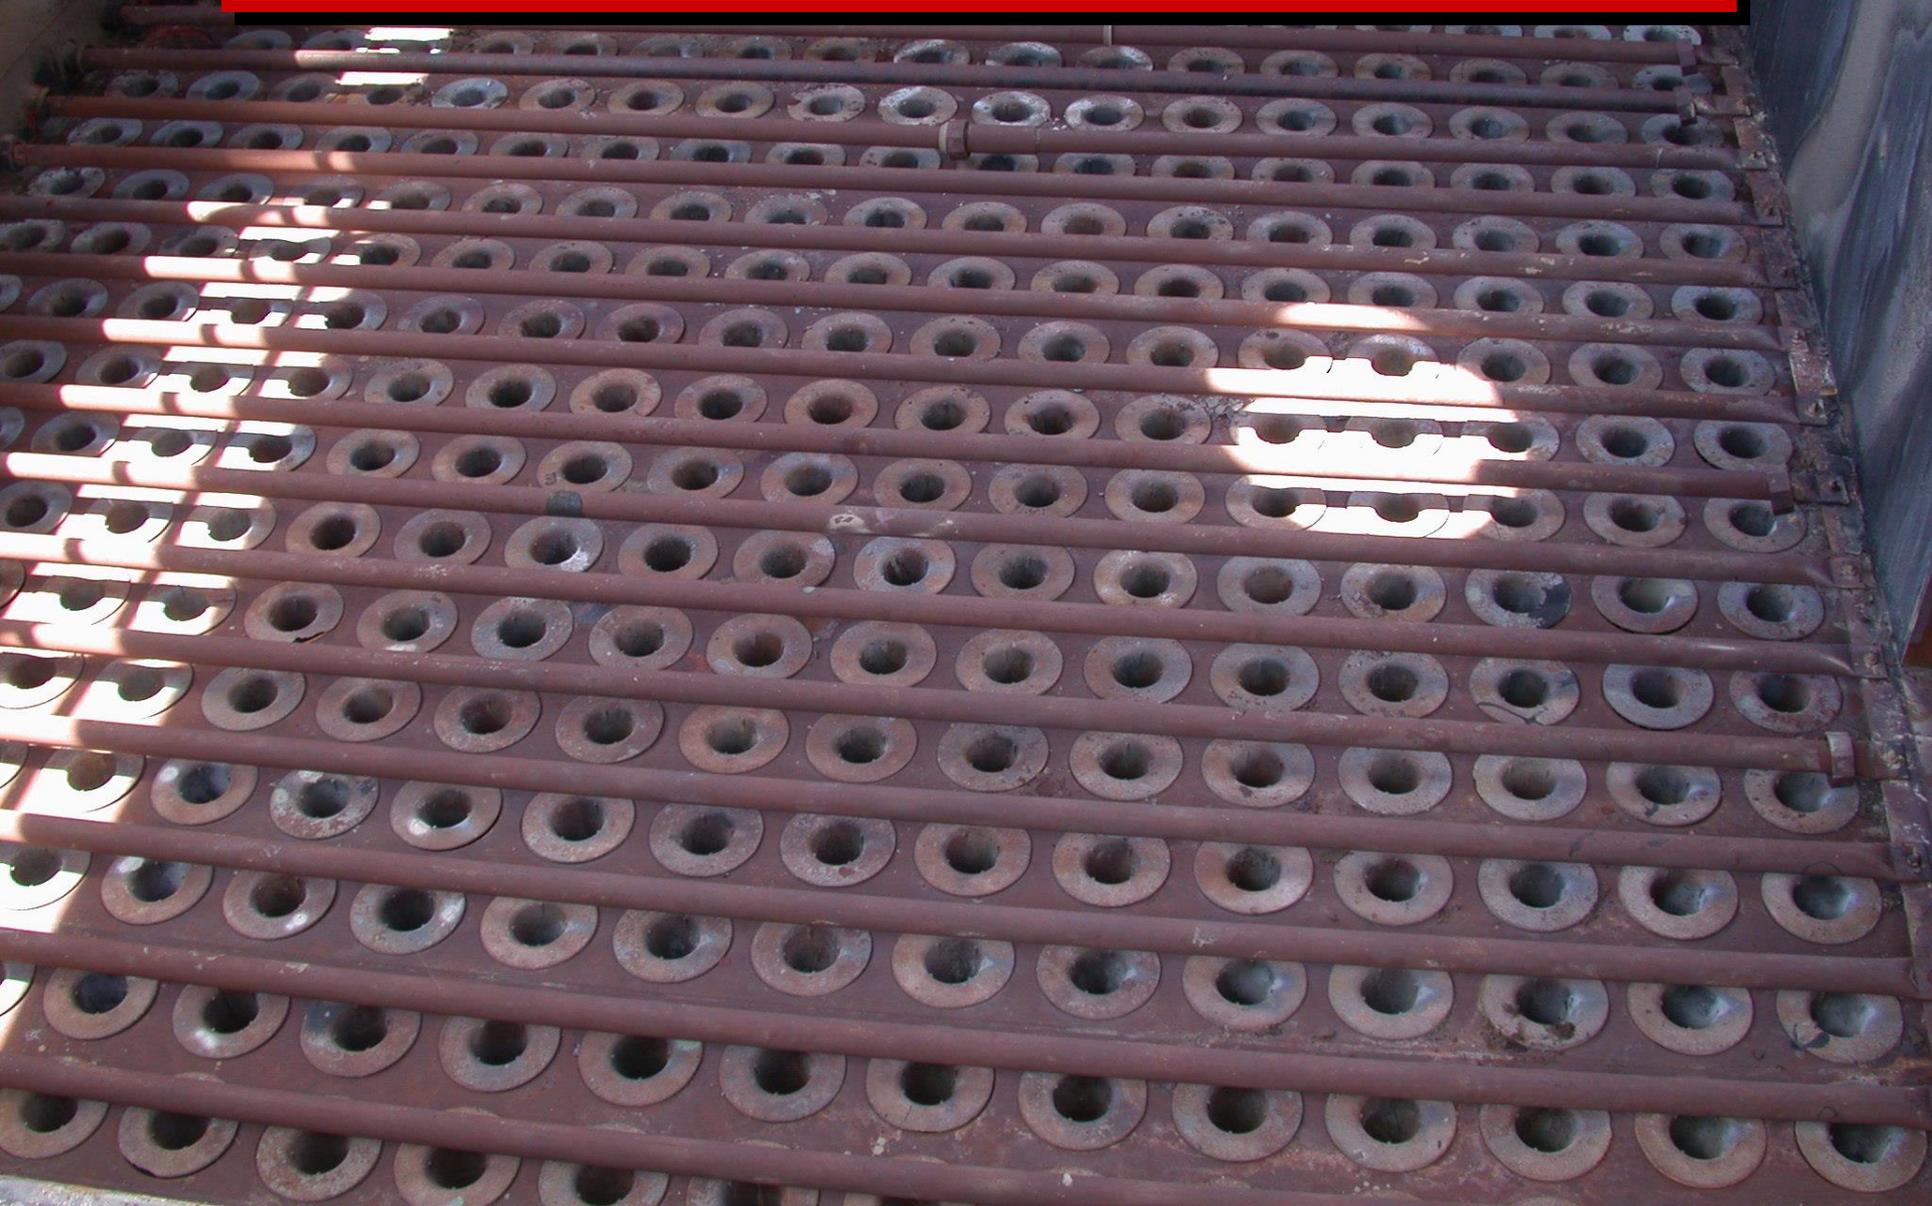

Pulse Jet Bag

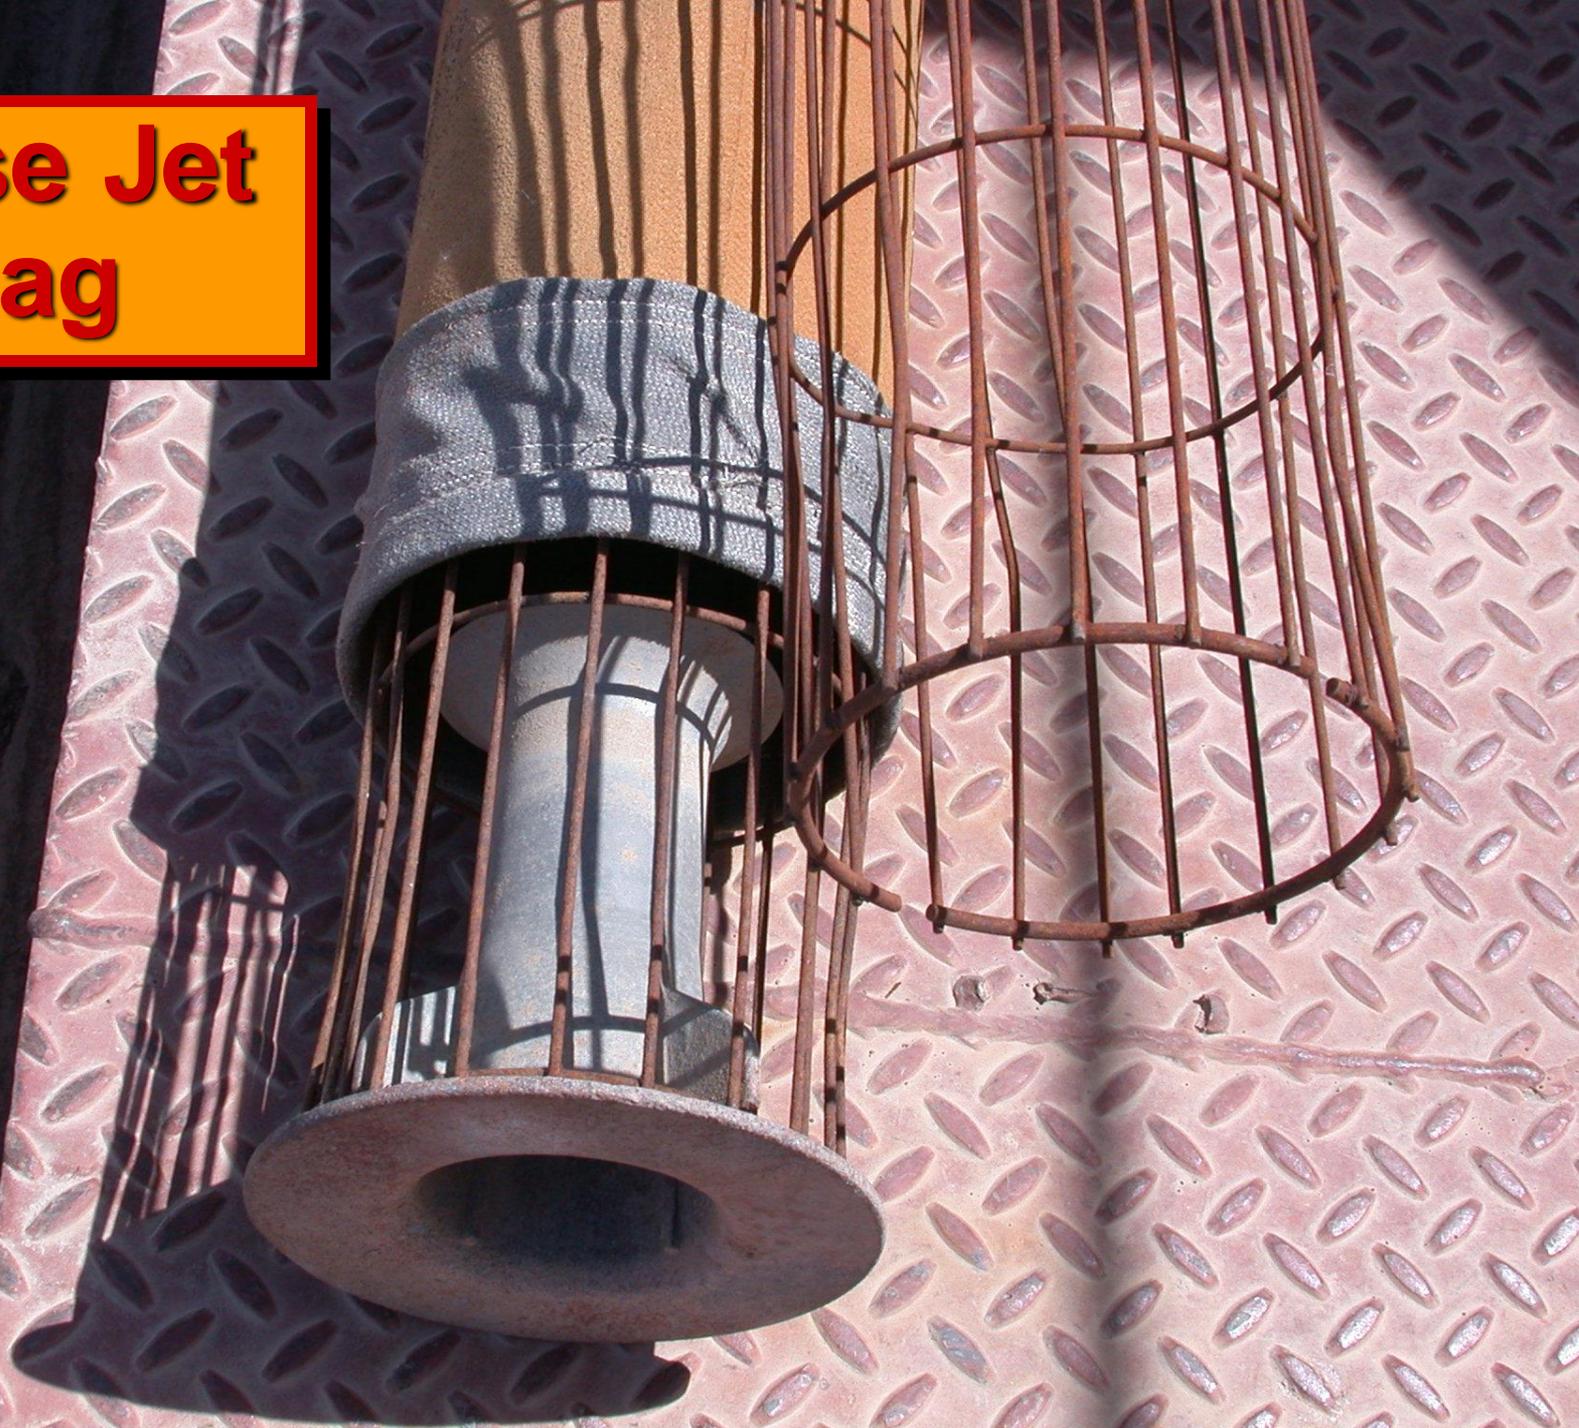


Control Efficiency - Baghouse

- Conventional Baghouses
 - 95% - 99.9% for PM_{10}
 - 95% - 99% for $PM_{2.5}$
- High Efficiency Particle Air (HEPA)
 - 99.97% for $PM_{0.3}$
- Ultra Low Penetration Air (ULPA)
 - 99.9995% for $PM_{0.12}$

Baghouse Design Considerations

- Pressure Drop
- Air-To-Cloth Ratio
- Collection Efficiency
- Fabric Type
- Cleaning
- Temperature Control
- Space and Cost

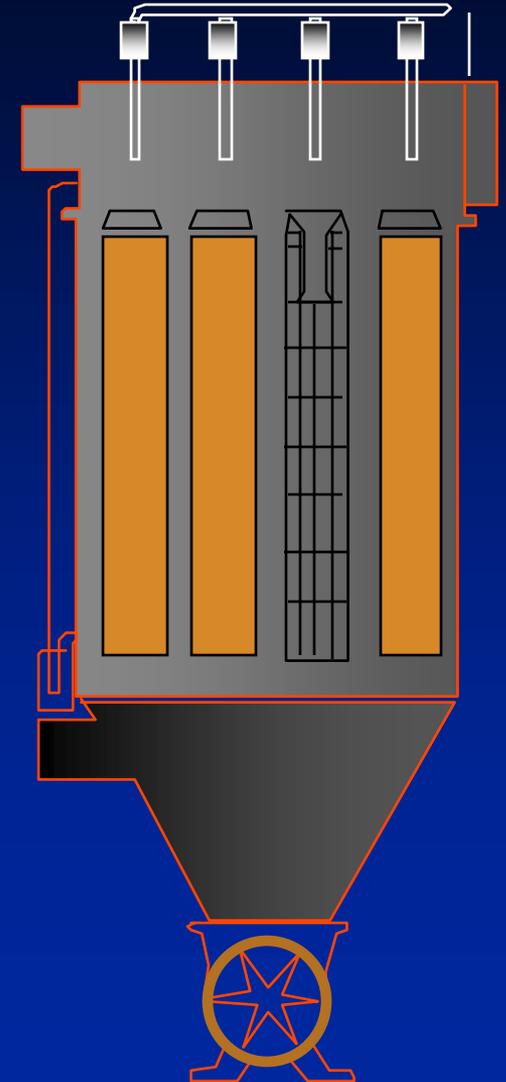

Causes of Failure - Baghouse

- **Bag**
 - Abrasion
 - High temperature
 - Chemical attack
 - Concretion of particulate
- **Plenum**
 - Abrasion
 - Chemical attack
 - Corrosion
- **Outer Wall**
 - Abrasion
 - Chemical attack
 - Corrosion
 - Physical Damage




Baghouse – Performance Indicators

- Performance indicators
 - Outlet opacity (VEE)
 - Pressure differential
 - Outlet PM concentration (COMS)
 - Bag leak detectors
 - Exhaust gas flow rate
 - Cleaning mechanism operation
 - Inspections and maintenance


Monitoring Equipment


- Magnehelic or Manometer (ΔP)
- Continuous Opacity Monitoring Systems (COMS)
- Tribo Electric Sensors

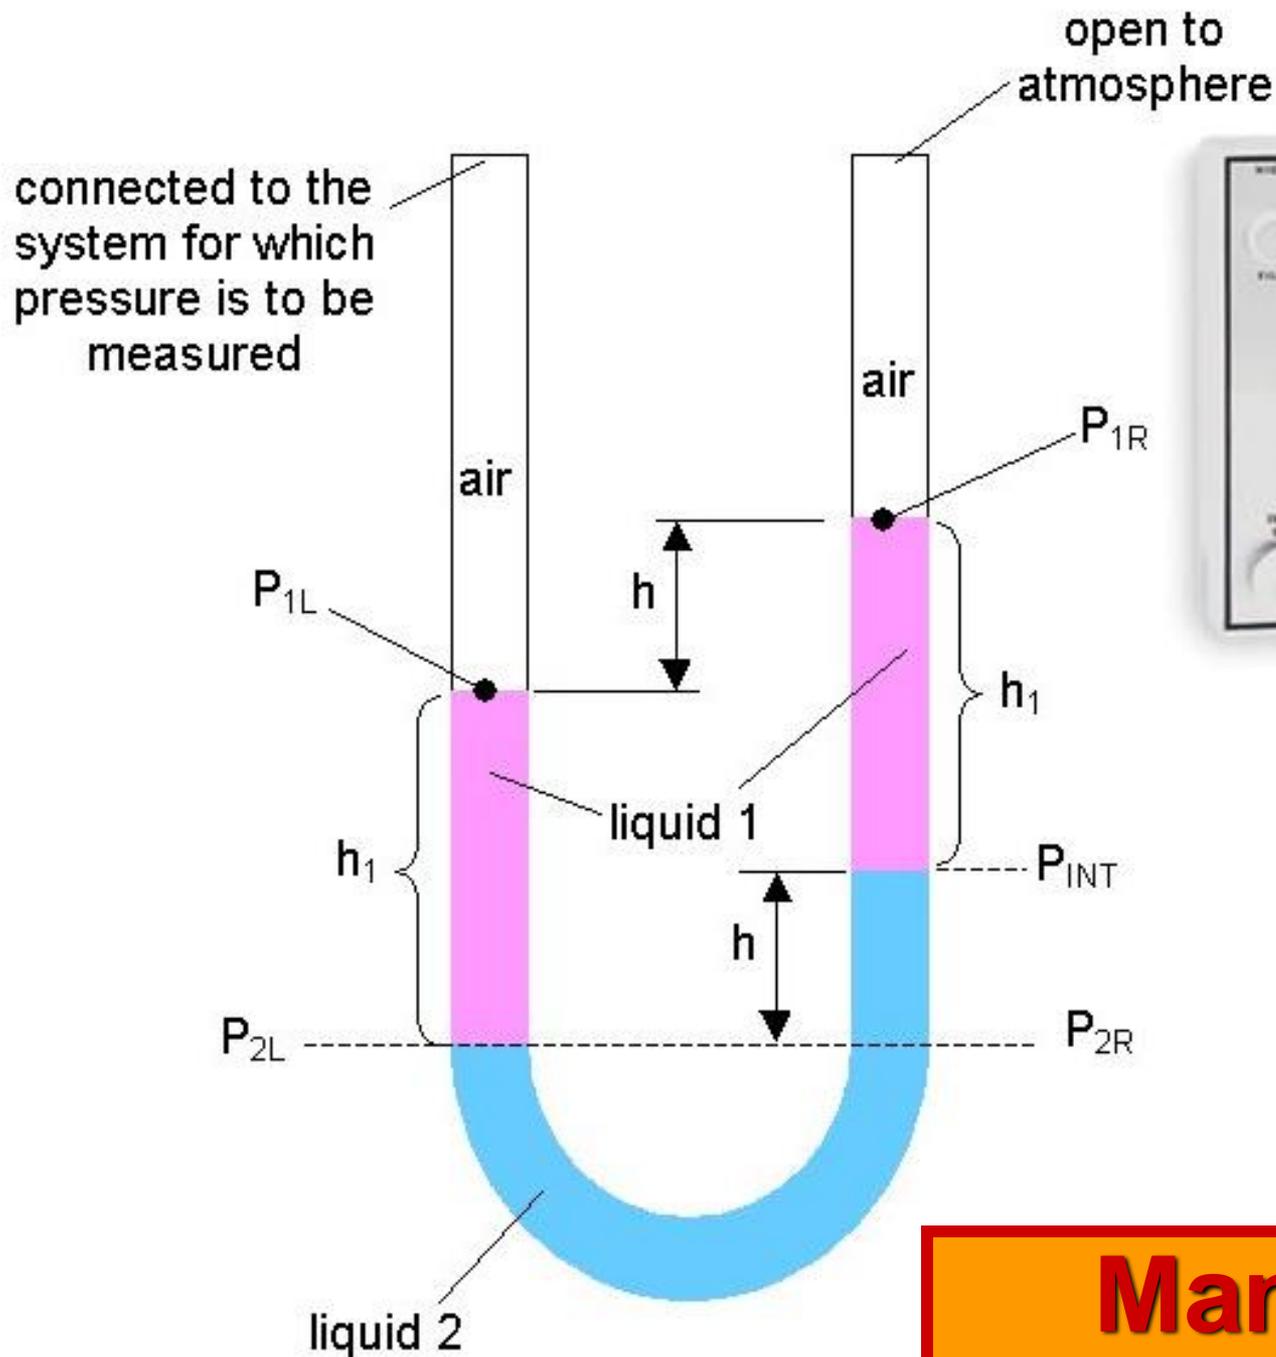

Manometer

Measuring Pressure Drop

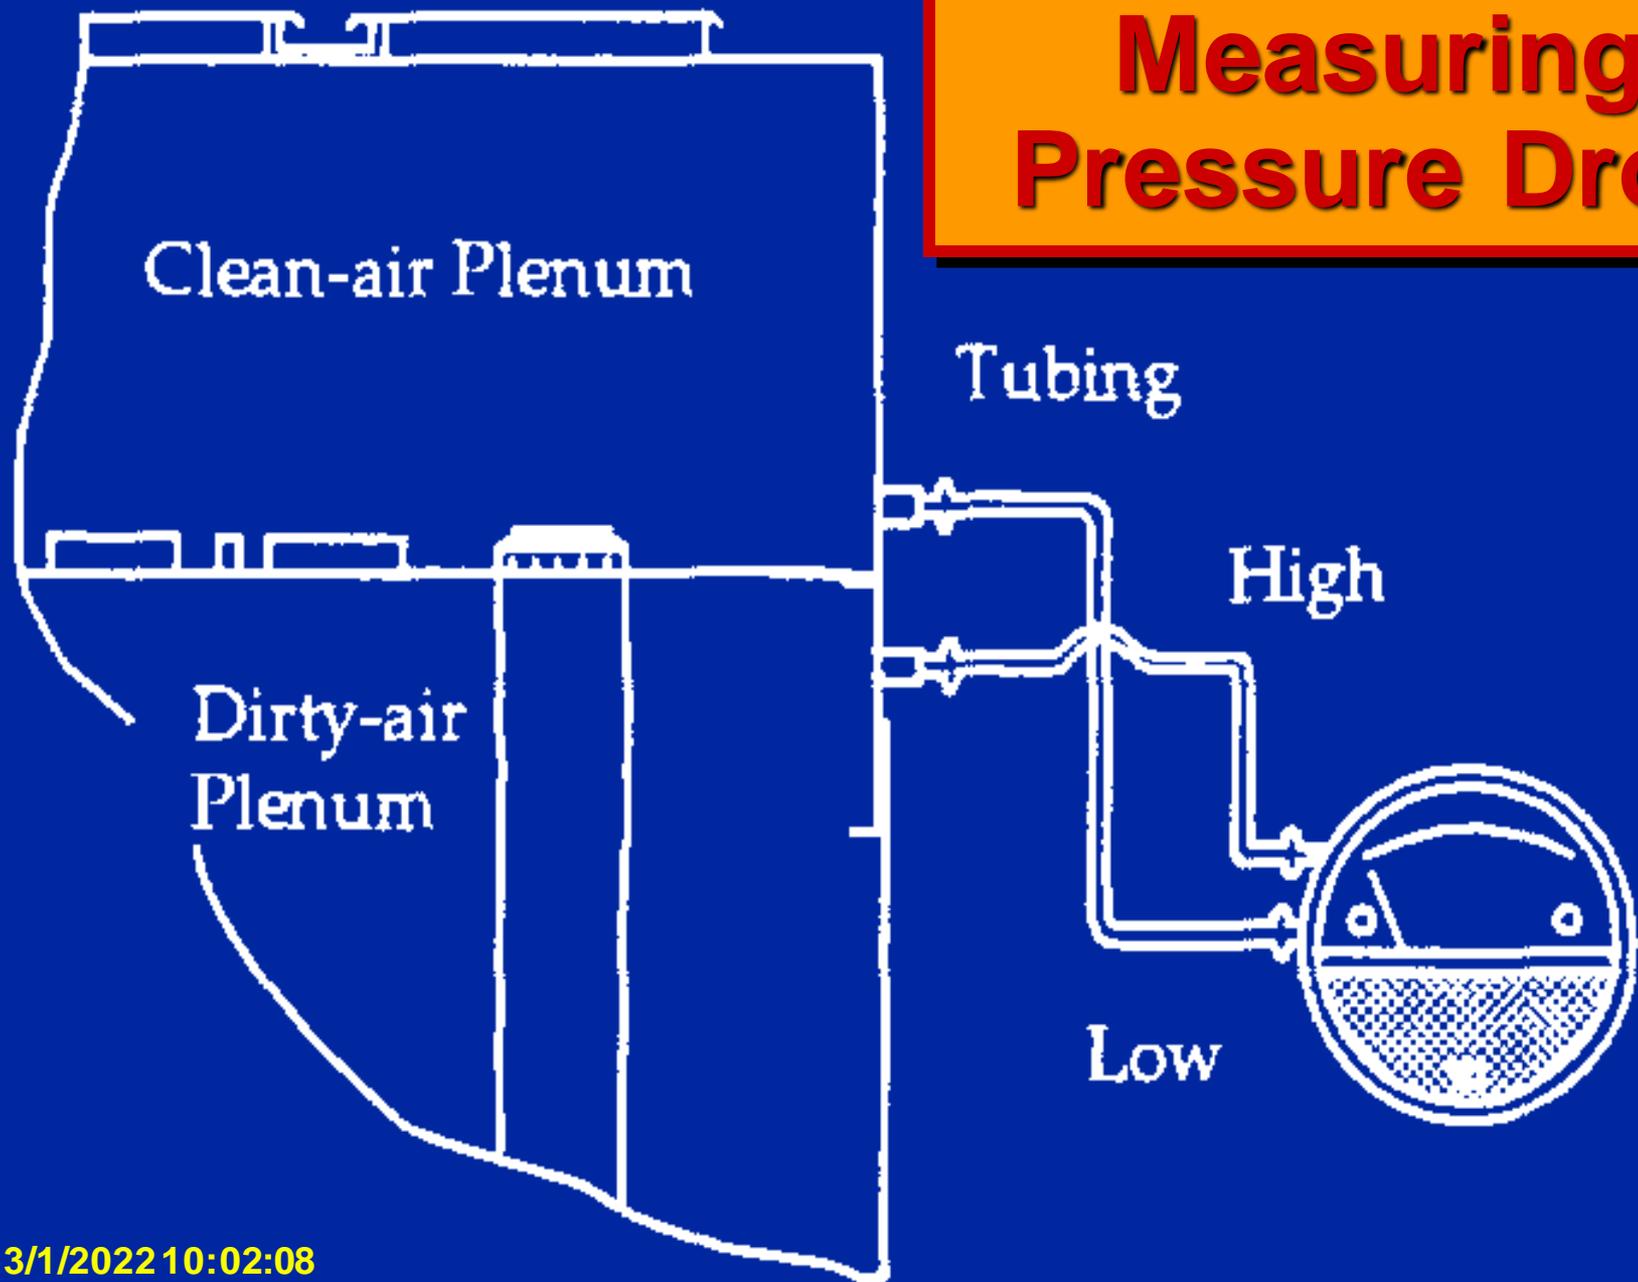

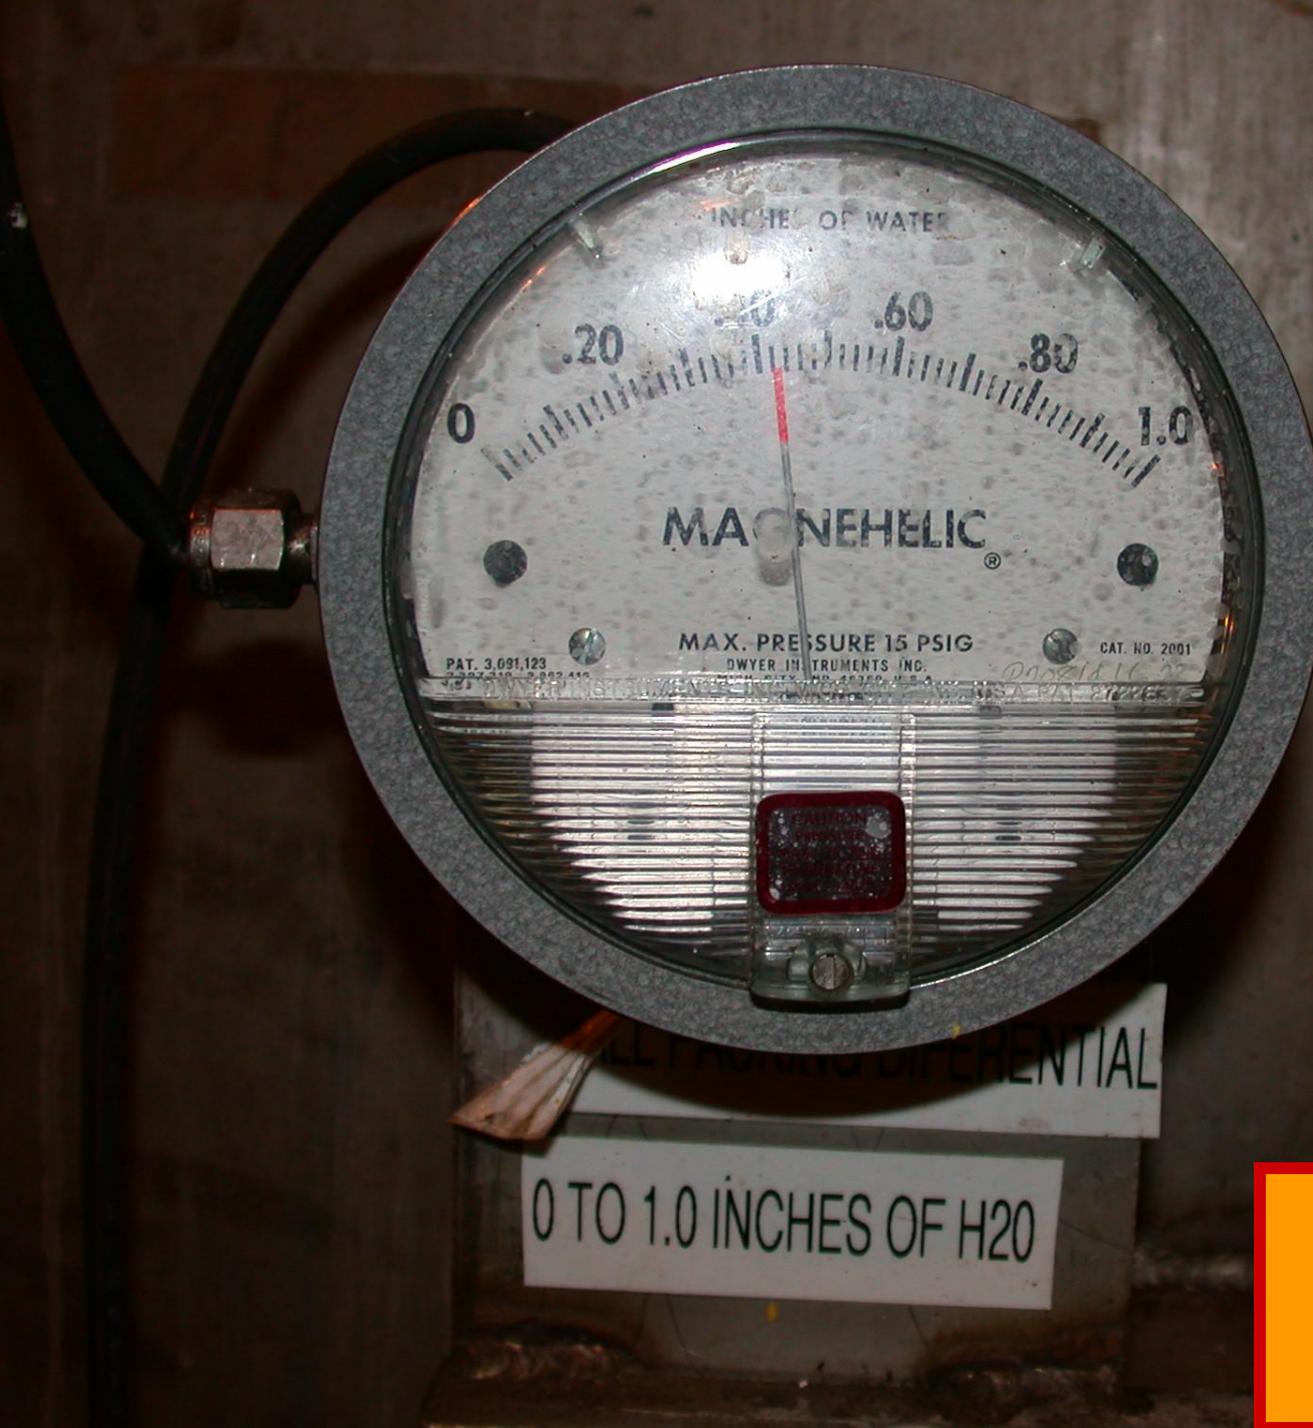

**Magnehelic
Gauge**

0 TO 1.0 INCHES OF H₂O

DIFFERENTIAL

MAGNEHELIC

MAX. PRESSURE 15 PSIG
Dwyer Instruments Inc.

CAT. NO. 2001

PAT. 3,091,123

2,227,310 - 2,882,410

MADE IN U.S.A.

Baghouse Pressure Drop

- ΔP shows air flow – it's in operation
- ΔP may fluctuate 10% as a function of the bag cleaning cycle.
- Continued rise in ΔP will result from bags that become permanently plugged (blinded).
- High ΔP will lead to premature bag failure.
- Daily/weekly record of ΔP can be a useful monitoring tool



PM COMS



Opacity

- Not very sensitive – shows a gross failure.
- Baseline (new) bag house opacity is probably $\ll 1\%$
- Emissions must increase about 10x to be visible.
- Opacity useful where particulate emissions limit is high.

Triboelectric Sensors

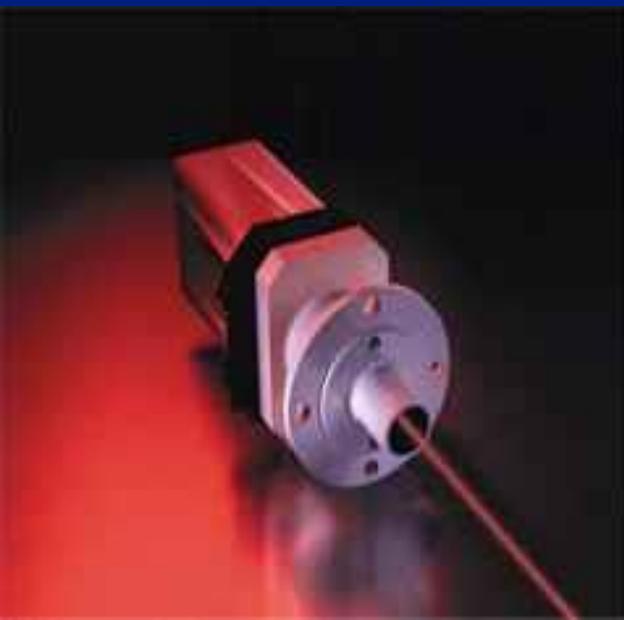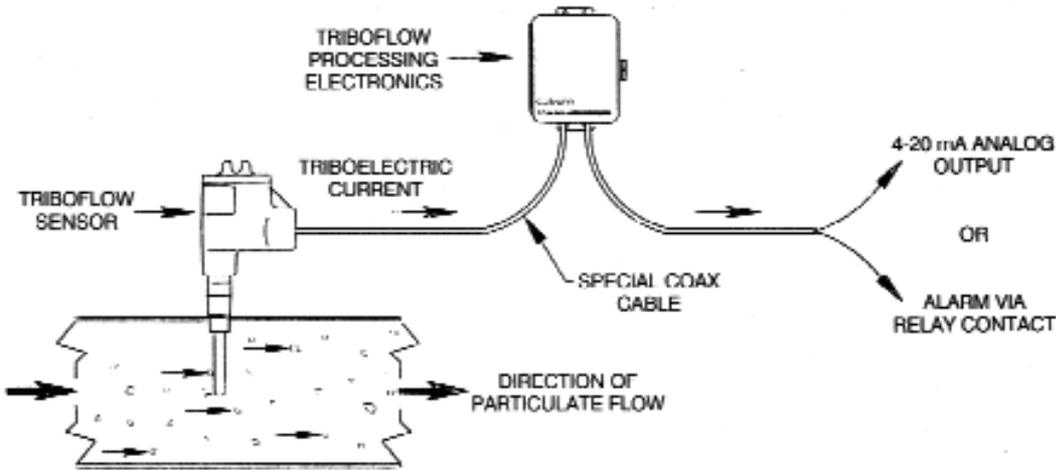

Baghouse Monitoring

- Normal baghouse emissions are very low.
 - Opacity sensors (COM) aren't very good below 1-2%, so they don't detect initial problems.
 - Opacity will show a major particulate emissions increase.
 - COM or Method 9 may be OK for loose emission limits.

Tribo Electric Sensors

- Tribo electric sensors (TES) work well at very low particle concentrations (very sensitive).
- TES detects micro amp current from particles hitting a metal probe.
- TES is simple and inexpensive.
- TES is an effective monitor when a small to moderate increase in emissions is of concern.


BH Monitoring Summary

- Use TES for sensitive indication of changes in particulate emissions
- Opacity will indicate large increases in particulate emissions.
- An increasing pressure drop is indicative of long term problems

Baghouse : Secondary Containment



**Let's Discuss
Electrostatic
Precipitators (ESP)**

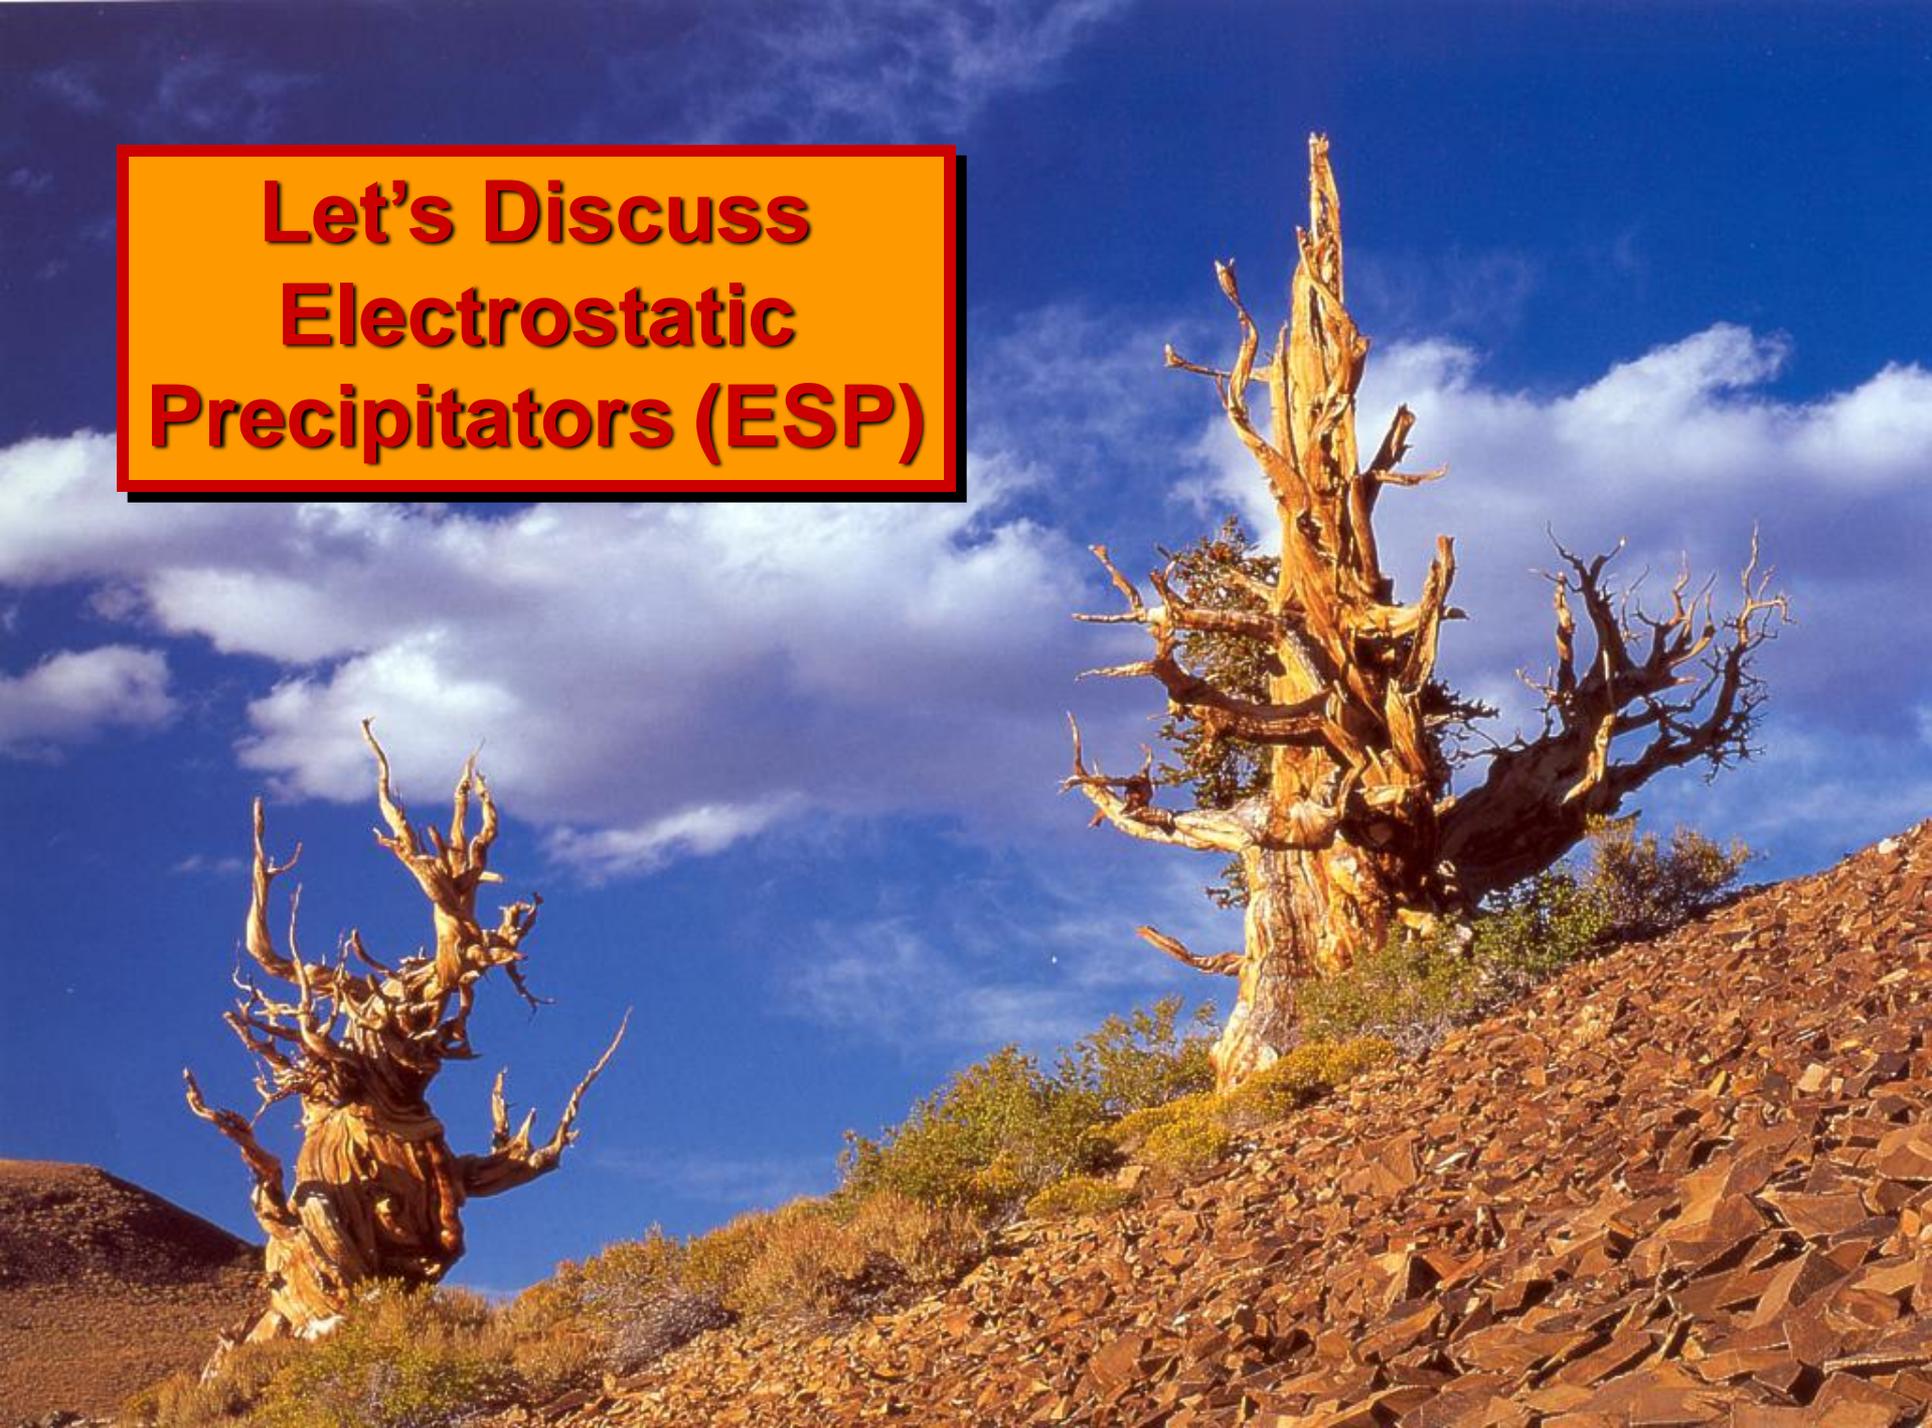


Prometheus Tree – 4,844 years old




Bio Mass Power Plant


Electrostatic Precipitator

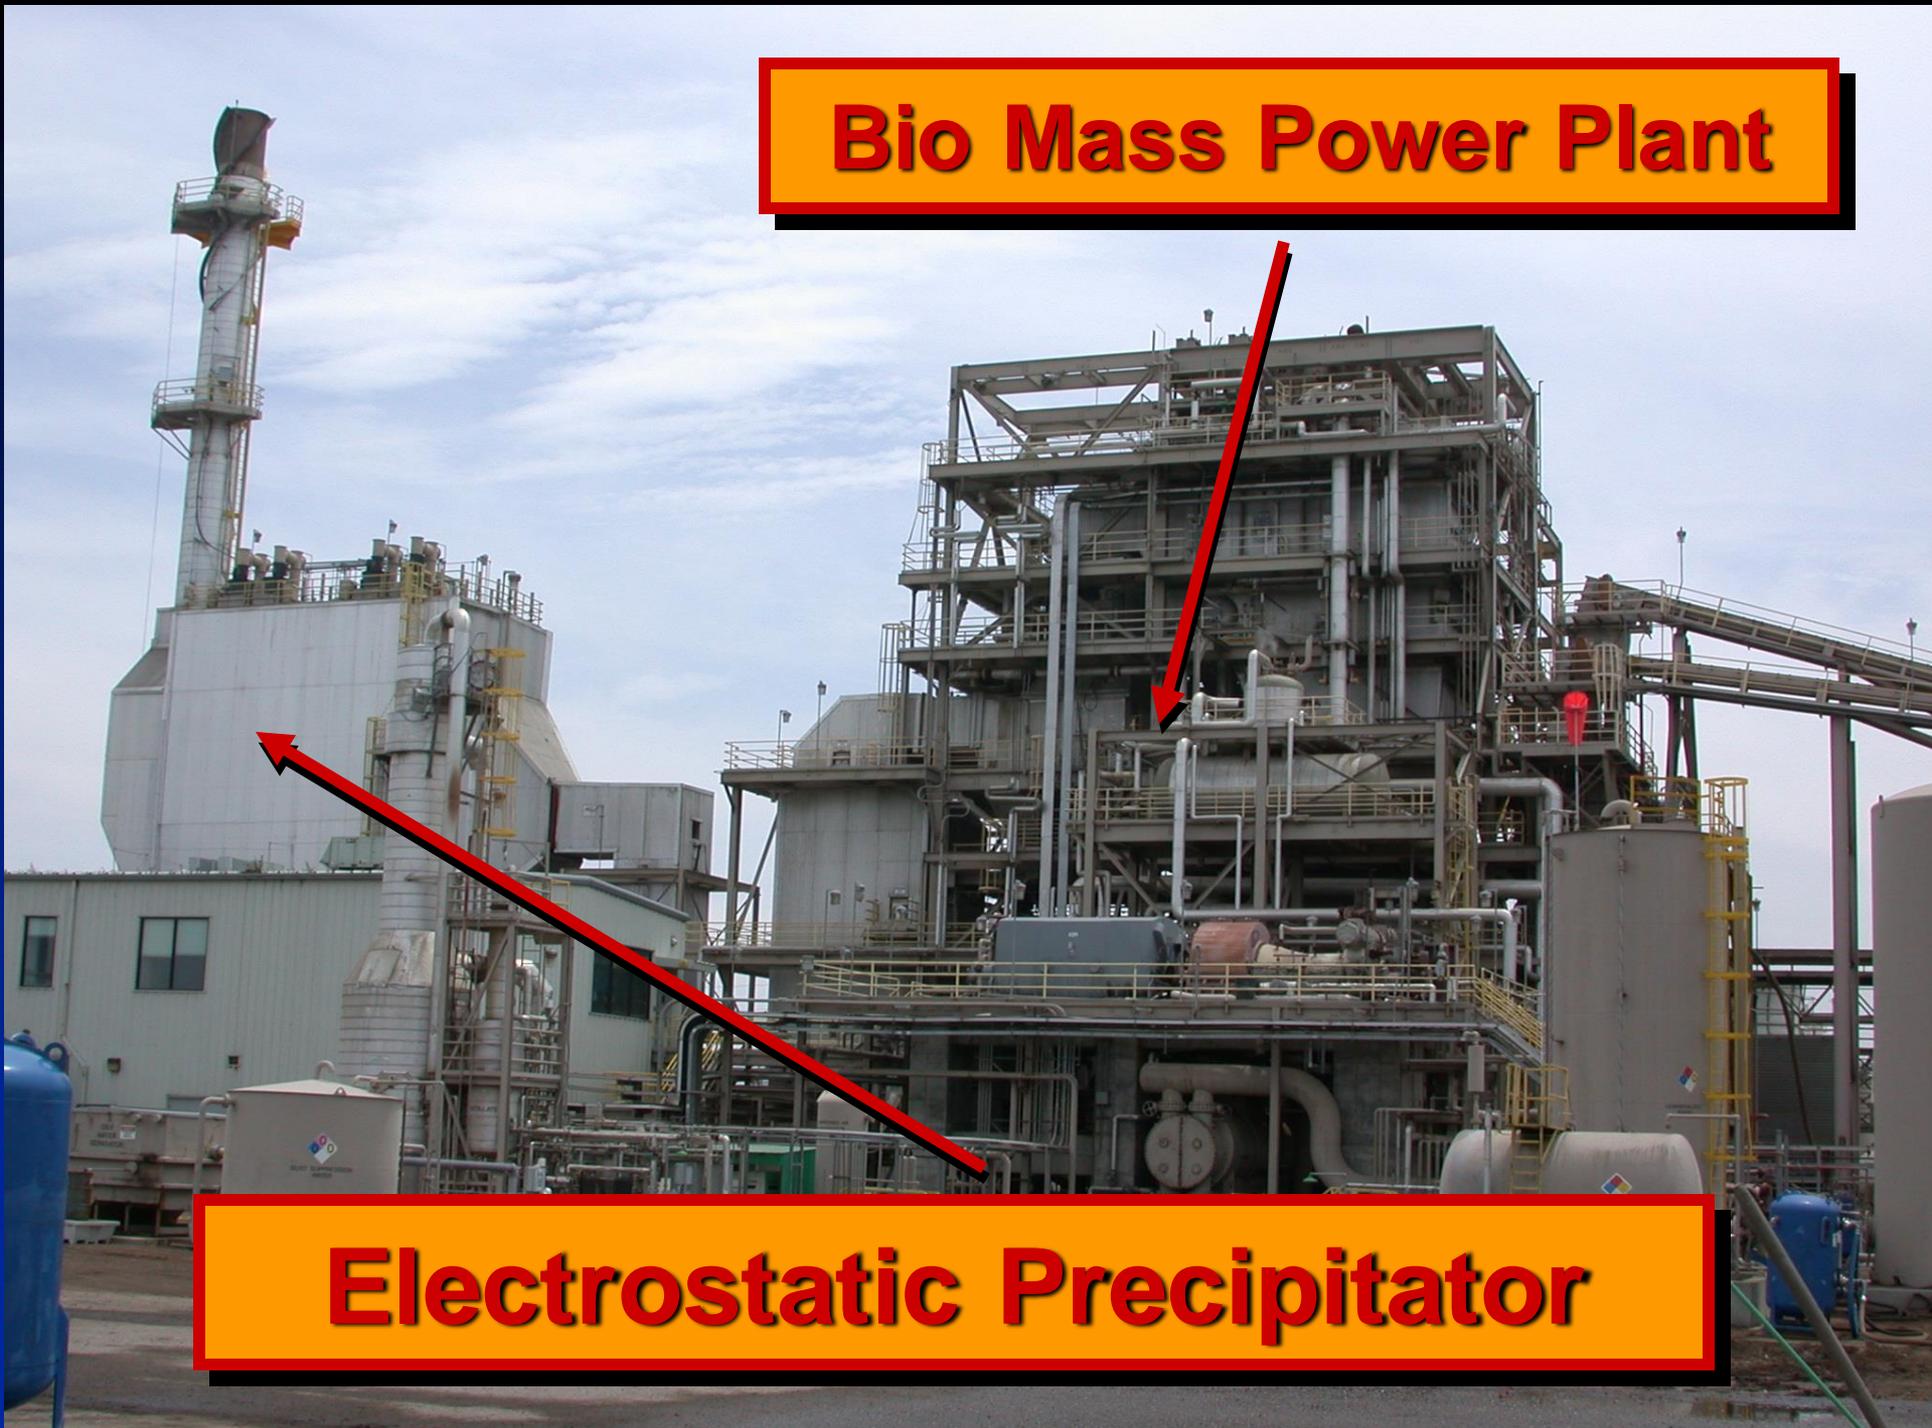


Electrostatic Precipitator

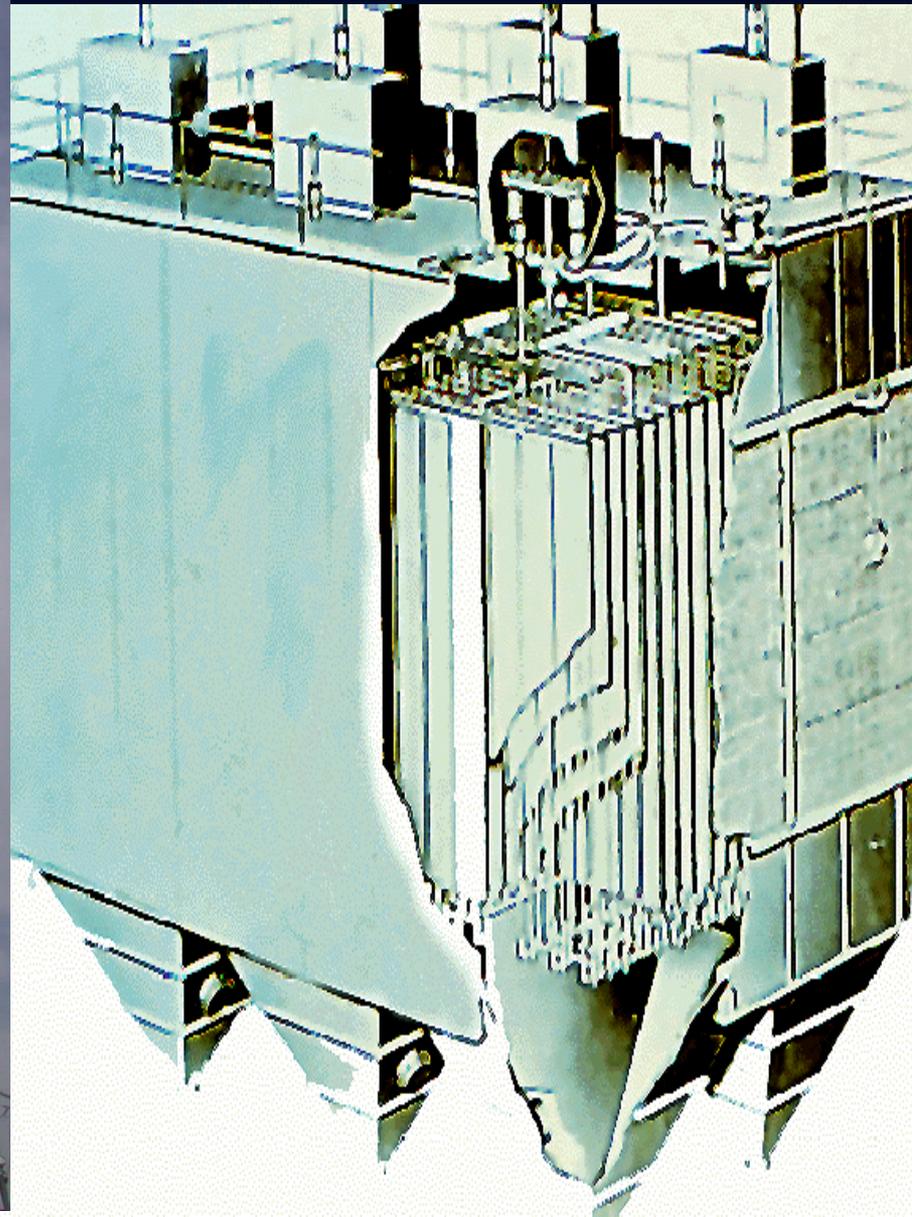



Electrical Field Generation

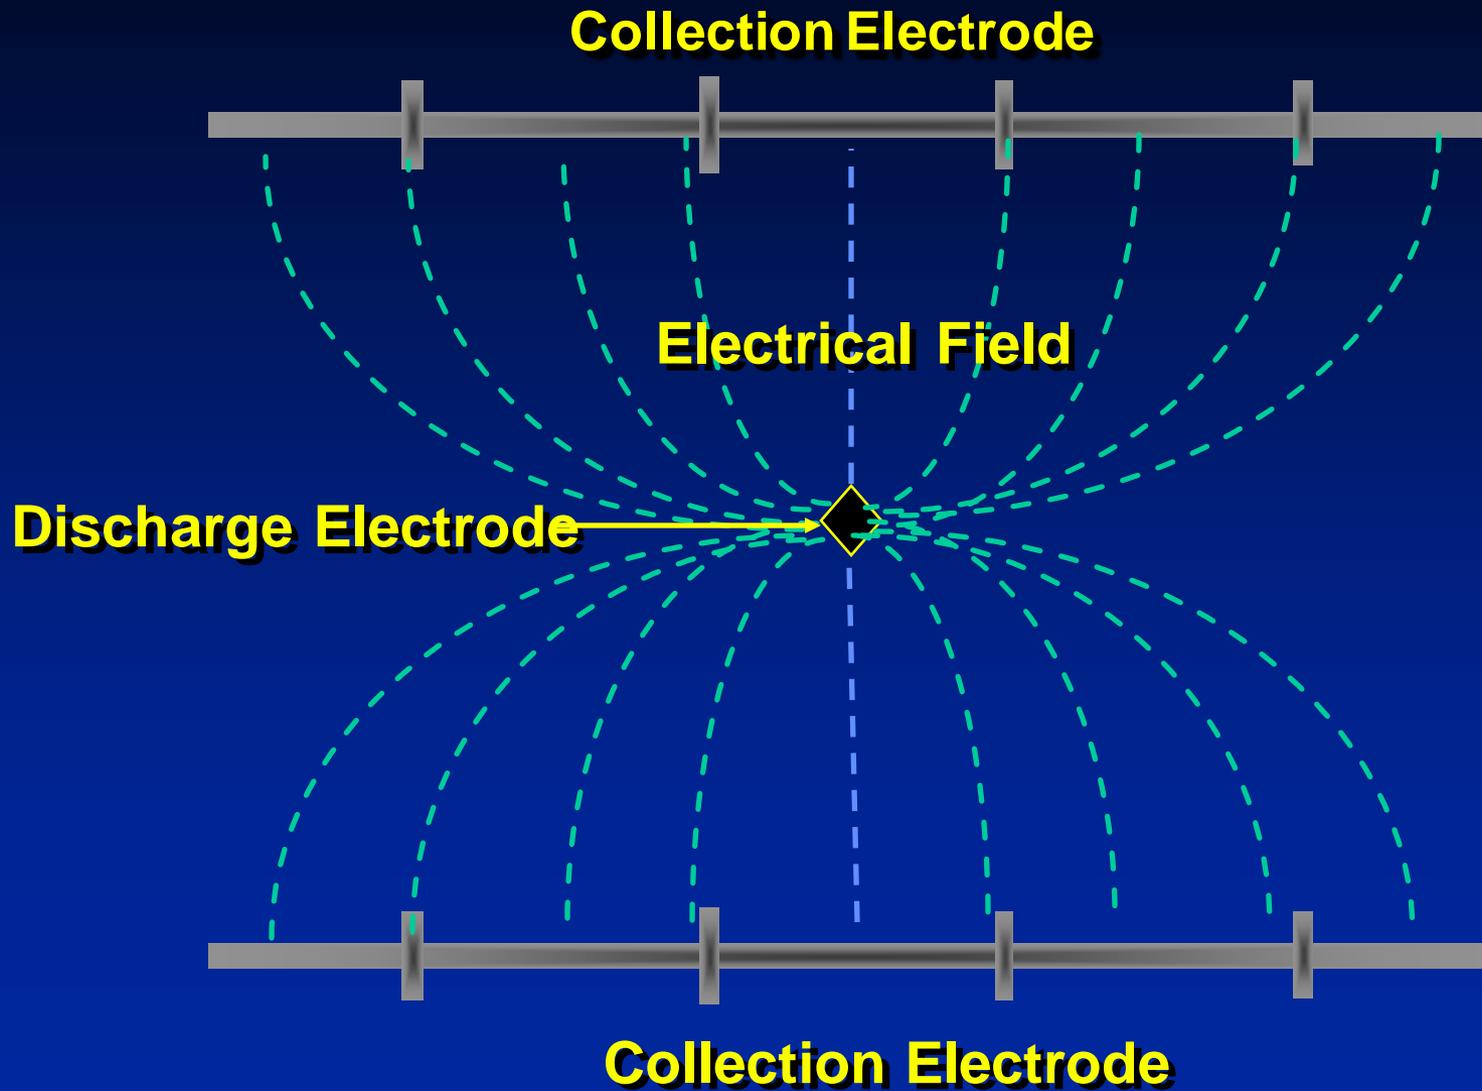

Electrostatic Precipitator

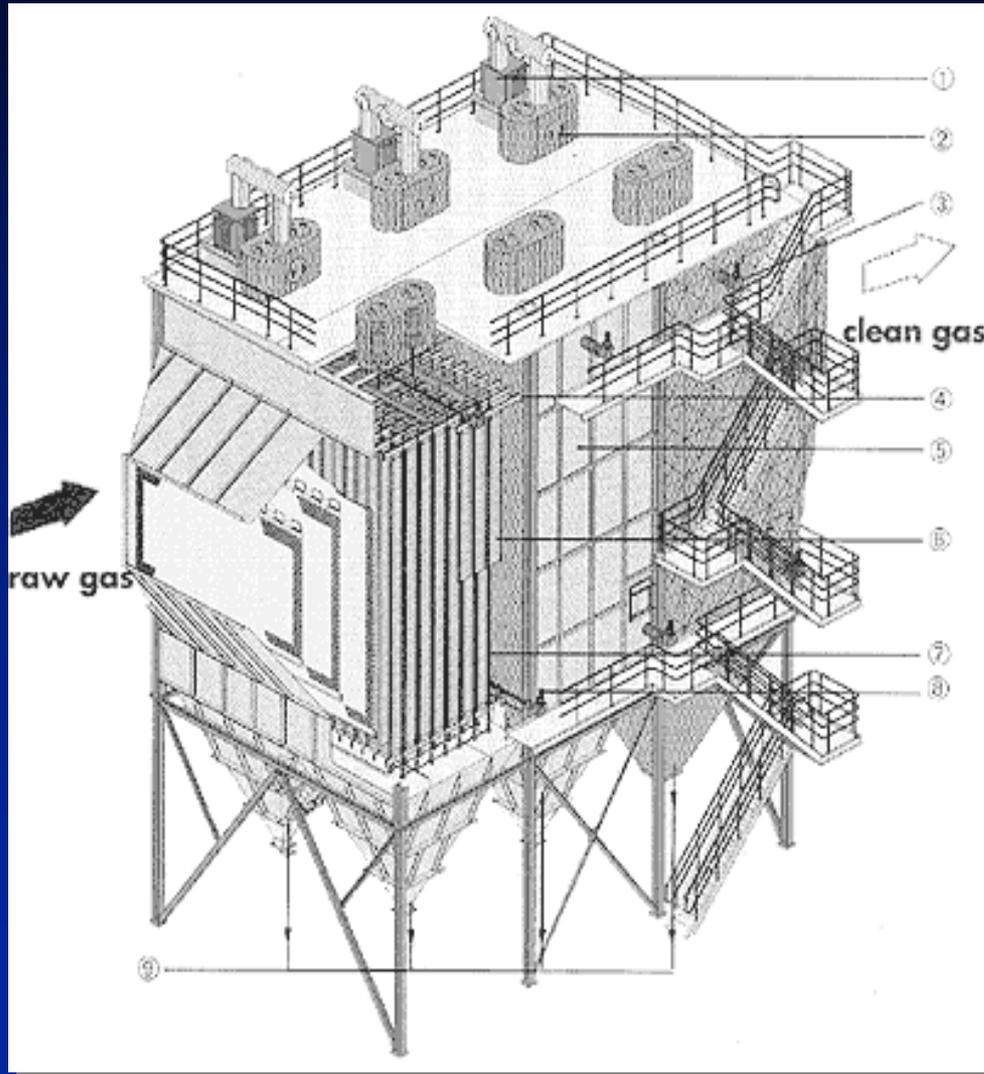


ELECTROSTATIC SCHEMATIC

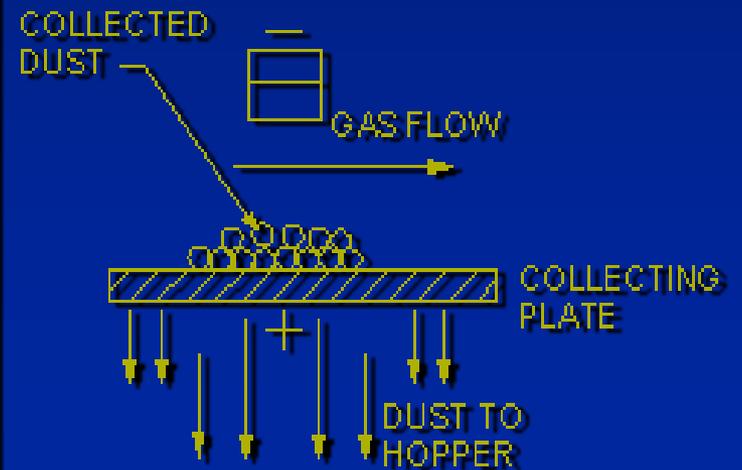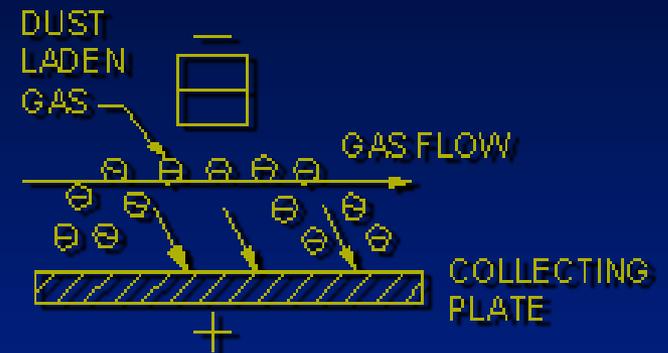

Corona

(voltage negative)

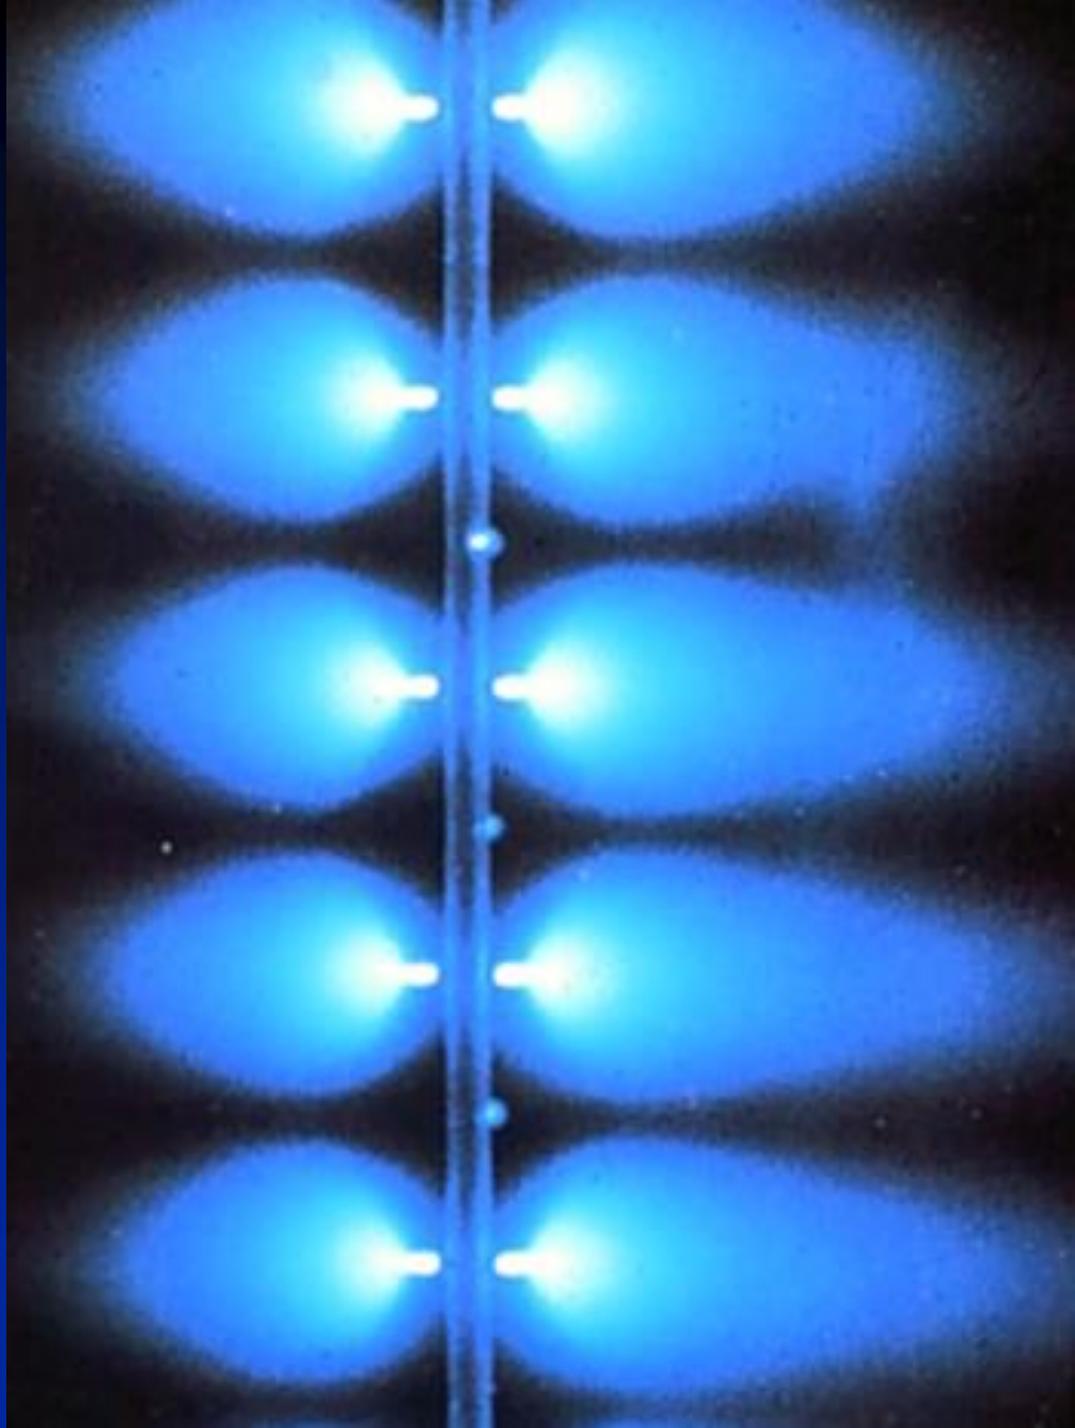

Avalanche Multiplication



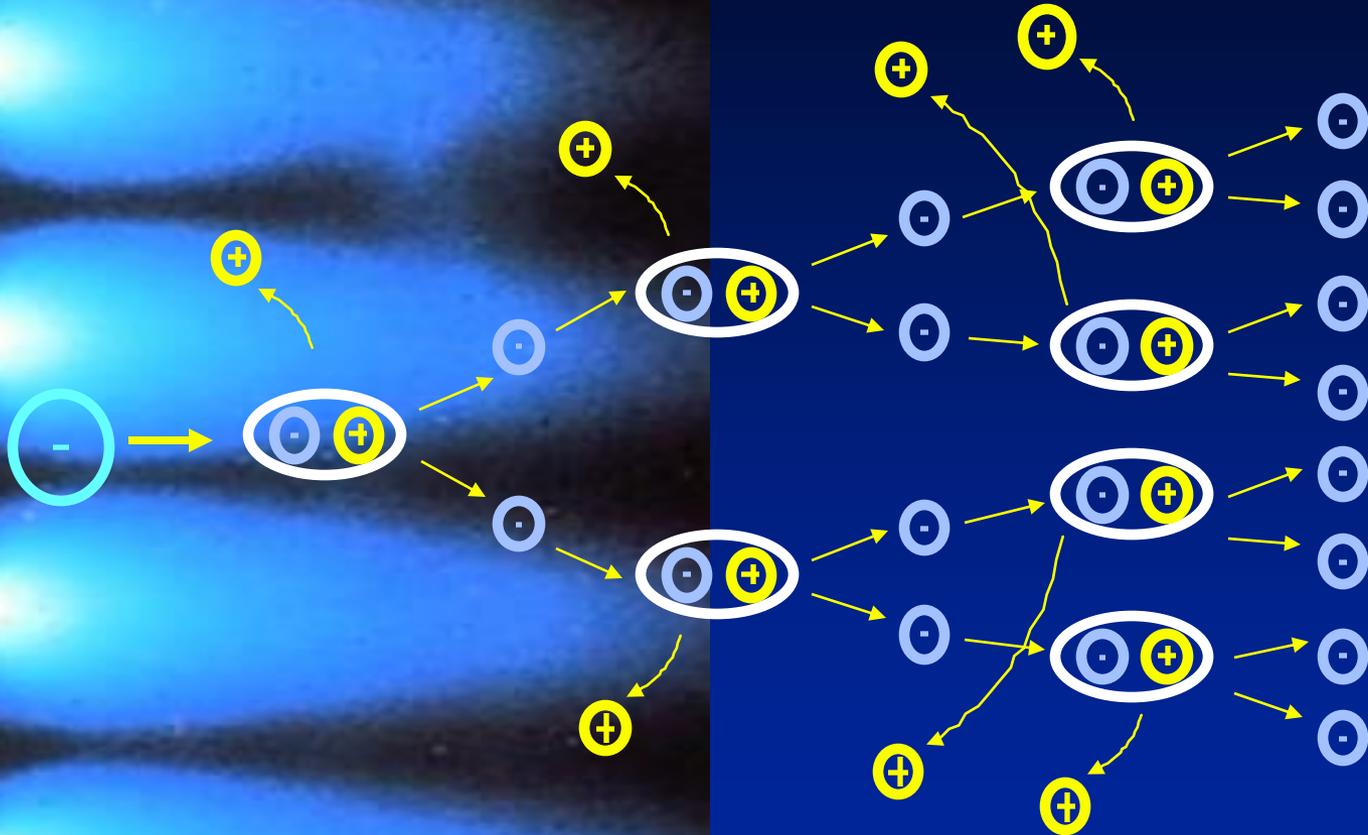



Figure 301.3

Field Charging

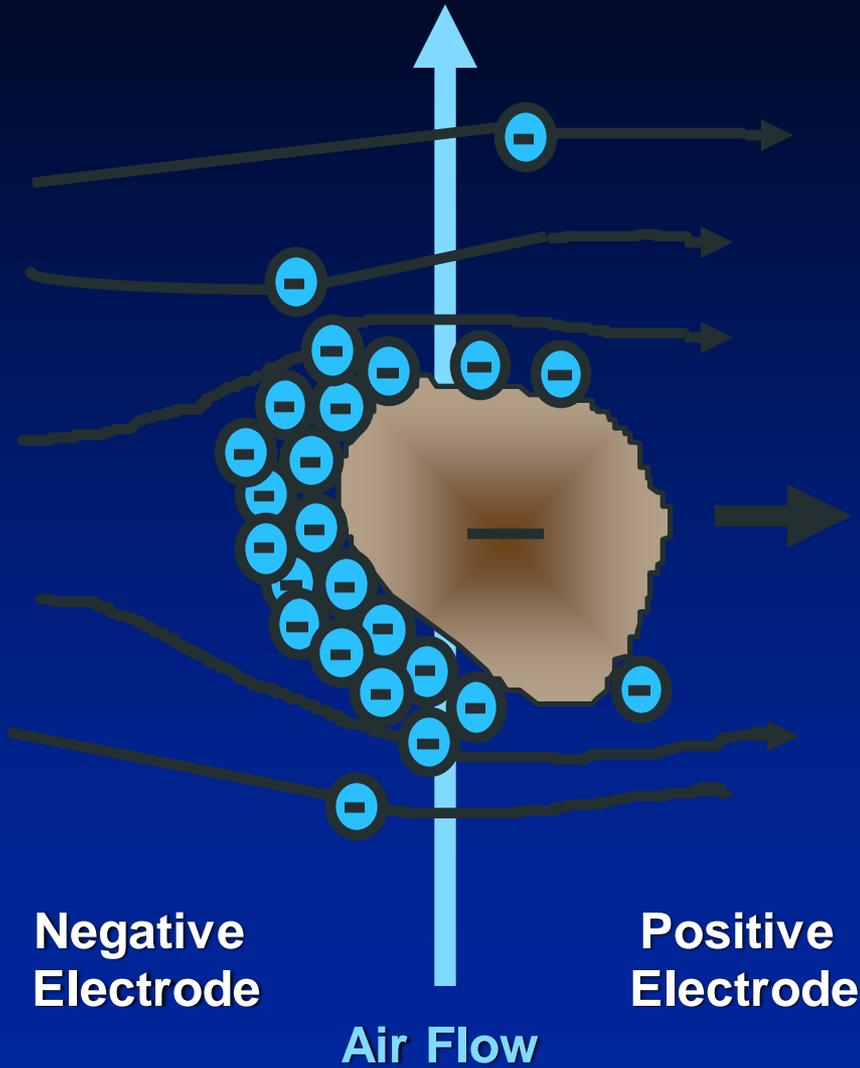

Diffusion Charging

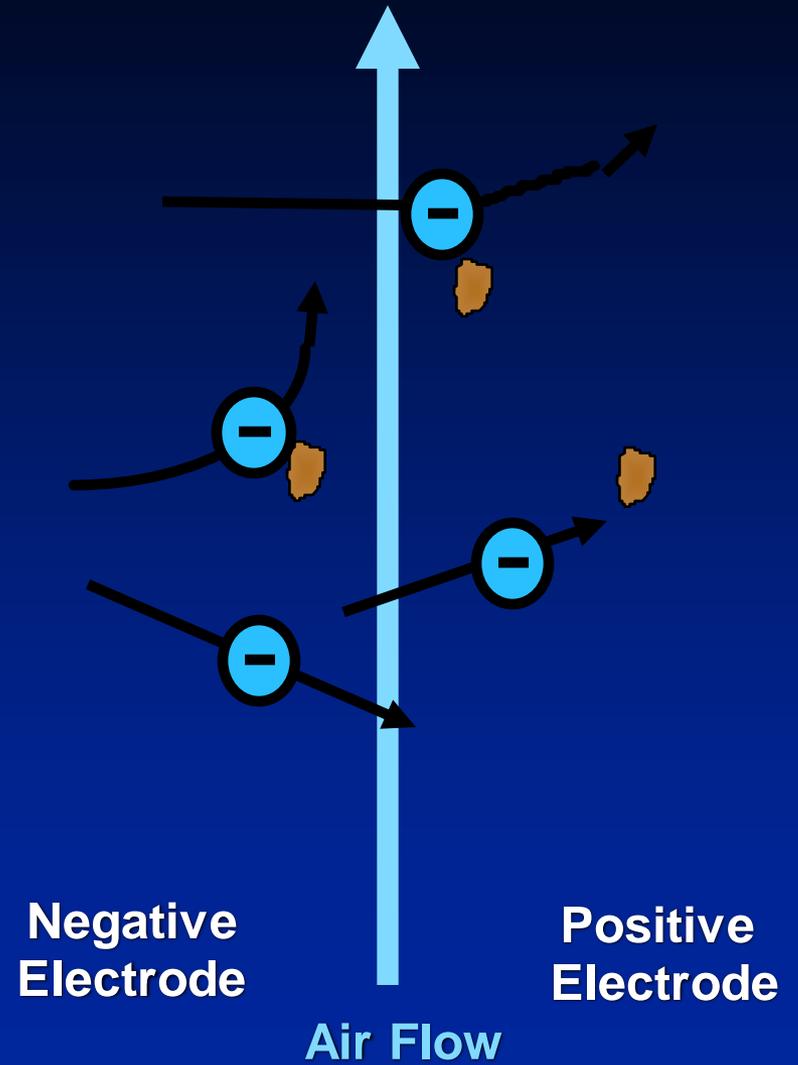

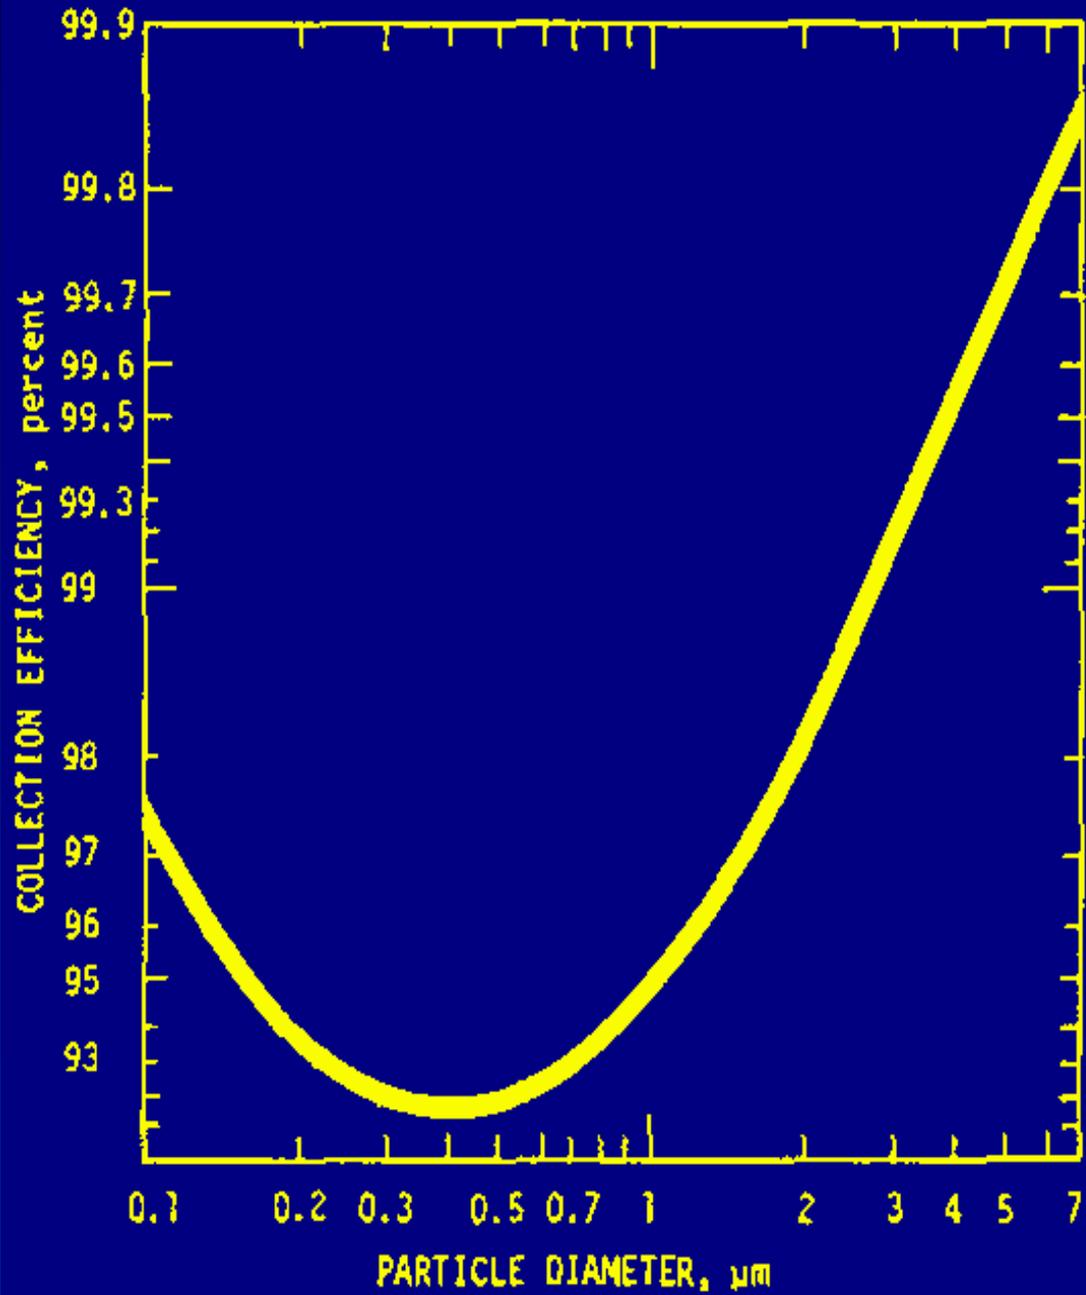

Particle Size & Collection Efficiency

Figure 305.5

Electrostatic Precipitator

- **General Description**

- **Two types**

- **Dry type use mechanical action to clean plates**

- **Wet type use water to prequench and to rinse plates**

Electrostatic Precipitator

- **General Description**
 - **High voltages are required**
 - **20,000 – 100,000 VDC**
 - **Multiple sections (fields) may be used**
 - **They usually can meet emission target with one field out of service or operating at reduced power**

Electrostatic Precipitator

- **General Description**
 - **High airflow rates**
 - 200,000 – 1,000,000 scfm
 - **High temperatures**
 - Up to 1,300 °F
 - **Pollutant Loading**
 - 1 – 50 grains/scfm

Electrostatic Precipitator

- A high voltage field creates a corona (current)
 - Particles are charged by electrons in the corona
 - The DC field draws charged particles to the plate
- Dust layers on the plates are cleared by mechanical rapping. Dust falls into the hoppers.
- Several fields in the direction of flow
 - Voltage/current to each is separately controlled
 - The first field collects most of the dust (75%)
 - Not much dust left in the last field

Mechanical Tumbling Hammer Rappers





Pneumatic Rappers


Magnetic Impulse Rappers



Electromagnetic Rapper



Control Efficiency - ESPs

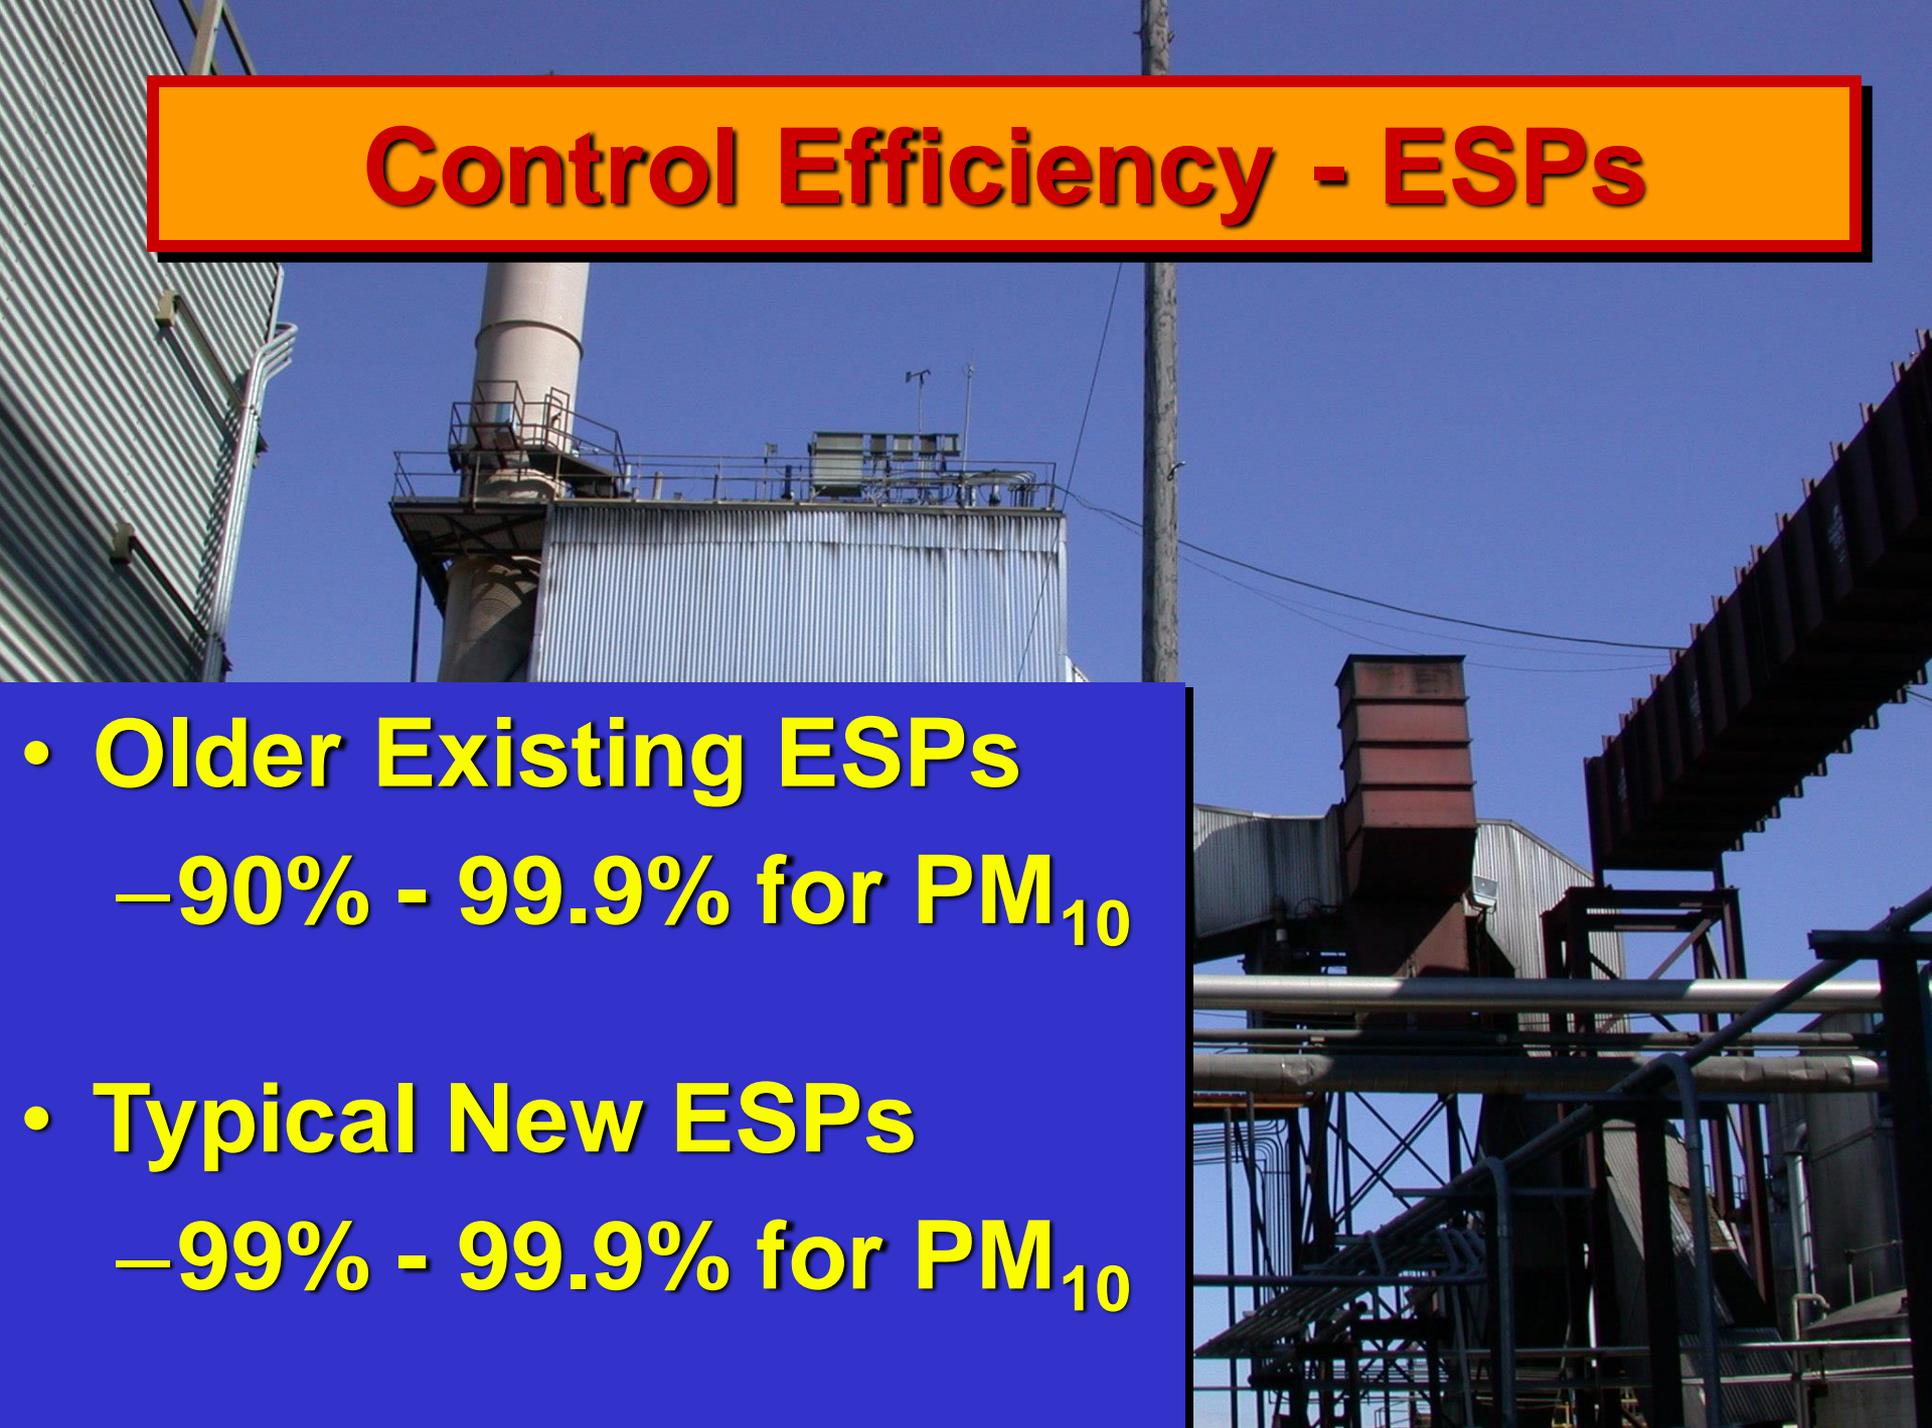The background image shows an industrial facility under a clear blue sky. On the left, a large building with corrugated metal siding is visible. In the center, a tall, cylindrical chimney stack rises from a platform. To the right, a complex network of pipes, walkways, and structural steel is visible, including a large, dark, rectangular structure that appears to be part of the air pollution control system.

- **Older Existing ESPs**
 - 90% - 99.9% for PM_{10}
- **Typical New ESPs**
 - 99% - 99.9% for PM_{10}

ESPs: Design Factors Affecting Performance

- **Specific Collection Area**
- **Aspect Ratio**
- **Collection Plate Spacing**
- **Sectionalization**
- **Power Requirements/Spark Rate**

Electrostatic Precipitator

- **Factors affecting efficiency**
 - **Gas temperature, humidity, flow rate**
 - **Particle resistivity**
 - **Fly ash/Fuel composition**
 - **Plate length**
 - **Surface area**

Electrostatic Precipitator

- **Factors affecting efficiency**
 - ESP is sensitive to gas flow rate
 - Flow monitoring may be appropriate
 - An ESP won't work well if the velocity distribution is not uniform.
- **ESP internal factors**
 - Dust layer thickness & electrical resistance.
 - Changes in geometry (damage)
 - Air leaks, condensation

Electrostatic Precipitator

Baseline operating and emission data is needed to establish:

- Emissions level and control capability at max gas flow.**
 - Does it work as intended?**
 - Typical secondary current and voltage levels**
- Operating margin - number of fields and power required to meet emission requirements.**
- Normal operating temperature.**

Electrostatic Precipitator

- **Performance indicators**
 - **Outlet opacity (VEE)**
 - **Pressure differential**
 - **Outlet PM concentration (COMS)**
 - **Secondary corona power (current & voltage)**
 - **Spark rate**
 - **Primary power (current & voltage)**

ESP: Performance Indicators

DIGICON OPTIPULSE CONTROLLER

POWER ON

LIMIT

- SECONDARY VOLTAGE
- PRIMARY CURRENT
- SECONDARY CURRENT
- FULL CONDUCTION
- OPACITY
- BACK CORONA

MODE

- SPARK
- PULSE
- TEST
- REMOTE
- TRIP
- ERROR

70 SET
57 ACTUAL

SEC V	SPARK	PULSE
62	040	OFF
55	001	---

KV SPM CYCLE ON / OFF

SECONDARY VOLTAGE LIMIT SPARK RATE LIMIT OPTIPULSE ENABLE

Electrostatic Precipitator

- **Performance indicators (cont.)**
 - **Inlet gas temperature**
 - **Gas flow rate**
 - **Rapper operation**
 - **Fields in operation**
 - **Inlet water flow rate (wet type)**
 - **Flush water solids content (wet type)**

Summary of ESP Monitoring


- **Obtain convincing baseline emissions data**
 - **Linked to flow rate, power levels and type of fuel**
- **Key monitoring parameters**
 - **Opacity**
 - **Electrical power levels (Secondary I & V)**
- **Secondary parameters**
 - **Temperature**
 - **Fuel composition**
 - **Inspection & routine maintenance**



**ESP:
Soot
Blowing
&
Opacity**

ESP : Secondary Containment



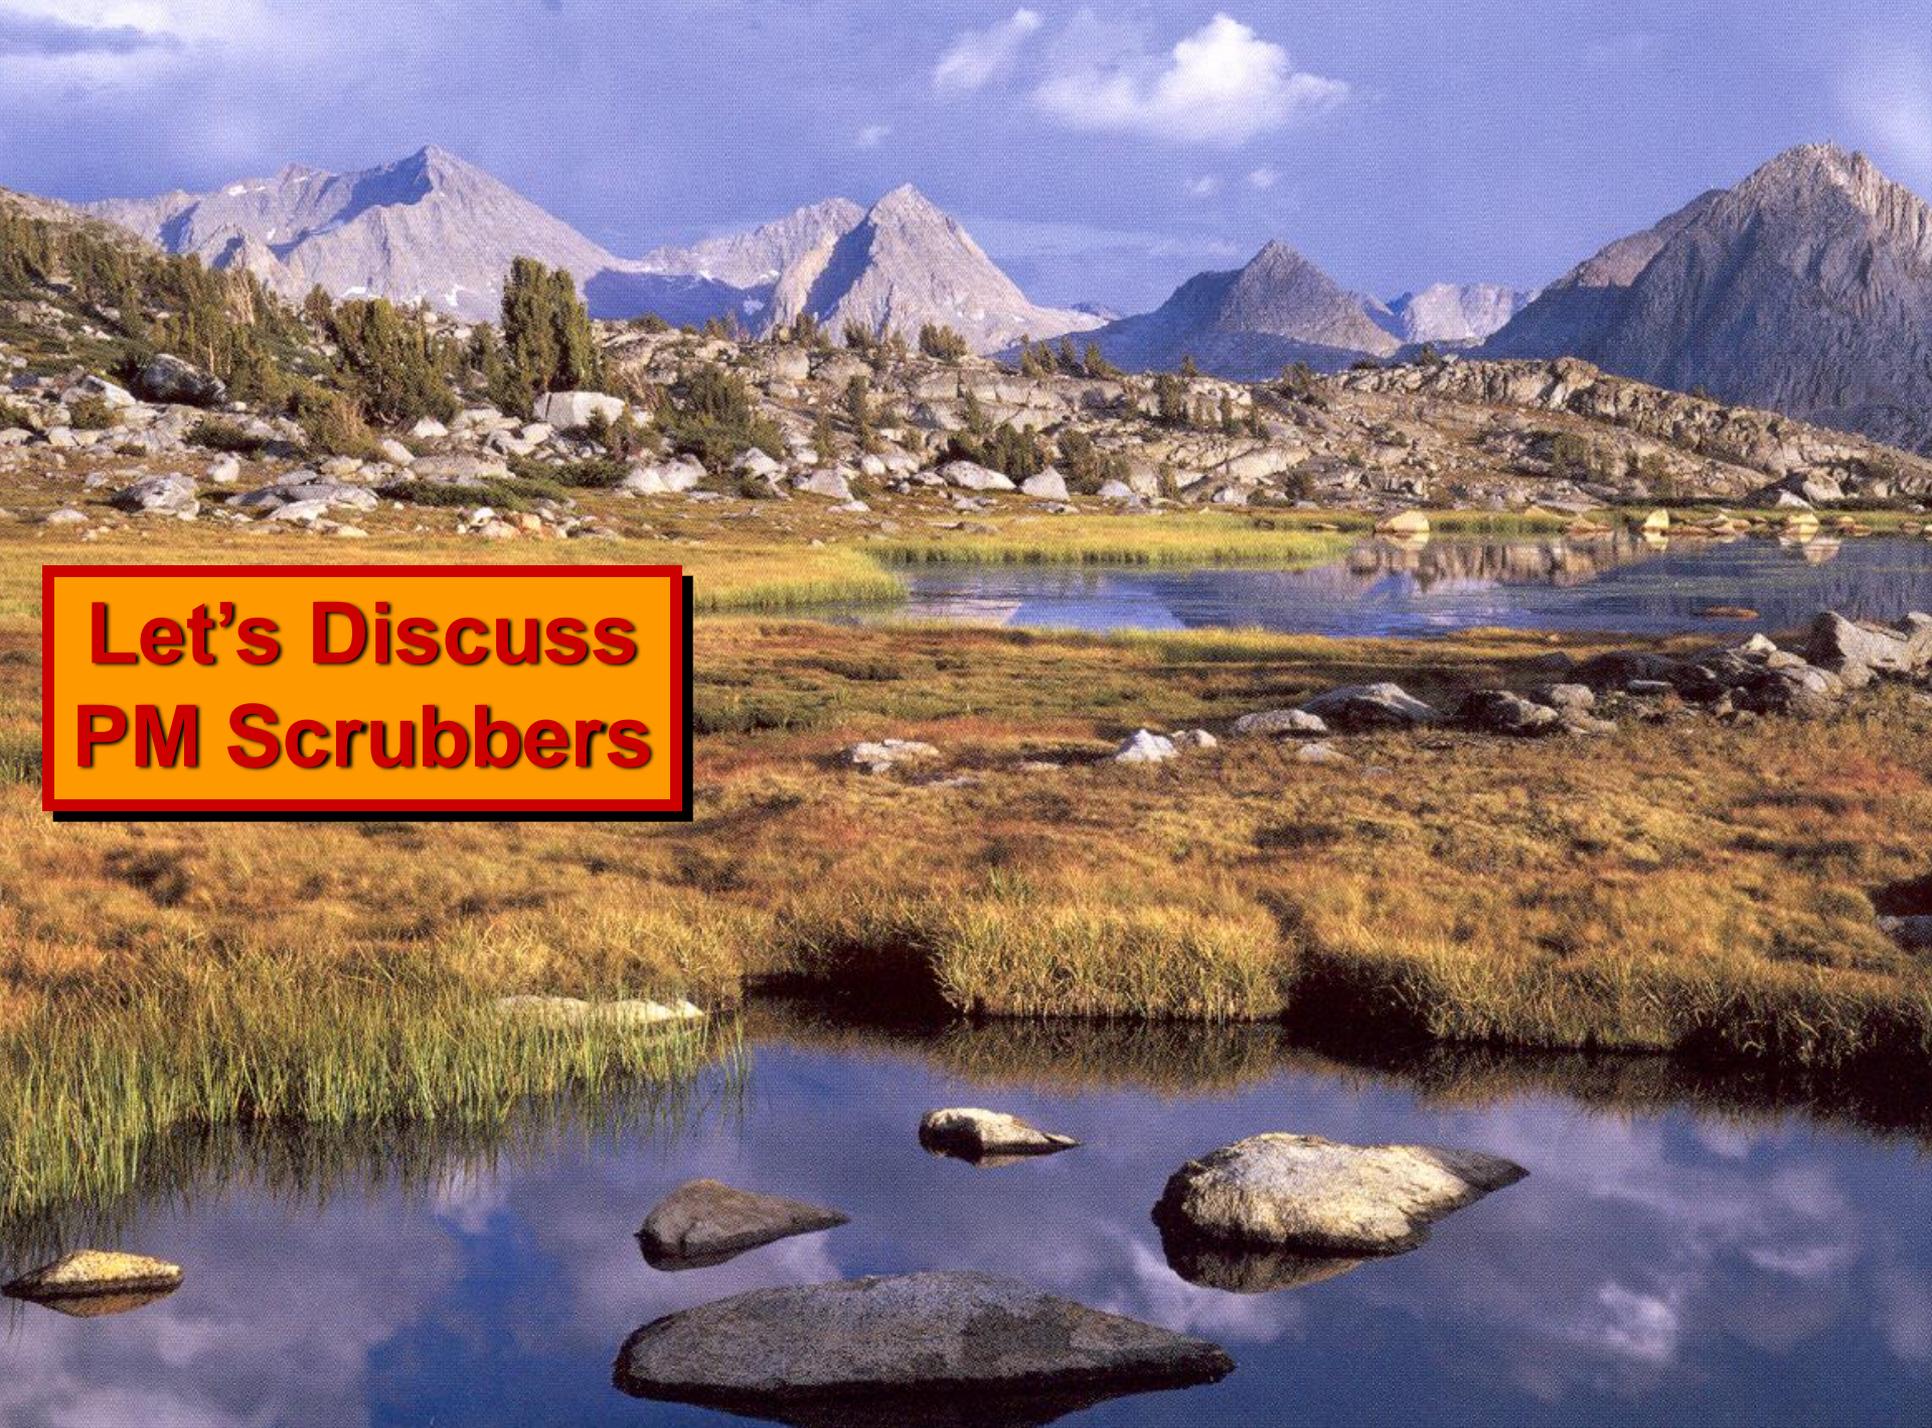


**Let's Discuss
PM Scrubbers**

Control Techniques – Wet Scrubber

- **General description**
 - **Particles (and gases) get trapped in liquids**
 - **Inertial impaction and diffusion**
 - **Liquids must contact pollutants and dirty liquids must be removed from exhaust gas**
 - **Four types**
 - **Spray; venturi or orifice; spray rotors; and moving bed or packed towers**



**Venturi
Scrubber**

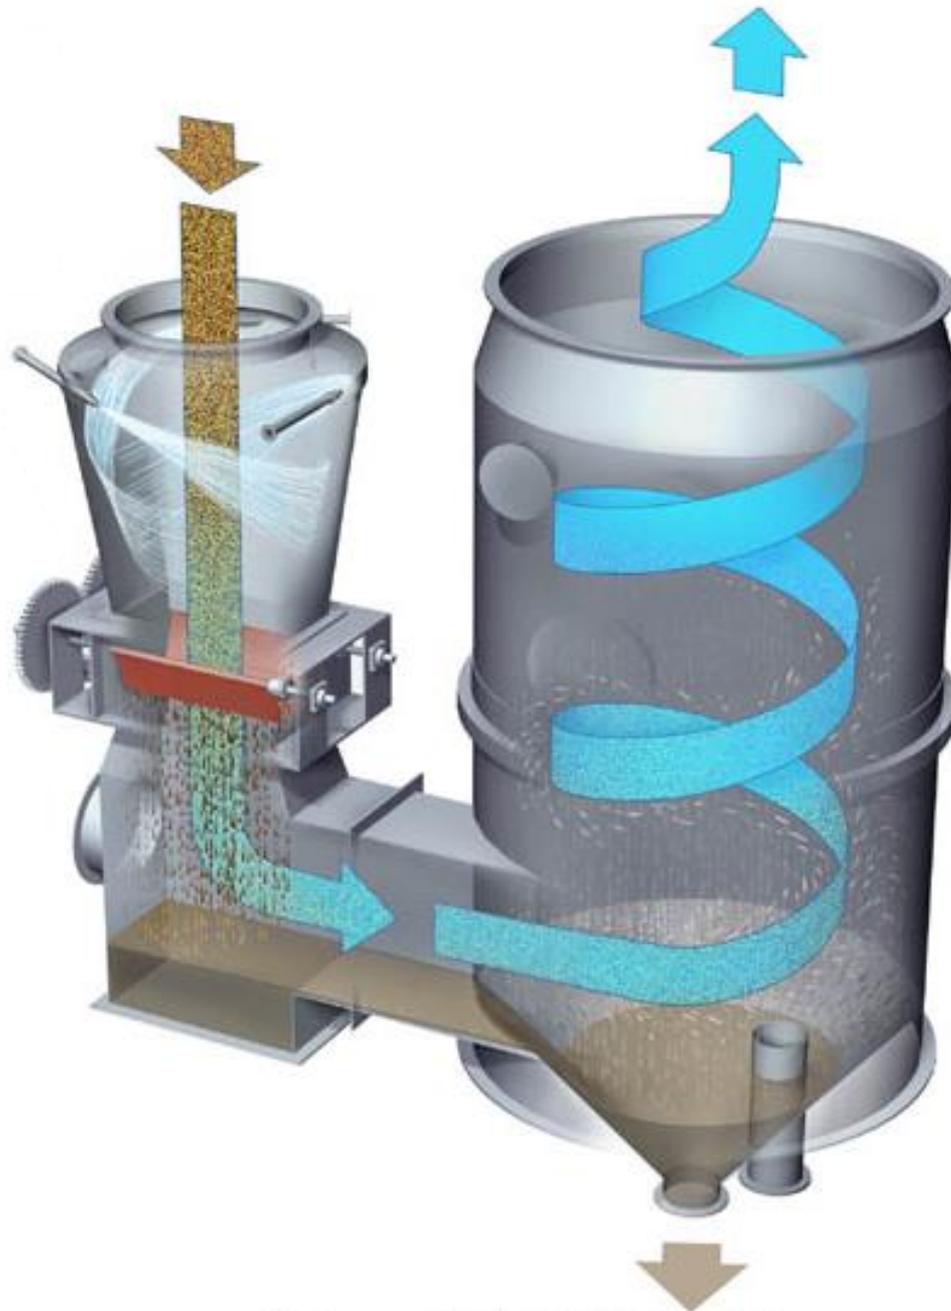


Venturi Scrubber

Wet Scrubber Operation

- **Particles collected by impaction**
- **Gasses collected by diffusion & absorption**

Packed Bed Scrubber

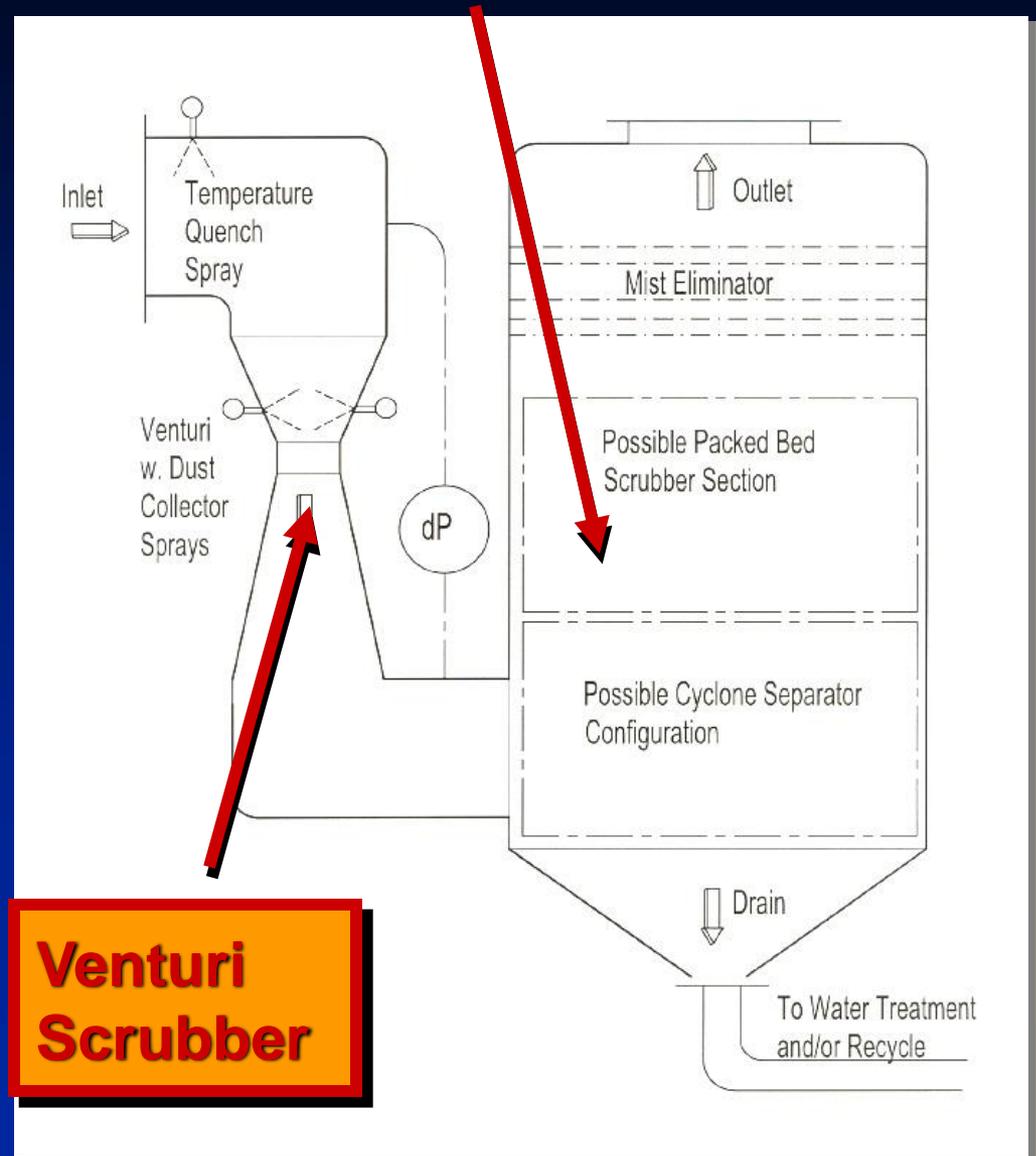

Venturi Scrubber

Venturi Scrubbers

- Control Efficiency
 - 70 - 99% for PM₁₀
- Moderate airflow rates
 - 500 – 100,000 scfm
- Moderate temperatures
 - Up to 750 °F
- Pollutant Loading
 - 0.1 – 50 grains/scfm

Scrubber Control Efficiency

- **Factors affecting efficiency**
 - **Gas and liquid flow rate**
 - **Condensation of aerosols**
 - **Poor liquid distribution**
 - **High dissolved solids content in liquid**
 - **Nozzle erosion or pluggage**
 - **Re-entrainment**
 - **Scaling**

Scrubber Monitoring


- **Venturi pressure drop (ΔP)**
 - **The higher the ΔP the smaller the collected particles**
 - **Some venturis have adjustable vanes**
- **Water flow rate (gallons/min)**
 - **Flow below a critical level will degrade performance.**
- **Water cleanliness – evaporated residue & mist carryover.**

Scrubber Performance

- **Performance indicators**
 - **Pressure differential**
 - **Liquid flow rate**
 - **Gas flow rate**
 - **Scrubber outlet gas temperature**
 - **Makeup / blowdown rates**
 - **Scrubber liquid solids content (PM)**

Scrubber Performance

- **Performance indicators (continued)**
 - Scrubber inlet gas and process exhaust gas temperature (PM)
 - Scrubber liquid pH (Acid gas)
 - Neutralizing chemical feed rate (Acid gas)
 - Scrubber liquid specific gravity (Acid gas)

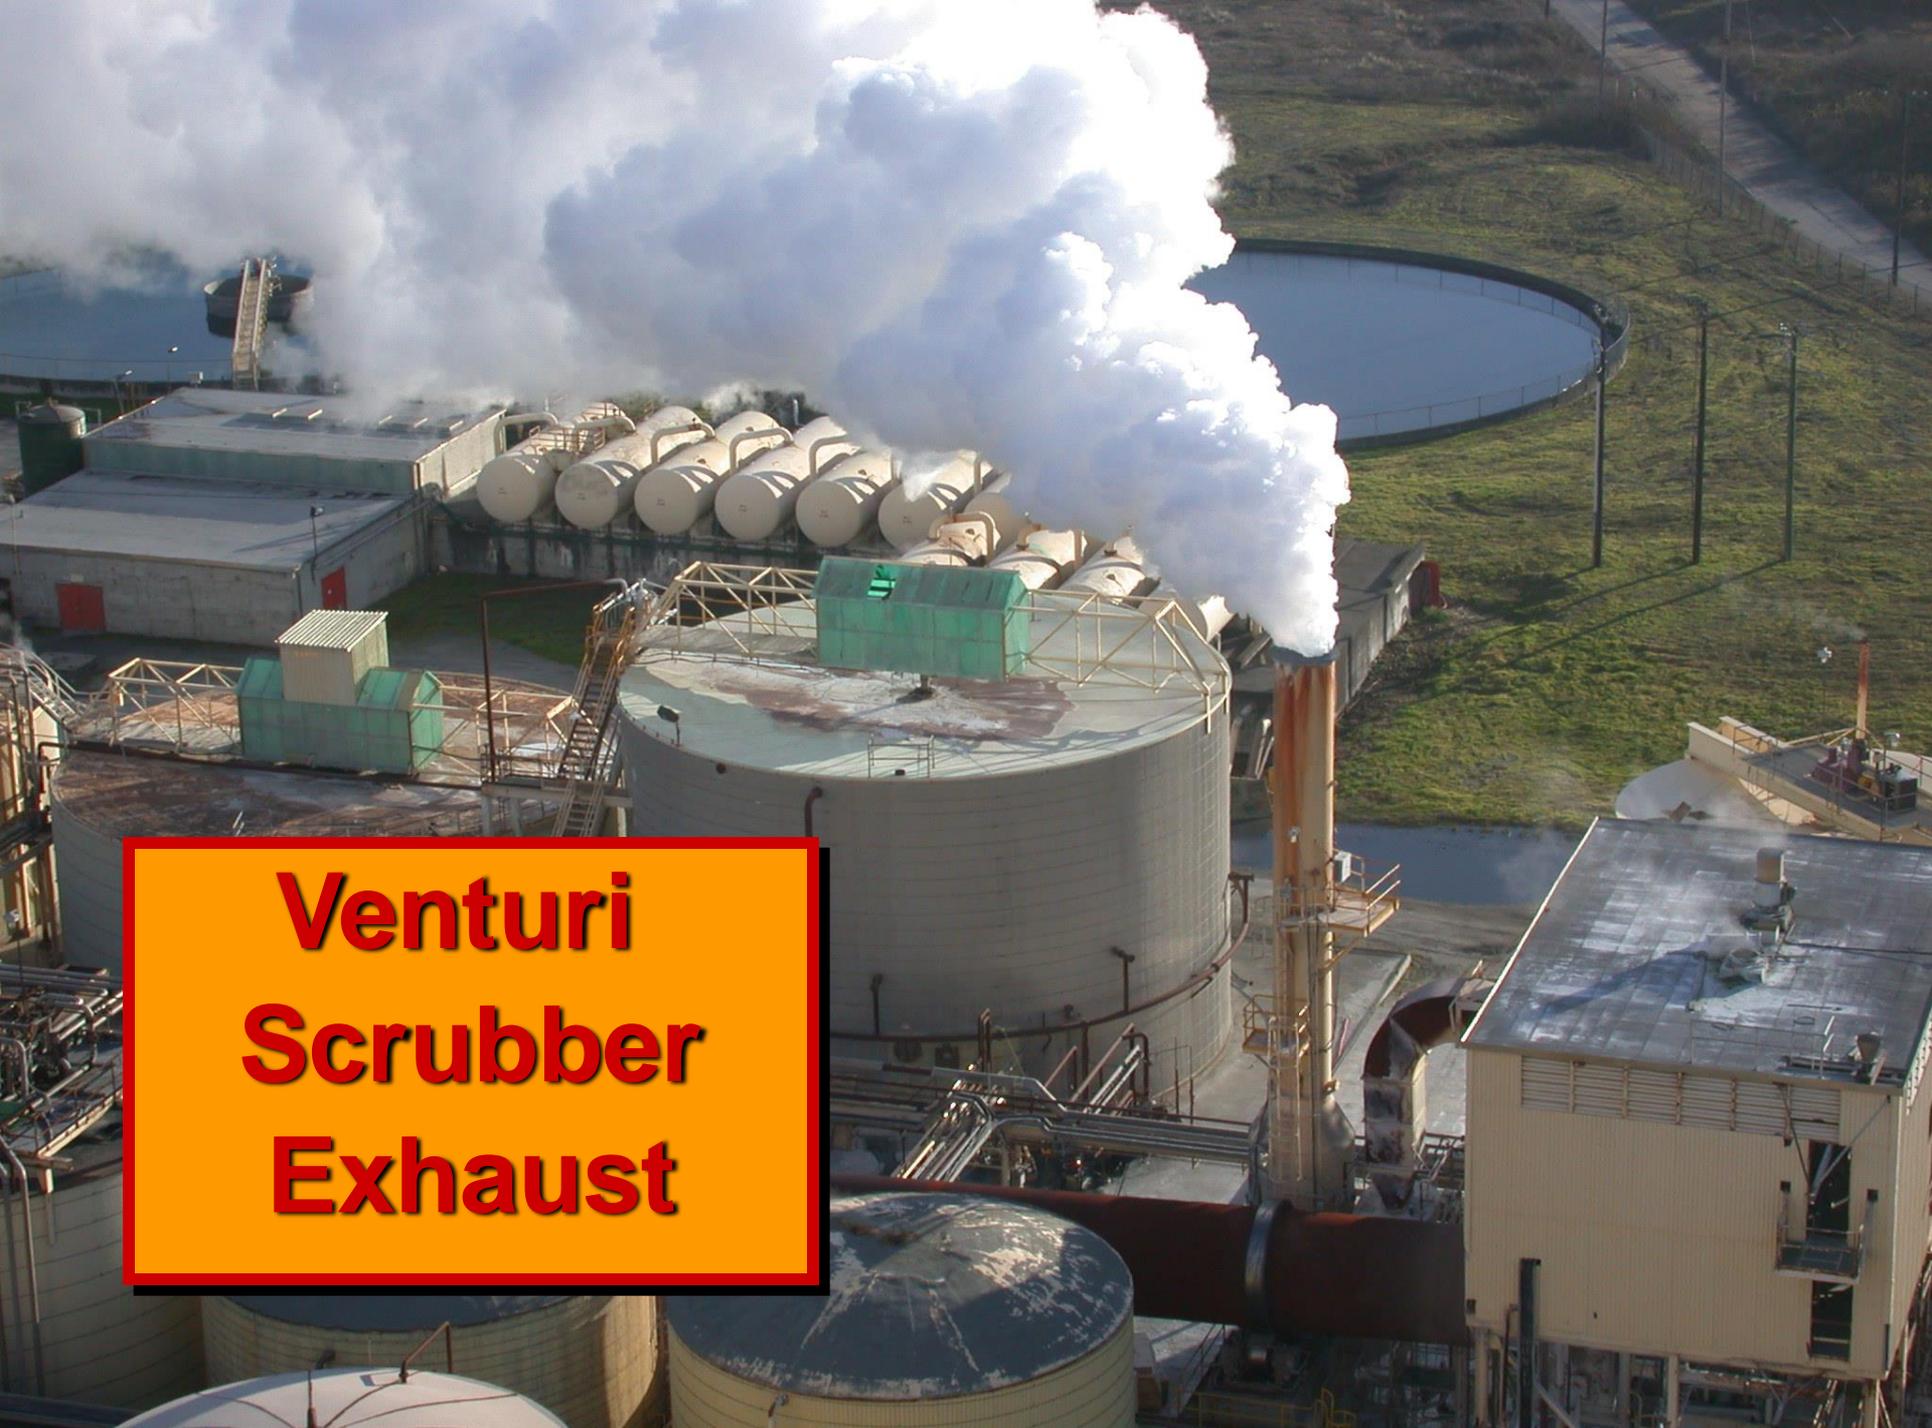

**Venturi
Scrubber
Exhaust**


Let's Discuss Diesel Particulate Filters






Diesel Particulate Filter (DPF)


e Filter

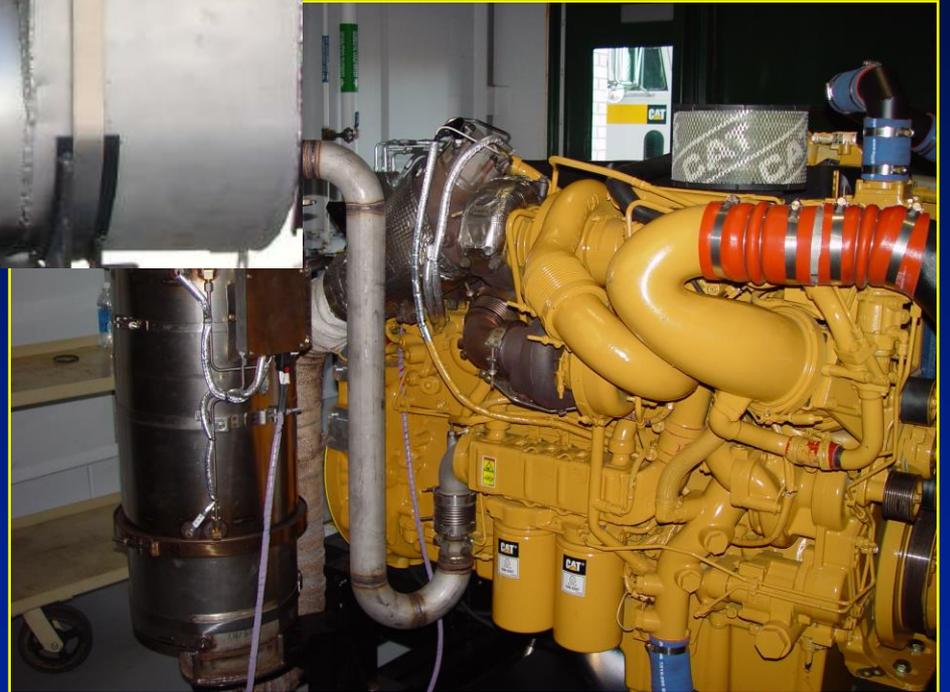

What is a DPF

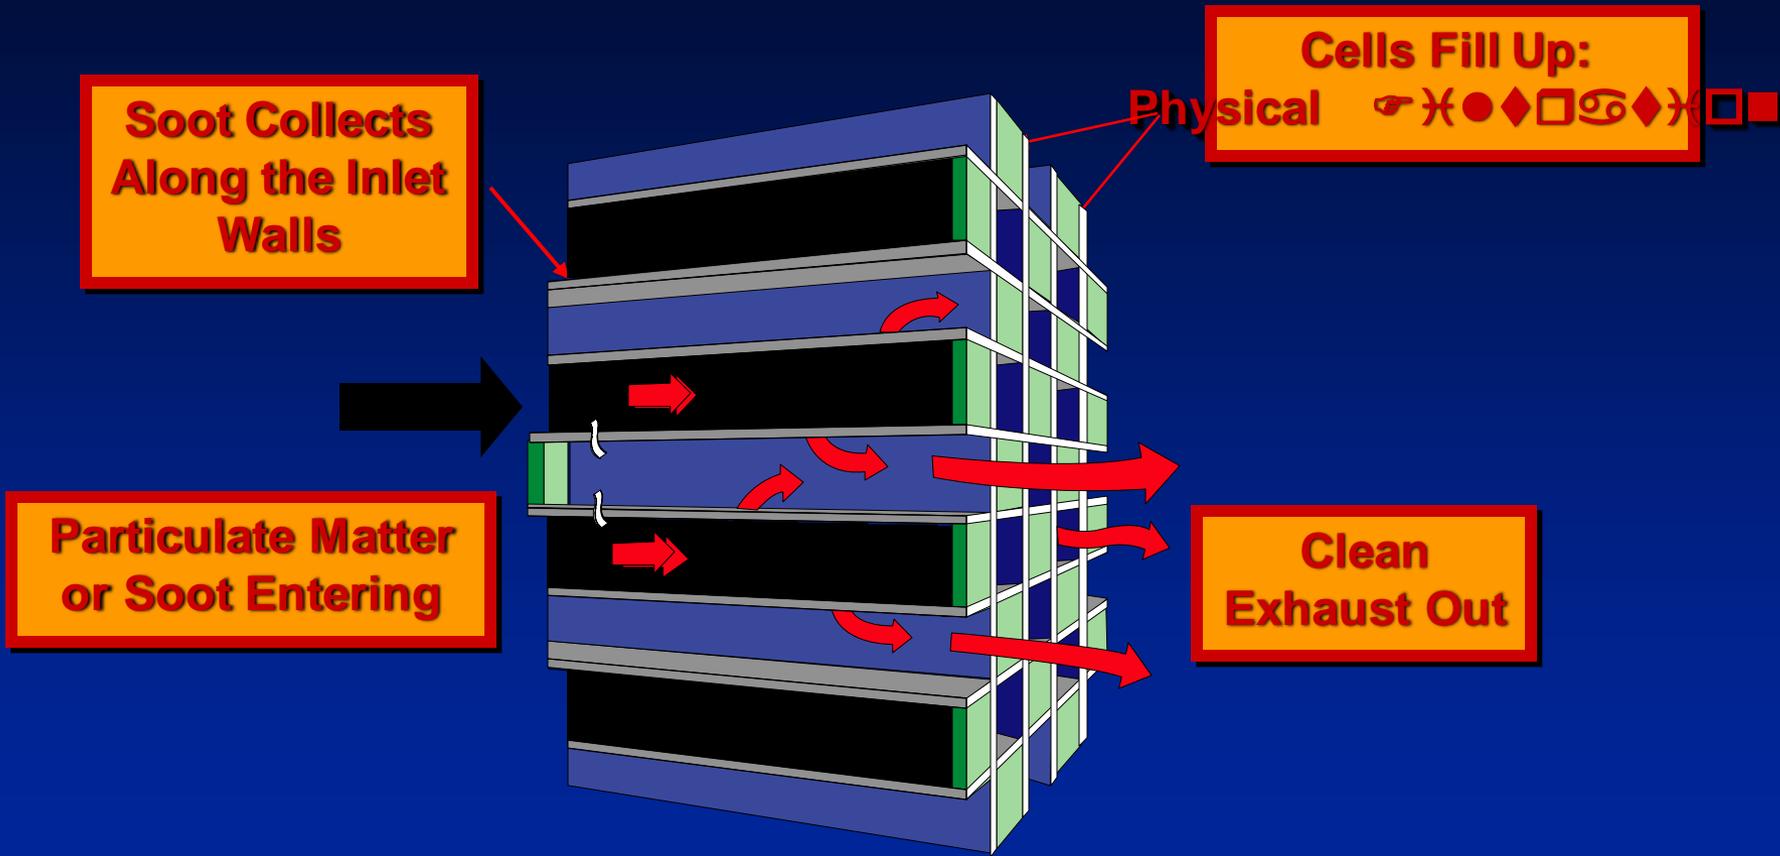

What is a DPF

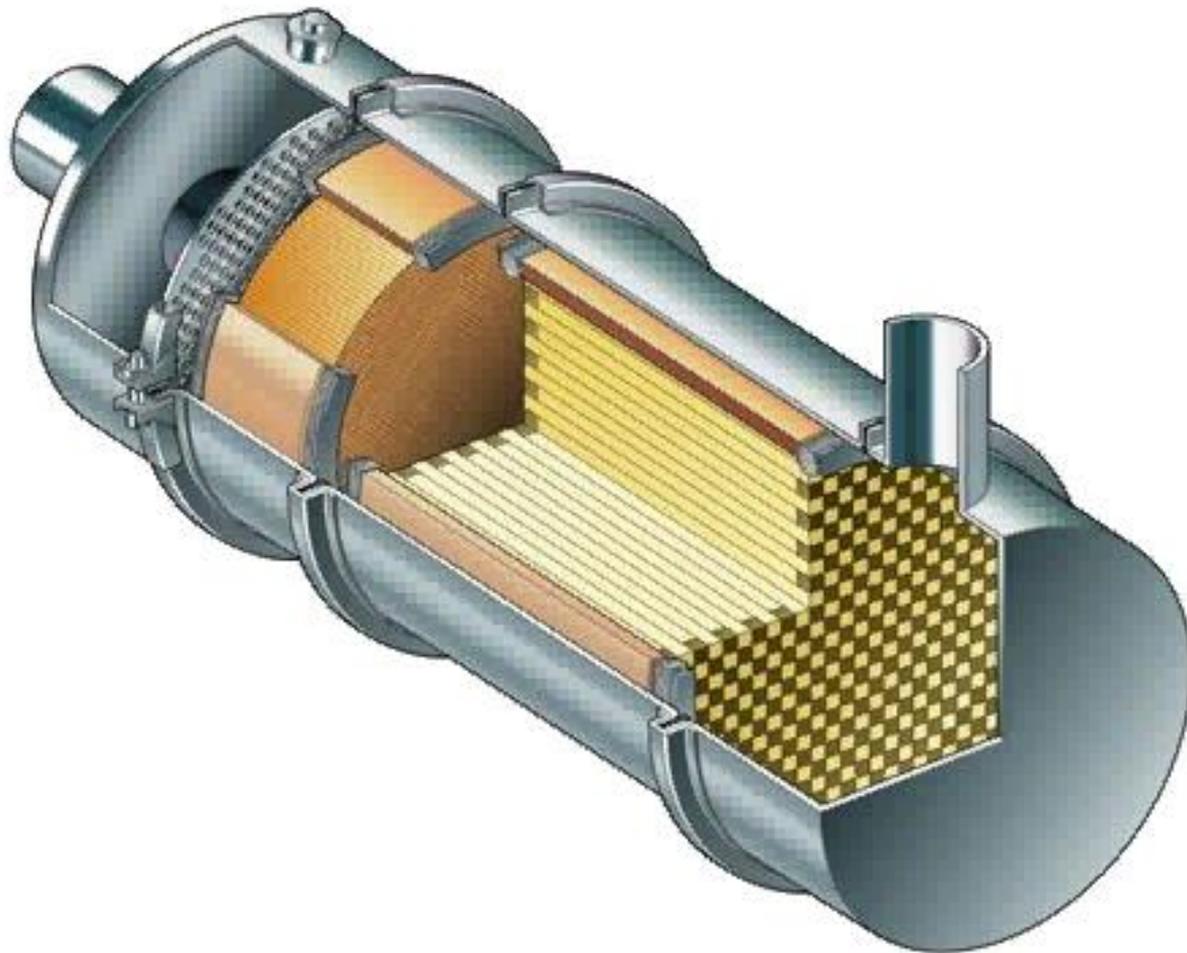

Regeneration Strategies

Active

Passive



Diesel Particulate Filter (DPF)

- ◆ High temperature regeneration (600-650 °C)
 $C + O_2 \rightarrow CO_2$
- ◆ Catalytic regeneration (~250 °C)
- ◆ Oxidize NO to NO₂ → adsorbs → reduces regeneration temperature
- ◆ Fuel-borne catalyst
- ◆ Ceramic coatings
- ◆ Engine adjustments necessary
- ◆ Total PM efficiency > 90%


Active Regeneration

- **Achieving 550°C**
 - **Electrical Heater**
 - **Dosing (flame front)**



Electrical Heater

- **Uses a heating element similar to an electric stove**
- **Performed while vehicle is offline**

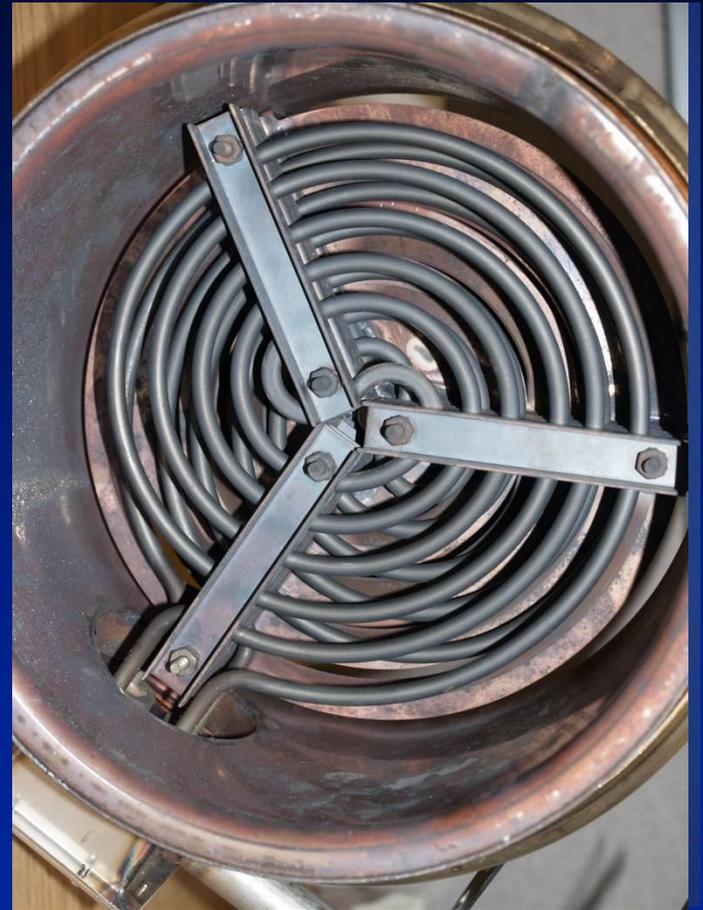



City Bus

Electrical Active Regeneration Cycle




Portable On-Board



Fuel Dosing


- **Auxilliary Fuel Injector**
 - Taps into vehicle's fuel system
 - Utilizes a blower for fresh air
 - Fuel Penalty

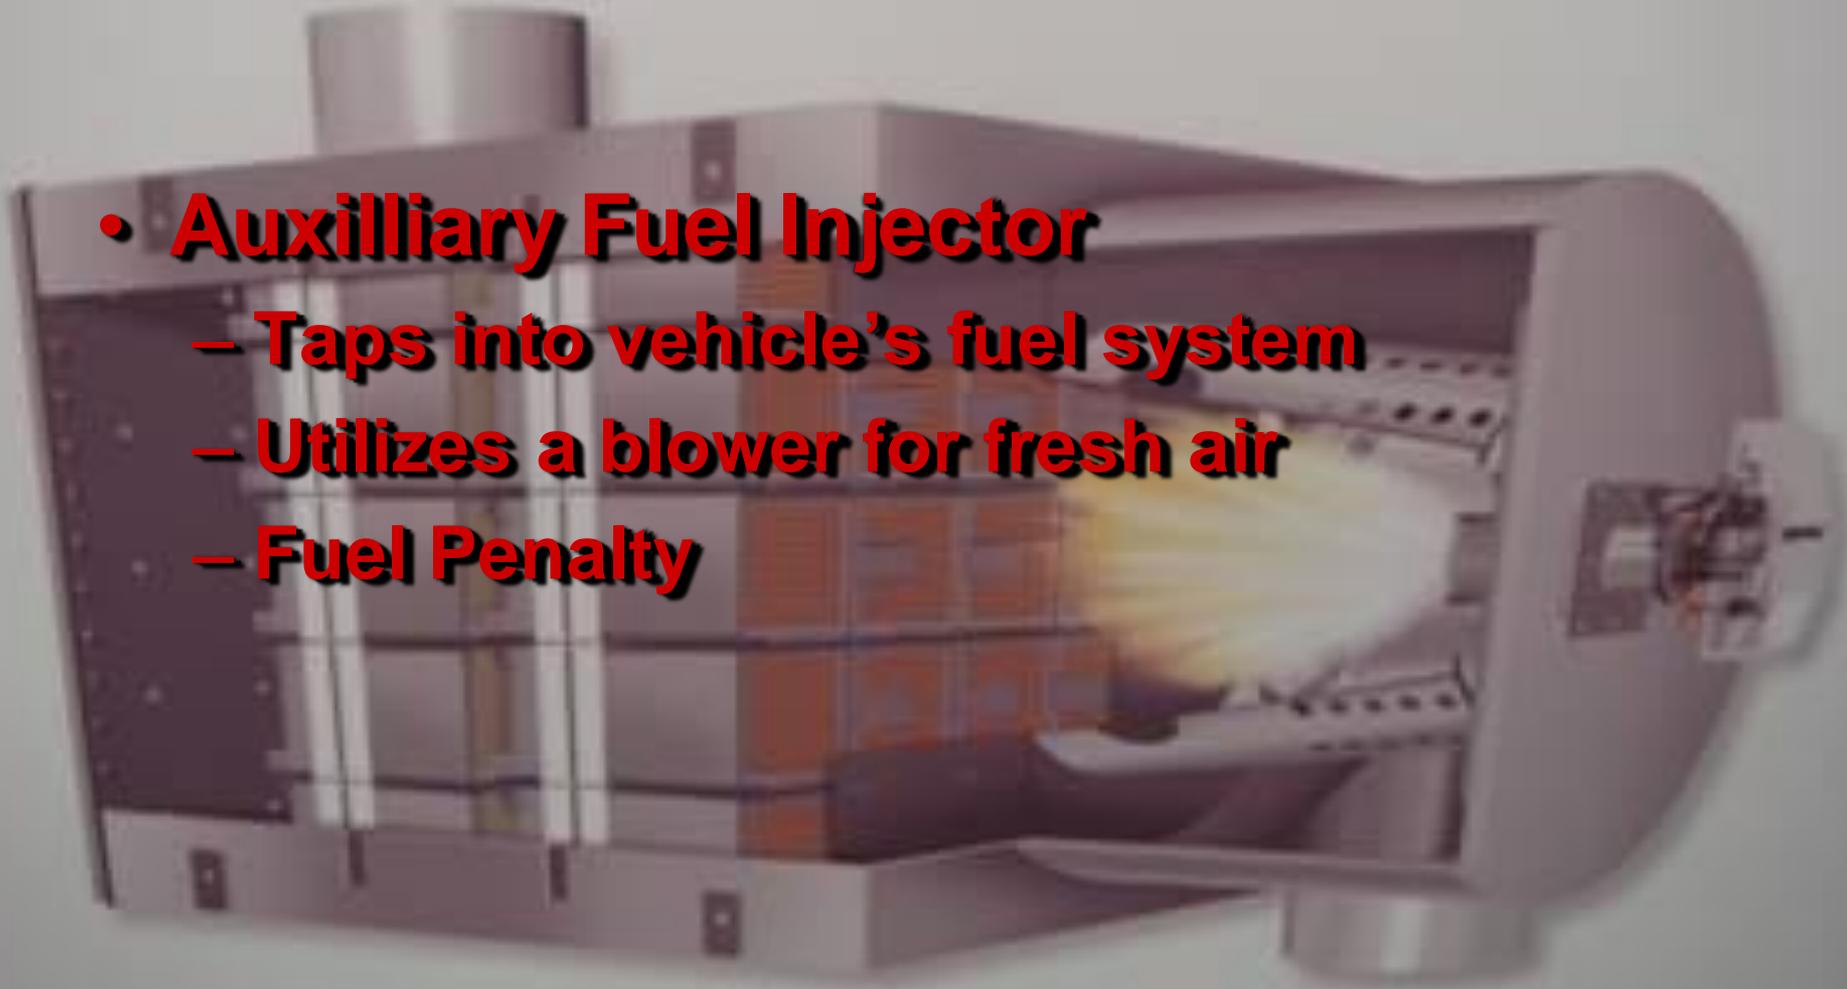


control unit



exhaust backpressure

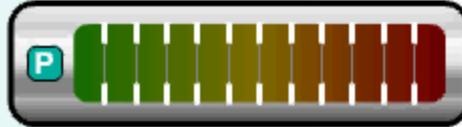

operating hours

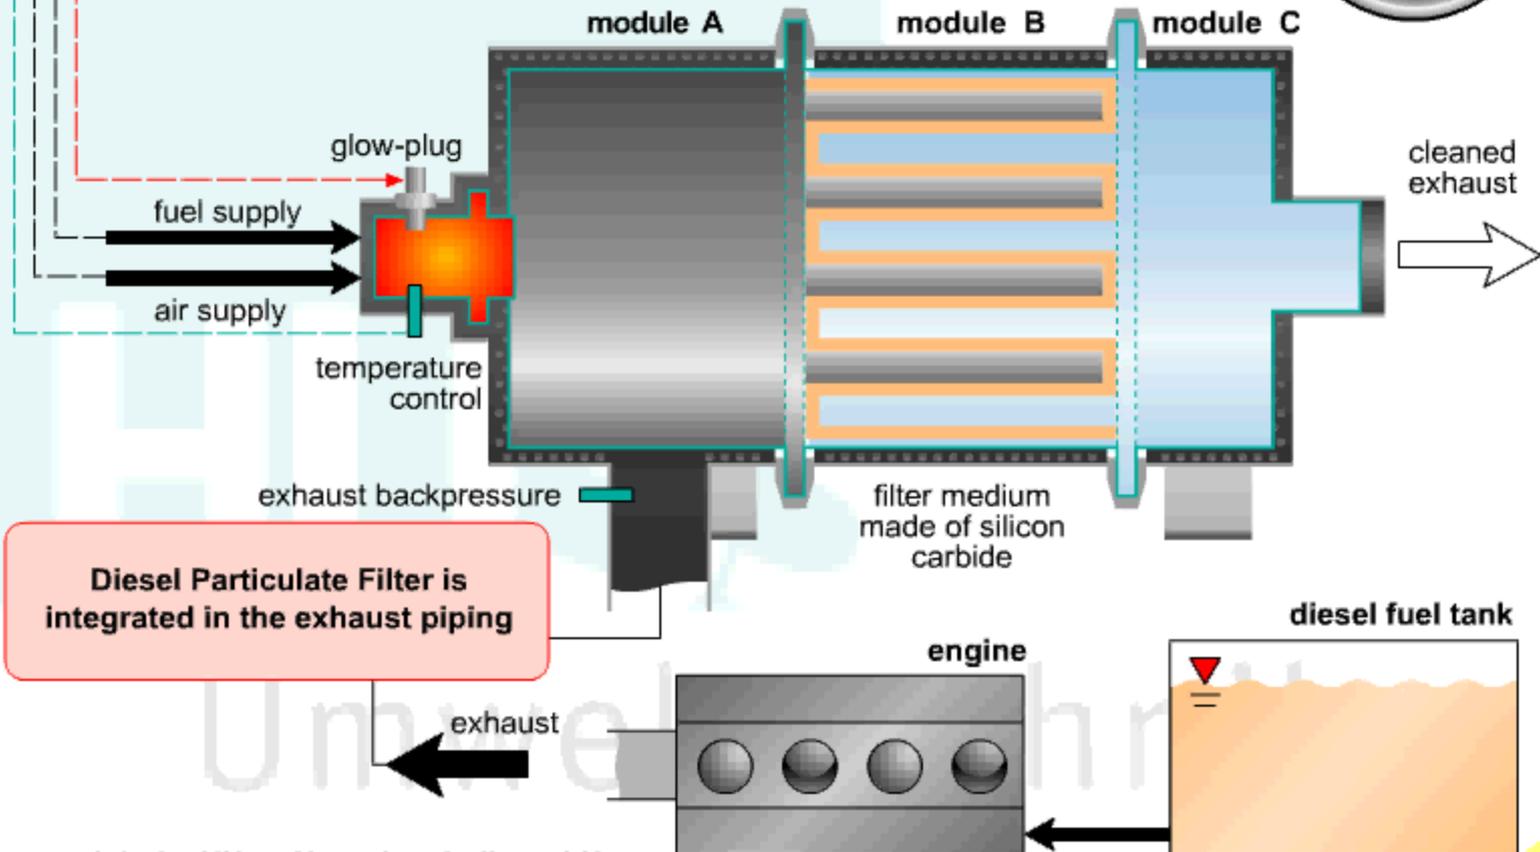

Copyright by HUSS-Umwelttechnik GmbH



Active Regeneration (O₂ @ 550° C)

- **Electrical**

- Online Electrical (Rypos)
- Offline/Off-board
- Offline/On-board



- **Fuel Dosing**

- Flame front using auxiliary injection and vehicle's fuel supply
- Air intake



Passive Regeneration


- **NO₂ oxidizes soot @ around 250° C**
- **NO₂ generation**
 - **Diesel Oxidation Catalysts**
 - **Catalyzed Filters**
 - **Fuel Born Catalysts (FBC)?**

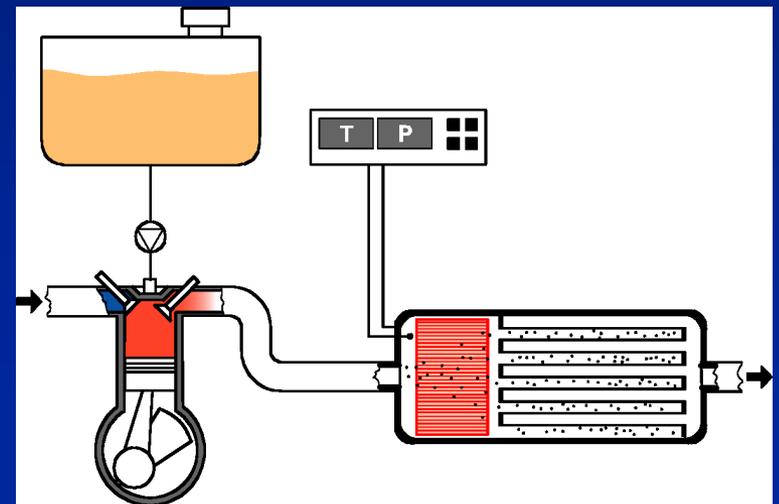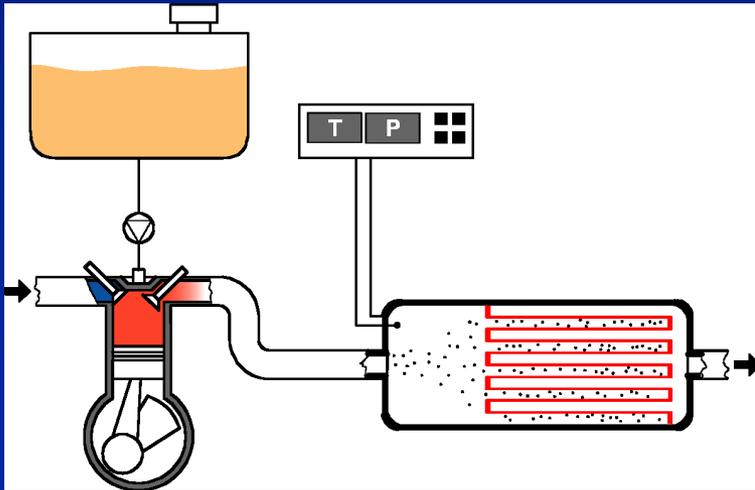

Soot & Ash

Definition of Soot

Soot is a byproduct of incomplete combustion




Soot Cleaning

- DPF Collects the soot
- Elevated exhaust temperatures convert the soot to vapor

Definition of Ash

Ash is Noncombustible residue of a lubricating oil or fuel



Ash Cleaning

- DPF Collects the ash
- Ash is removed using a special service tool

Aftertreatment Regeneration Device (ARD)

- **What is ARD?**
 - ARD is the device that increases exhaust gas temperature to enable regenerate the DPF
- **What are the benefits of the CRS System?**
 - Regenerates under all conditions

Comical Relief

Typical PM Spray Booth



Spray Booth Filter Inspection





**Spray Booth
Filter Inspection**



**Spray Booth
Filter Inspection**



PM Control: Wet Suppression



PM Control: Wet Suppression






**Gas Fired
I.C. Engine
Controls**

Gas Fired I.C. Engines



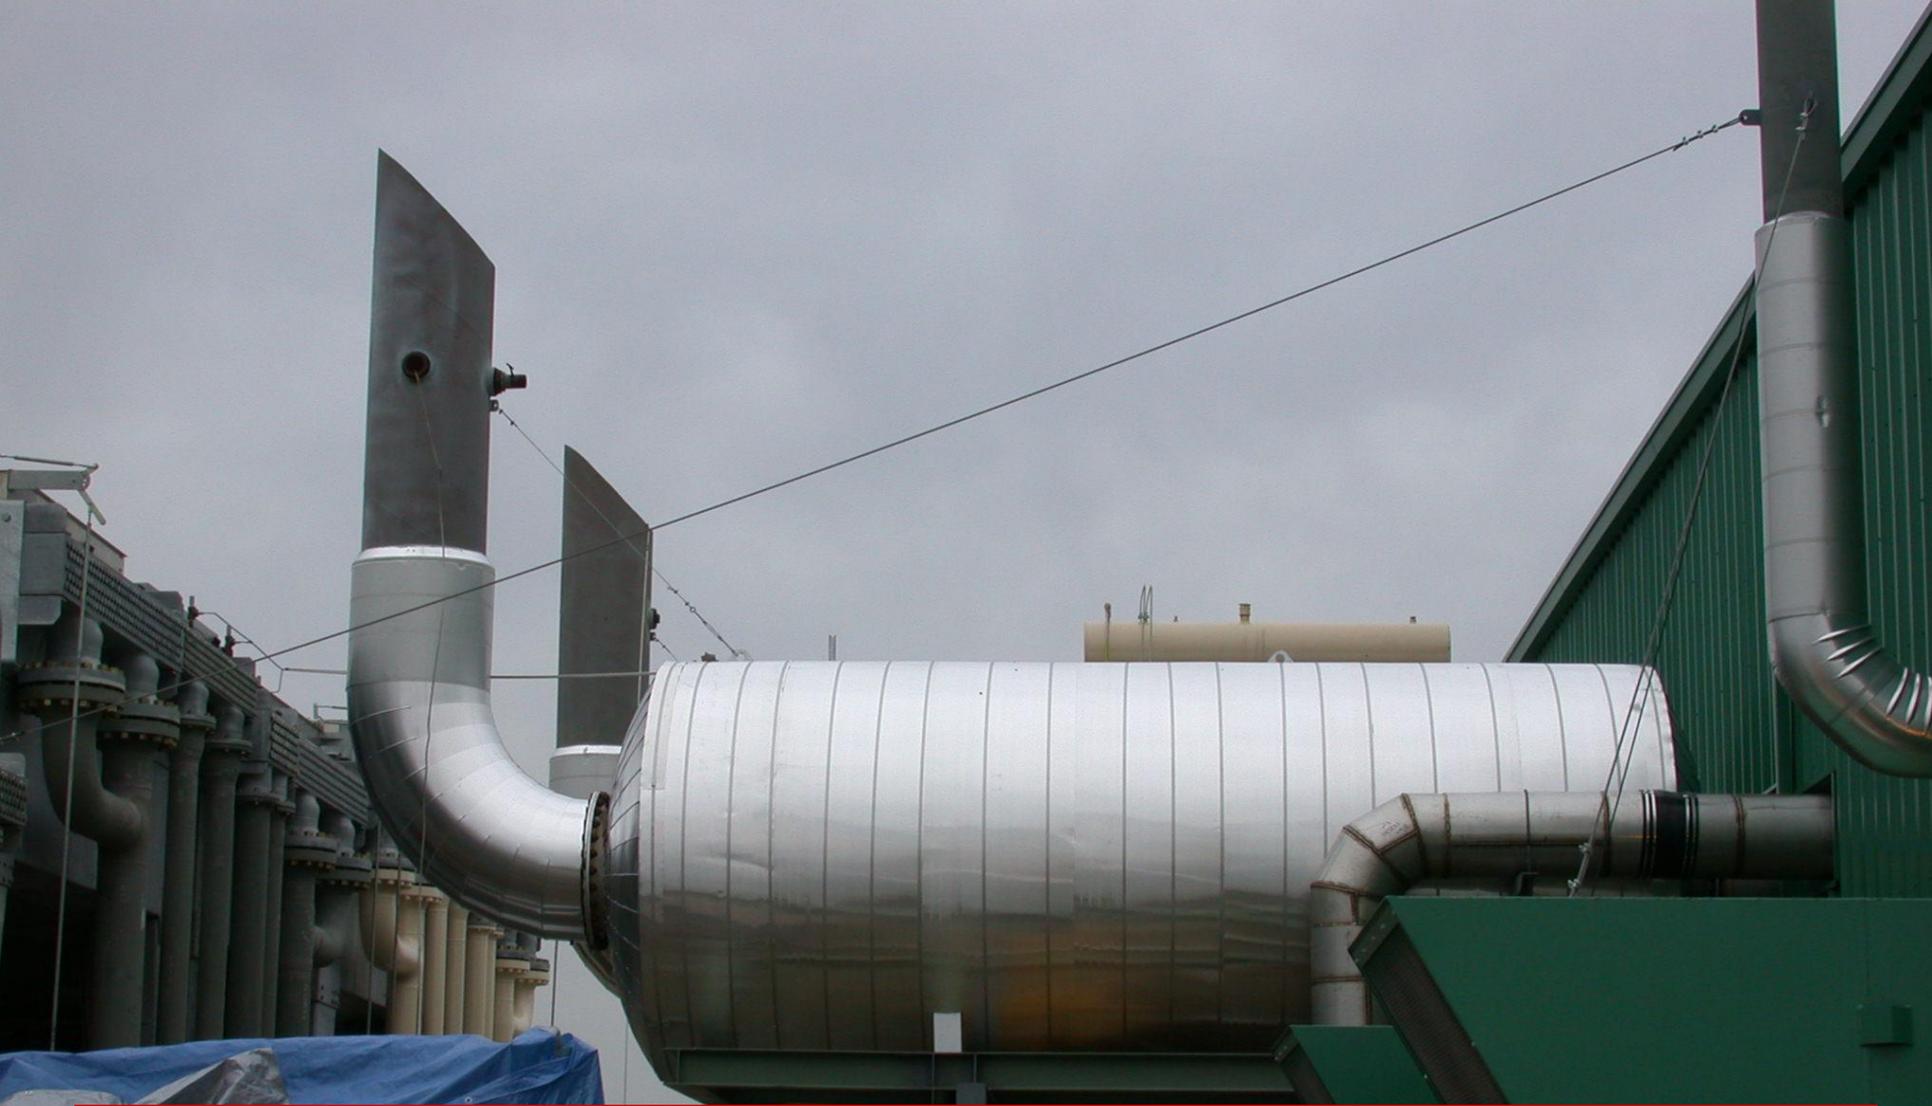



**3-way Catalyst:
Non-Selective Catalytic Reduction**

3-way Catalyst: Non-Selective Catalytic Reduction

- **Rich burn/NG fired engine**
- **$2\text{CO} + 2\text{NO} \rightarrow 2\text{CO}_2 + \text{N}_2$**
- **$\text{NO} + \text{HC} + \text{O}_2 \rightarrow \text{N}_2 + \text{CO}_2 + \text{H}_2\text{O}$**
- **98% control for NO_x & CO**

Rich/Lean Catalyst Conversions

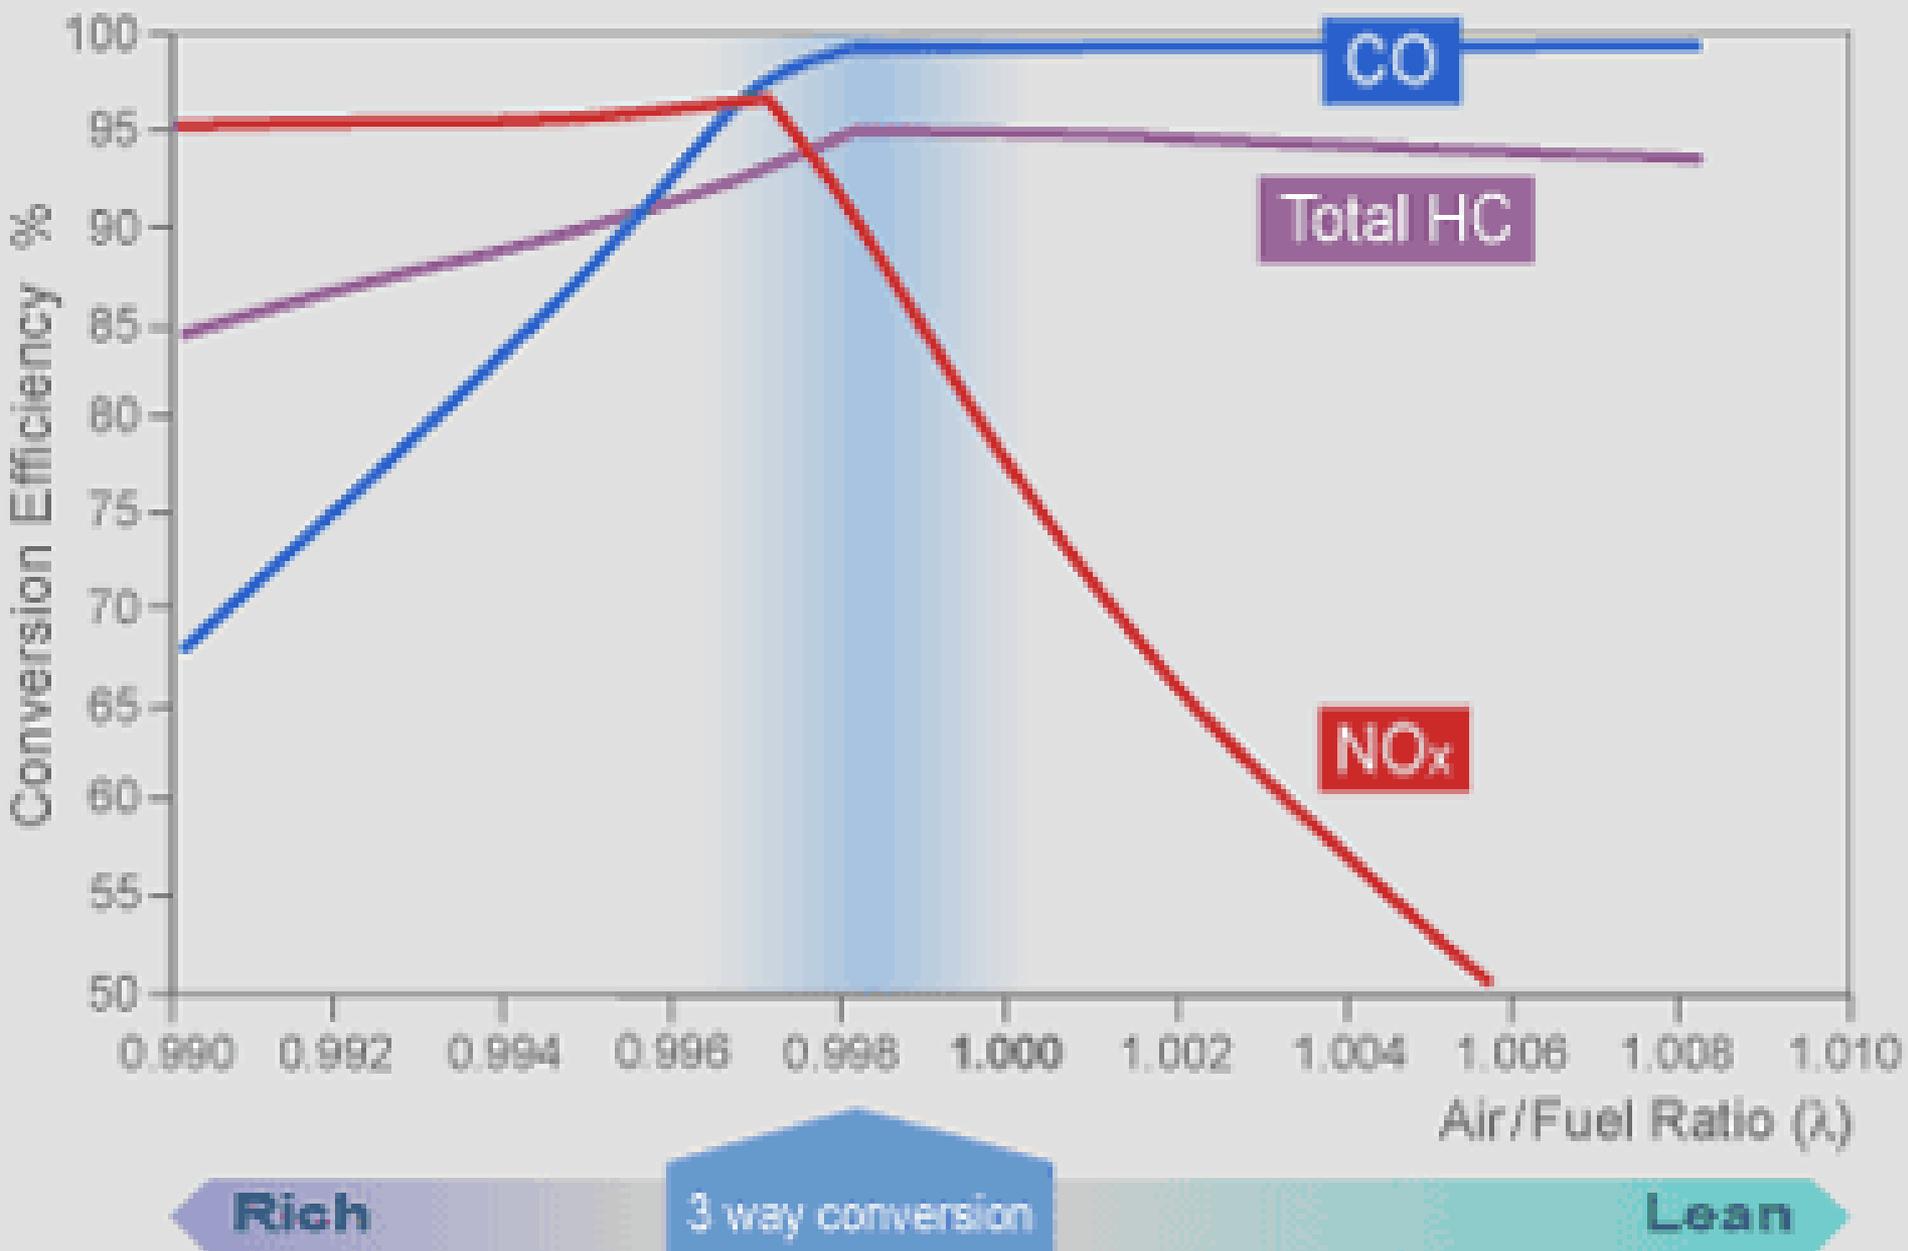

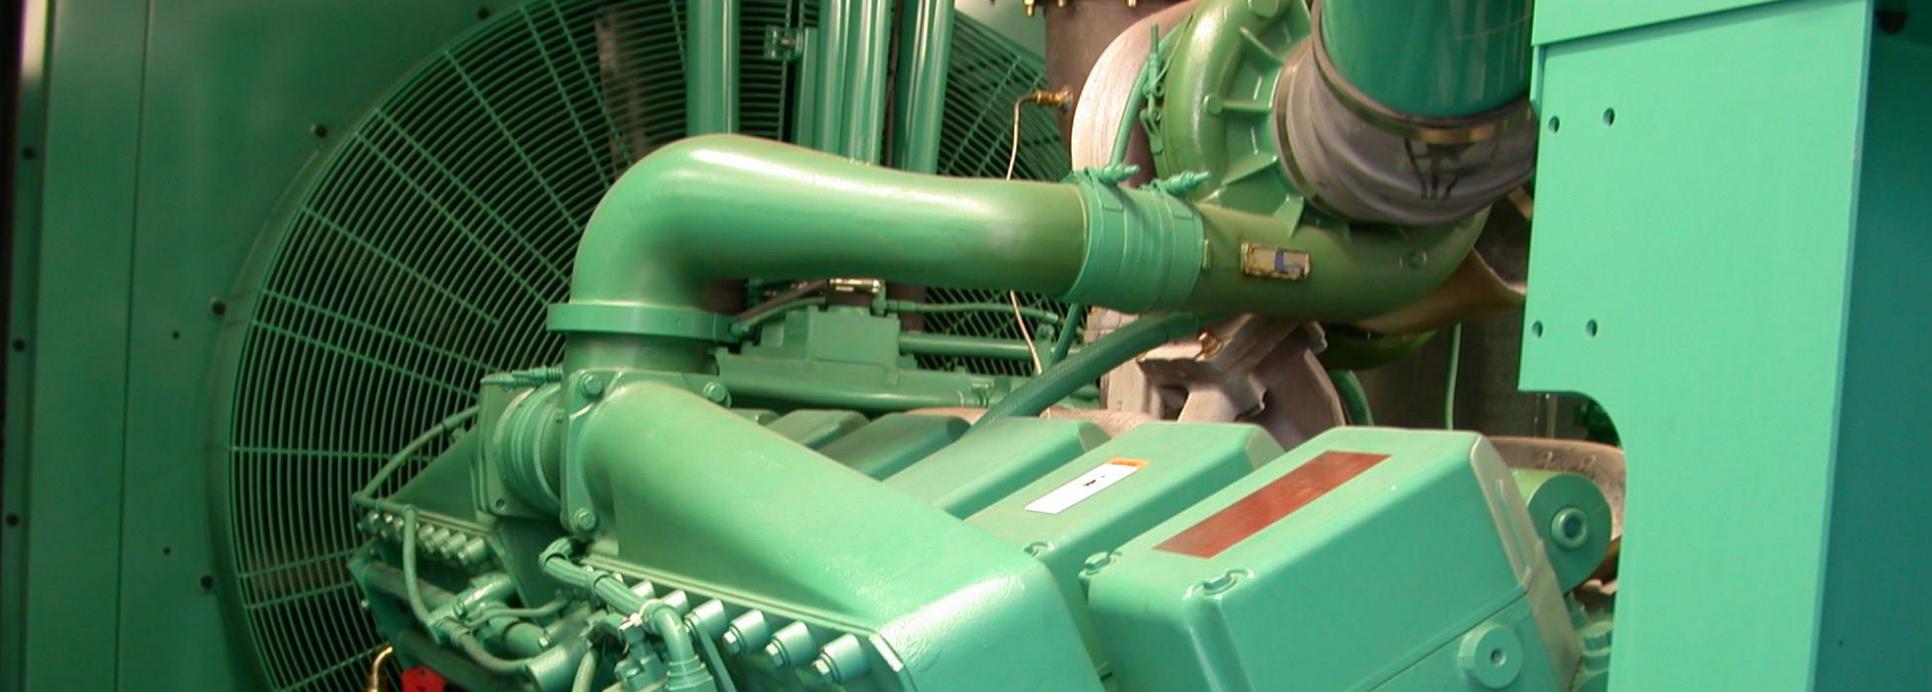

- **Issues with NSCR:**
 - **Air/Fuel ratio (AFR) controller required**
 - **O₂ sensor to maintain AFR**
 - **Inlet gas temp. range : 800-1200°F**
 - **Sulfur levels should be < 200 ppmv**



SCR Catalyst for IC Engines



<https://www.epa.gov/catc/clean-air-technology-center-products>

<https://www.epa.gov/air-emissions-factors-and-quantification/ap-42-compilation-air-emissions-factors>

The End